

Overview map of worksite

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Link Box ●	Overhead Line ○ ○ ○ ○ ○ ○ ○ ○ ○ ○ ○ ○	Underground Cable -	National Grid Telecoms - S - S - Private Cables - - - -	Pilot Cables - P - P - Pole Mounted Transformer ○ Ground Mounted Transformer □
Site Location	PL Service LV HV (11kV) HV (33kV) HV (66kV) HV (132kV)		PME Earth - E -	

PDF designed for A4 colour print only with no page scaling

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Scale: 1:1281 (When plotted at A4)

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

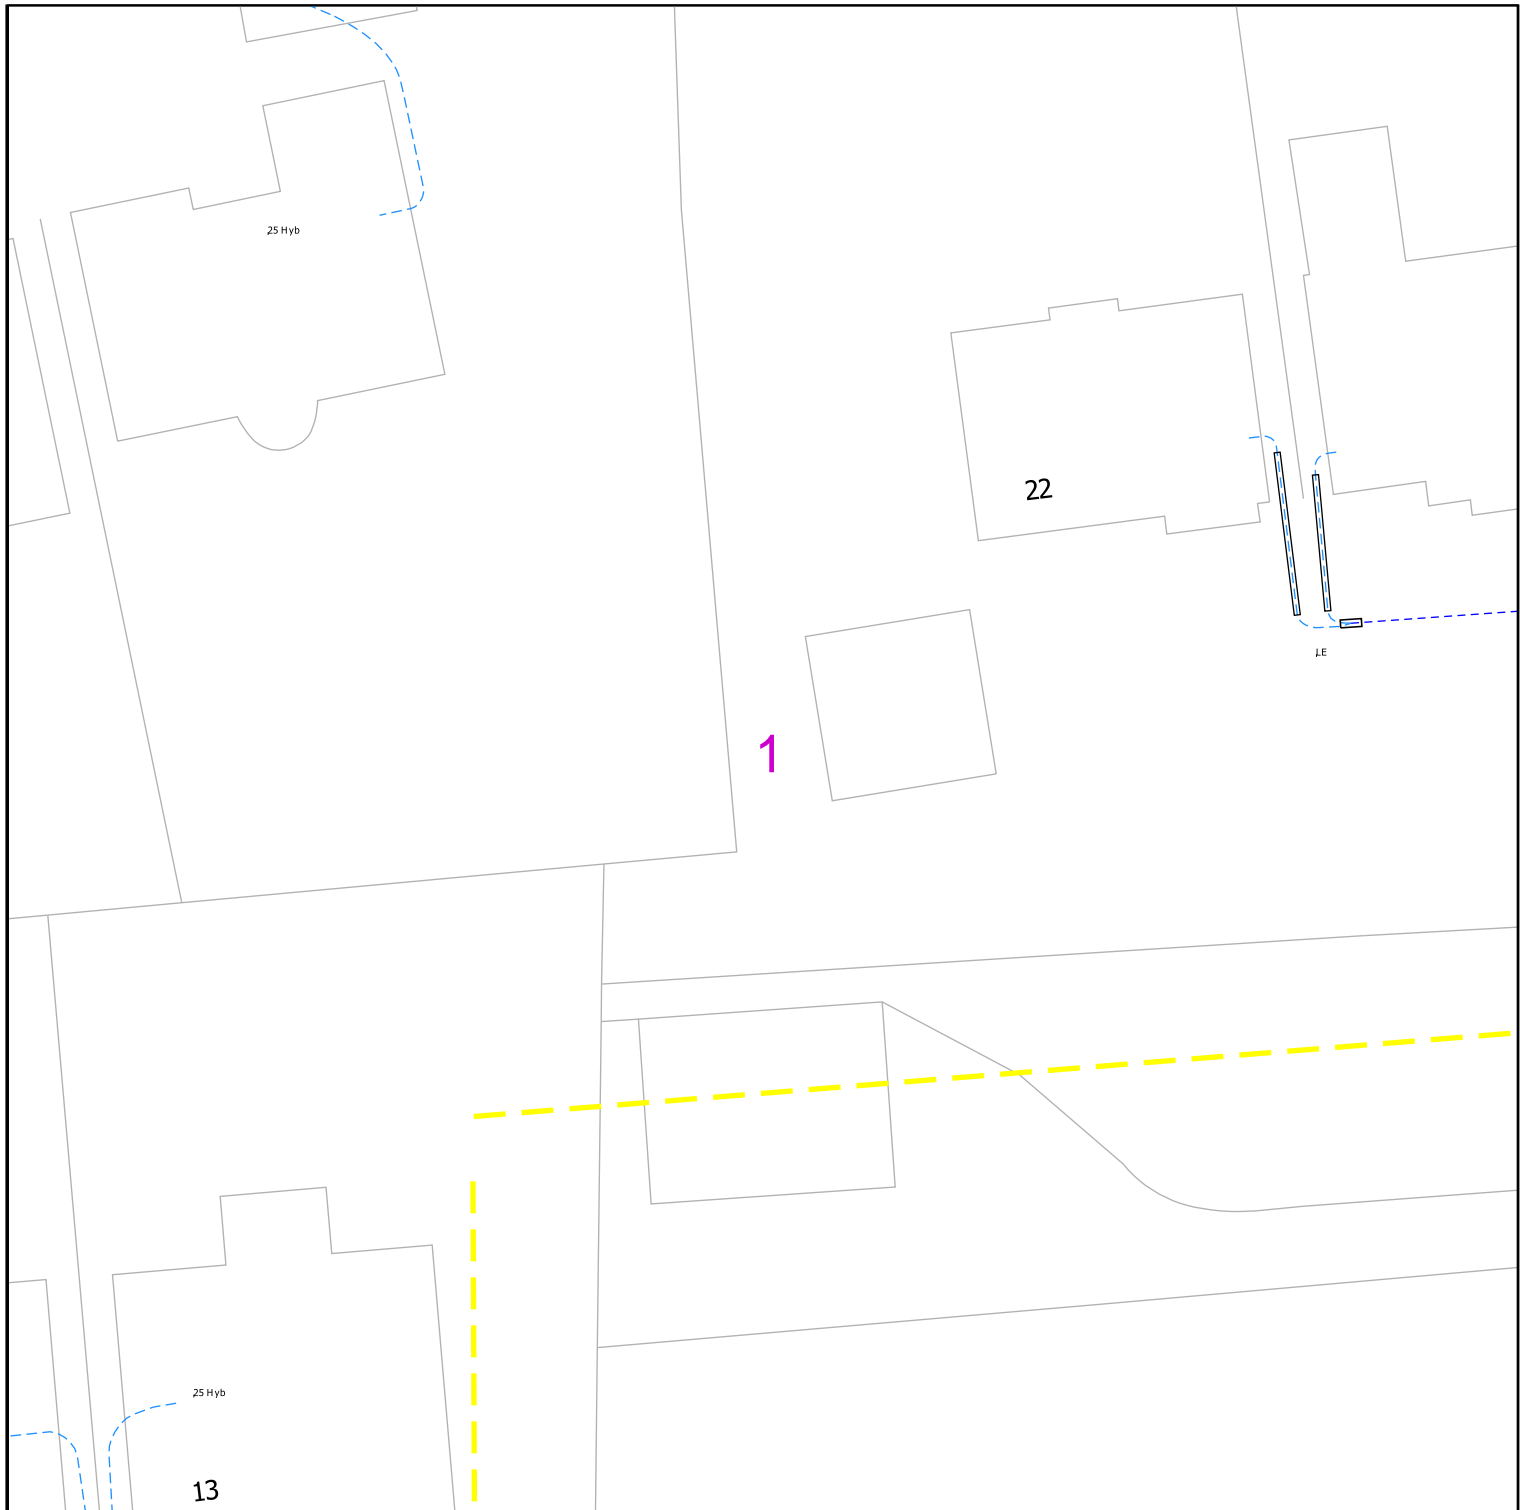

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	---	--	--

PDF designed for A4 colour print only with no page scaling


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

Scale: 1:250 (When plotted at A4)

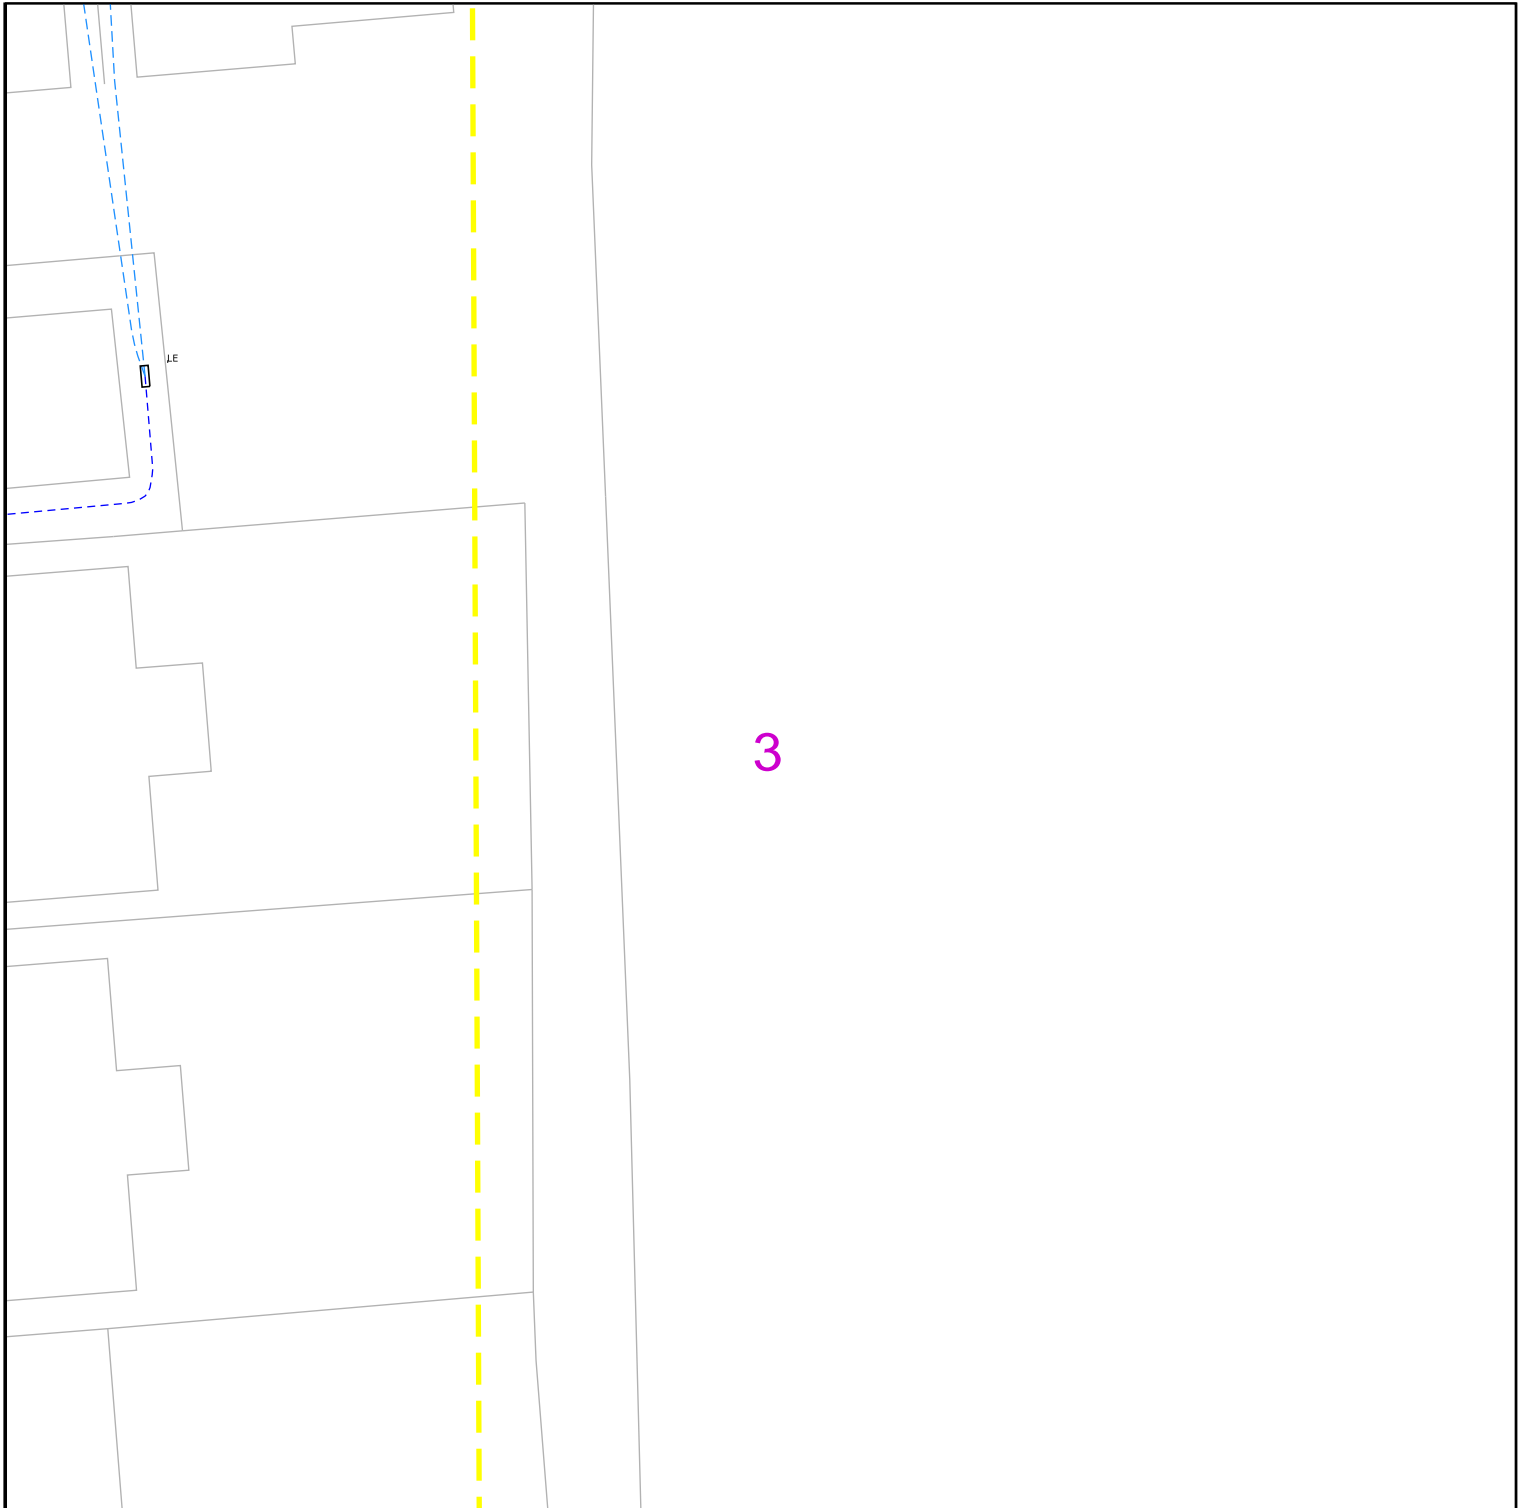

3

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

Scale: 1:250 (When plotted at A4)

0 2.5 m

Link Box ●	Overhead Line ○—○ ○—○ ○—○ ○—○ ○—○ ⊗—⊗	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — PME Earth —E— Underground Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	--	--	--


PDF designed for A4 colour print only with no page scaling

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
 NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

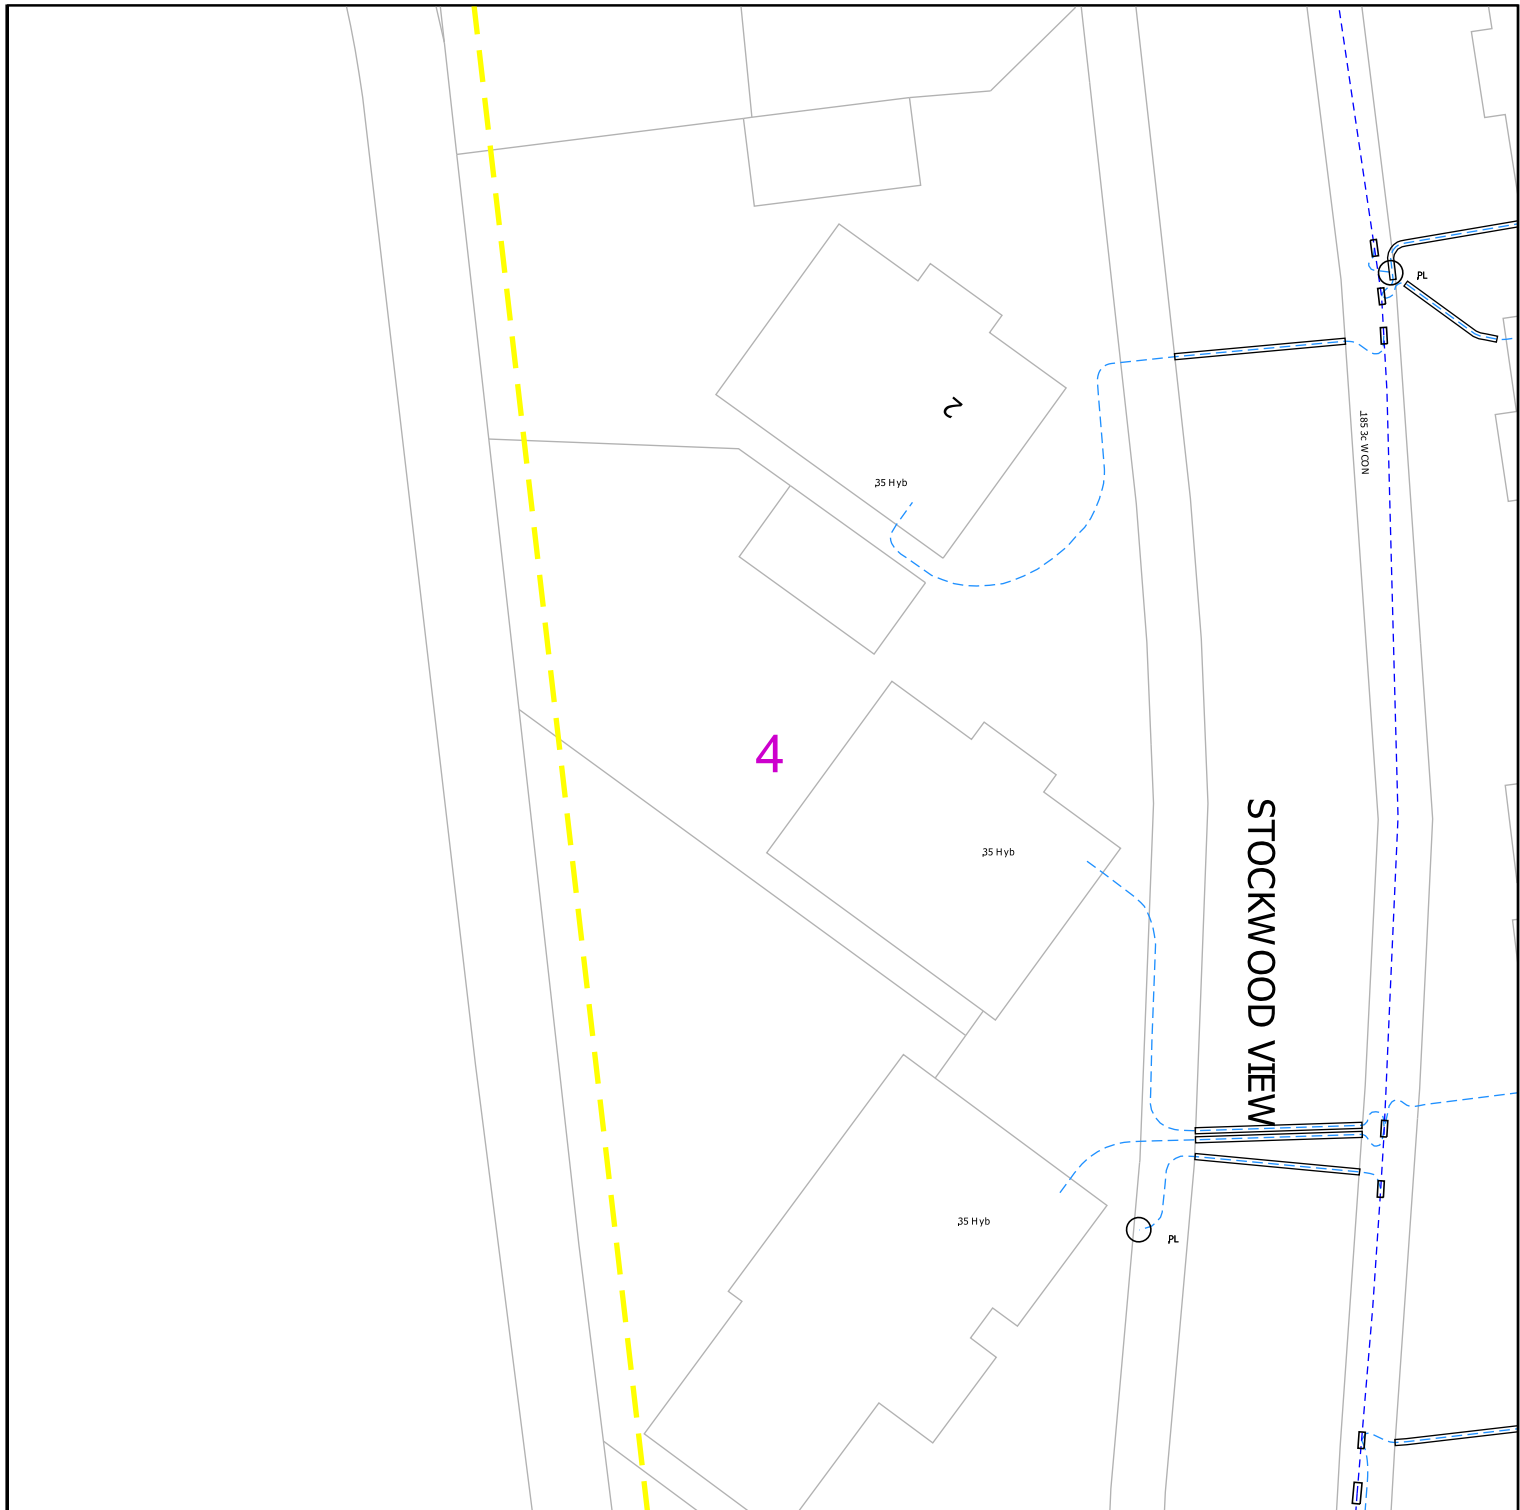

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	--	---	--

PDF designed for A4 colour print only with no page scaling


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Scale: 1:250 (When plotted at A4)

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

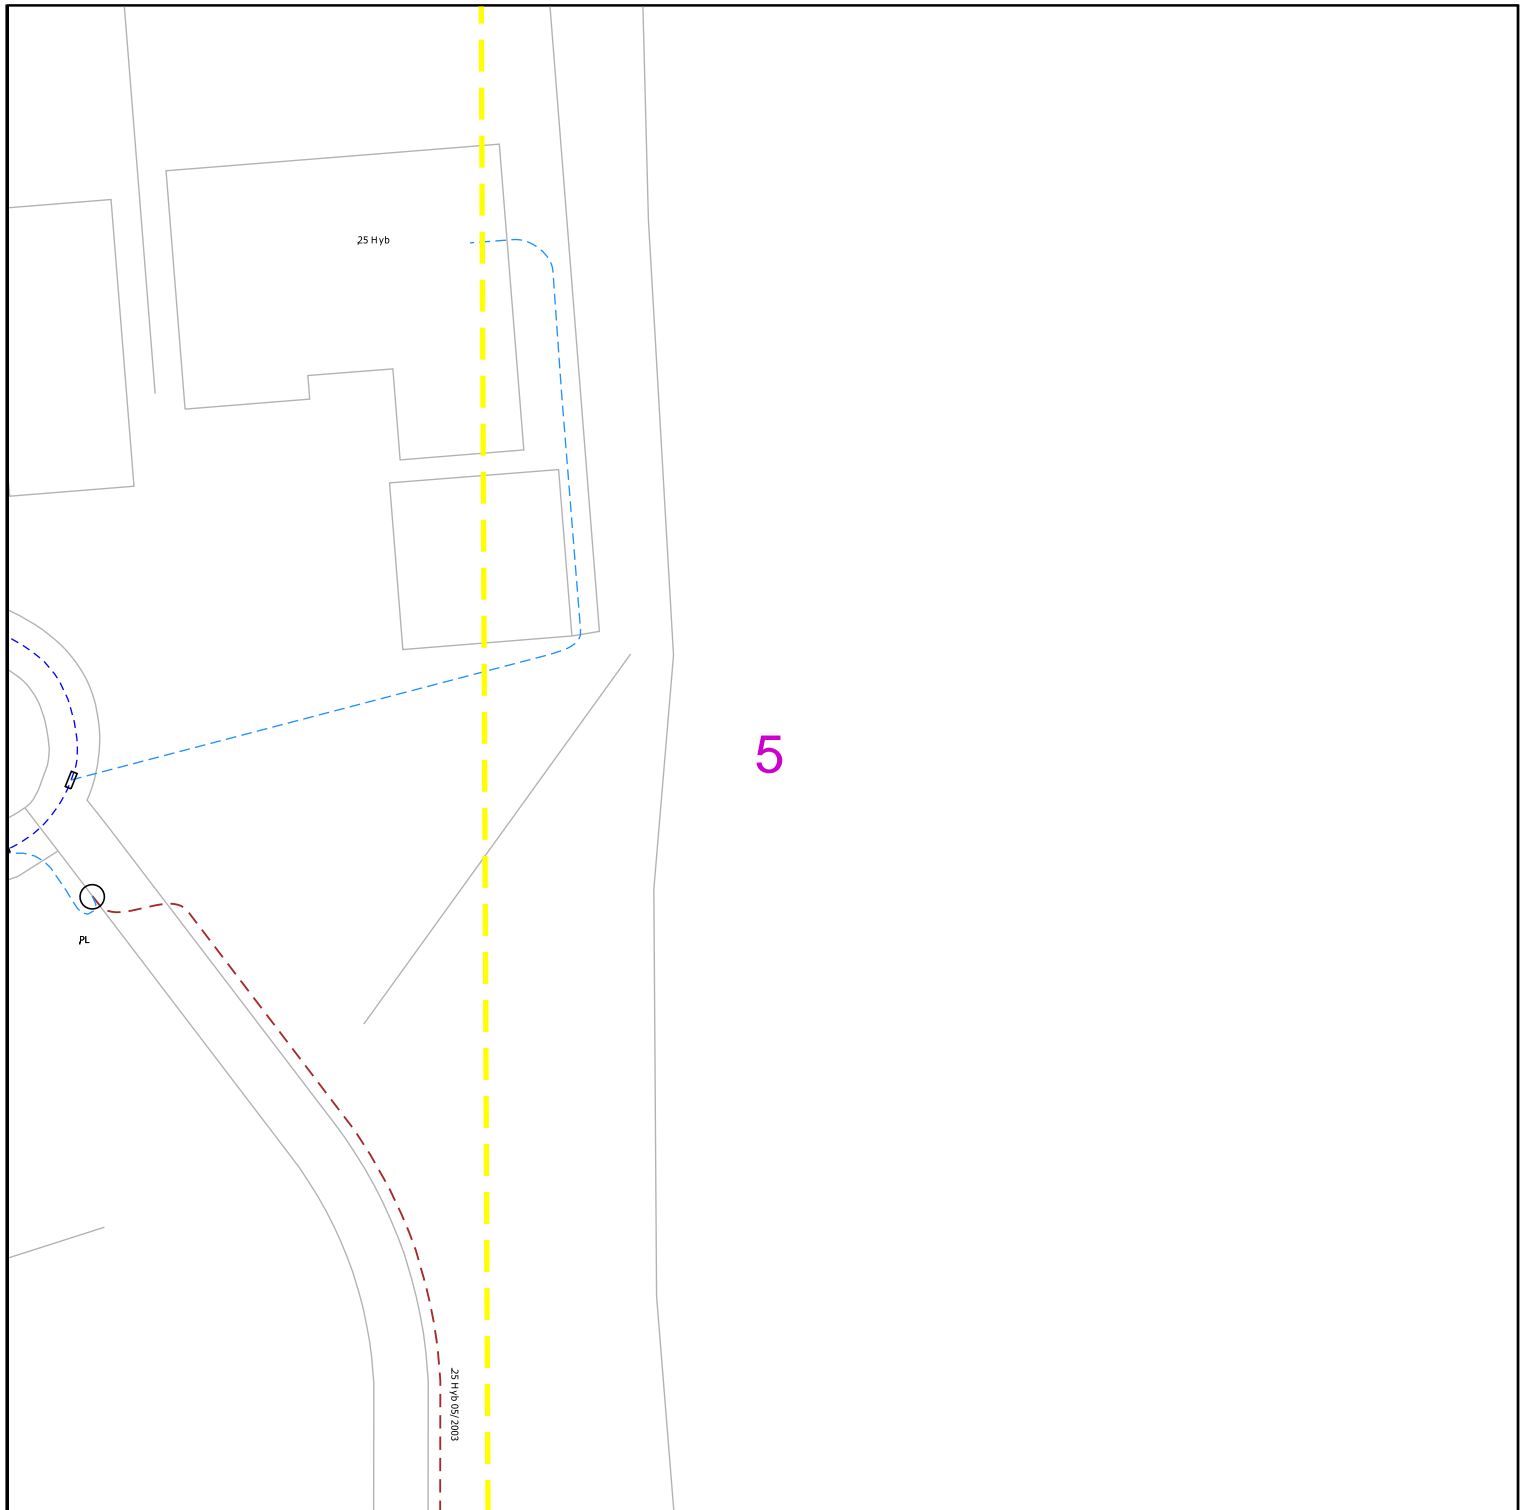

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E— Underground Earth	Pilot Cables —P—P— Pole Mounted Transformer Ground Mounted Transformer
----------------------	--	---	---	--

PDF designed for A4 colour print only with no page scaling

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Scale: 1:250 (When plotted at A4)

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

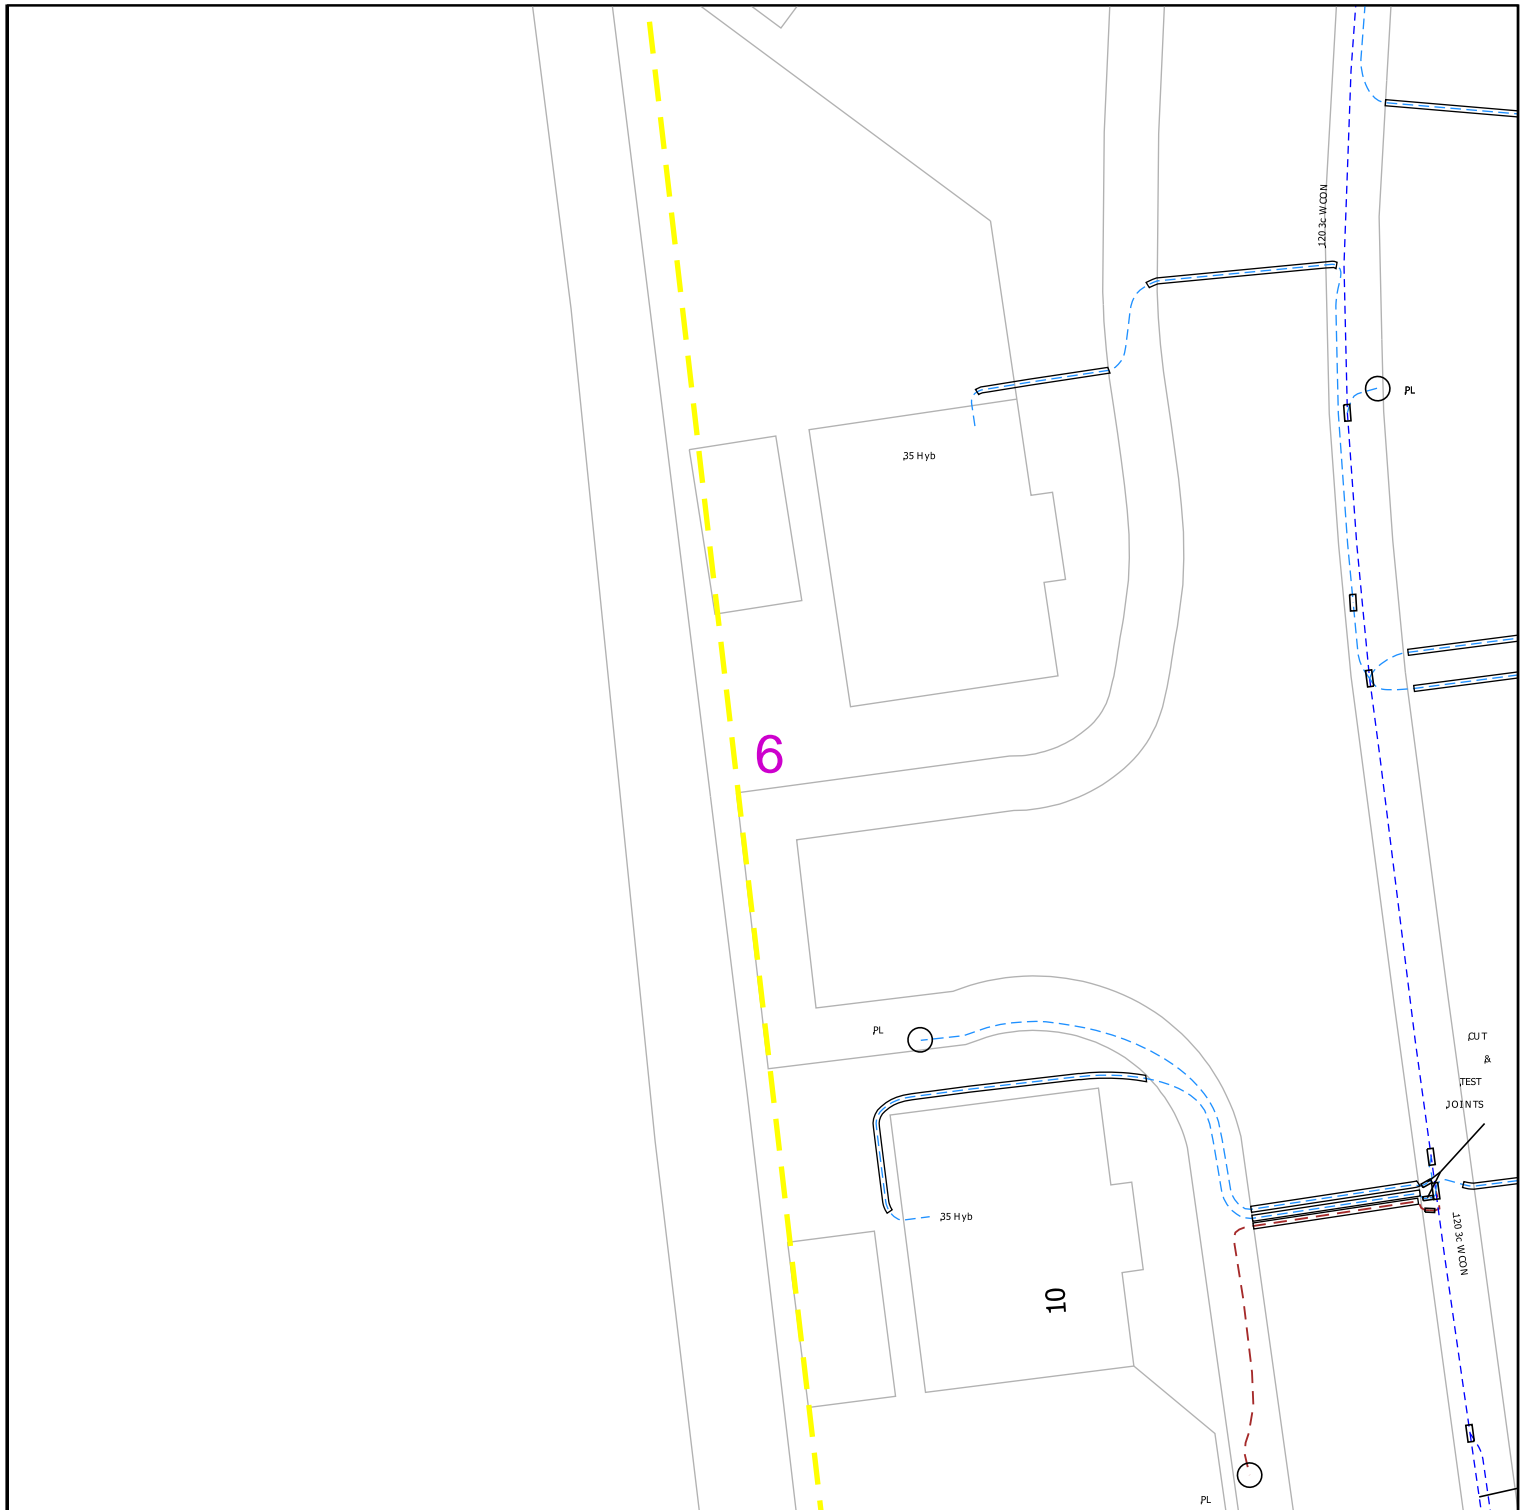

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E— Underground Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	---	--	--

PDF designed for A4 colour print only with no page scaling


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Scale: 1:250 (When plotted at A4)

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

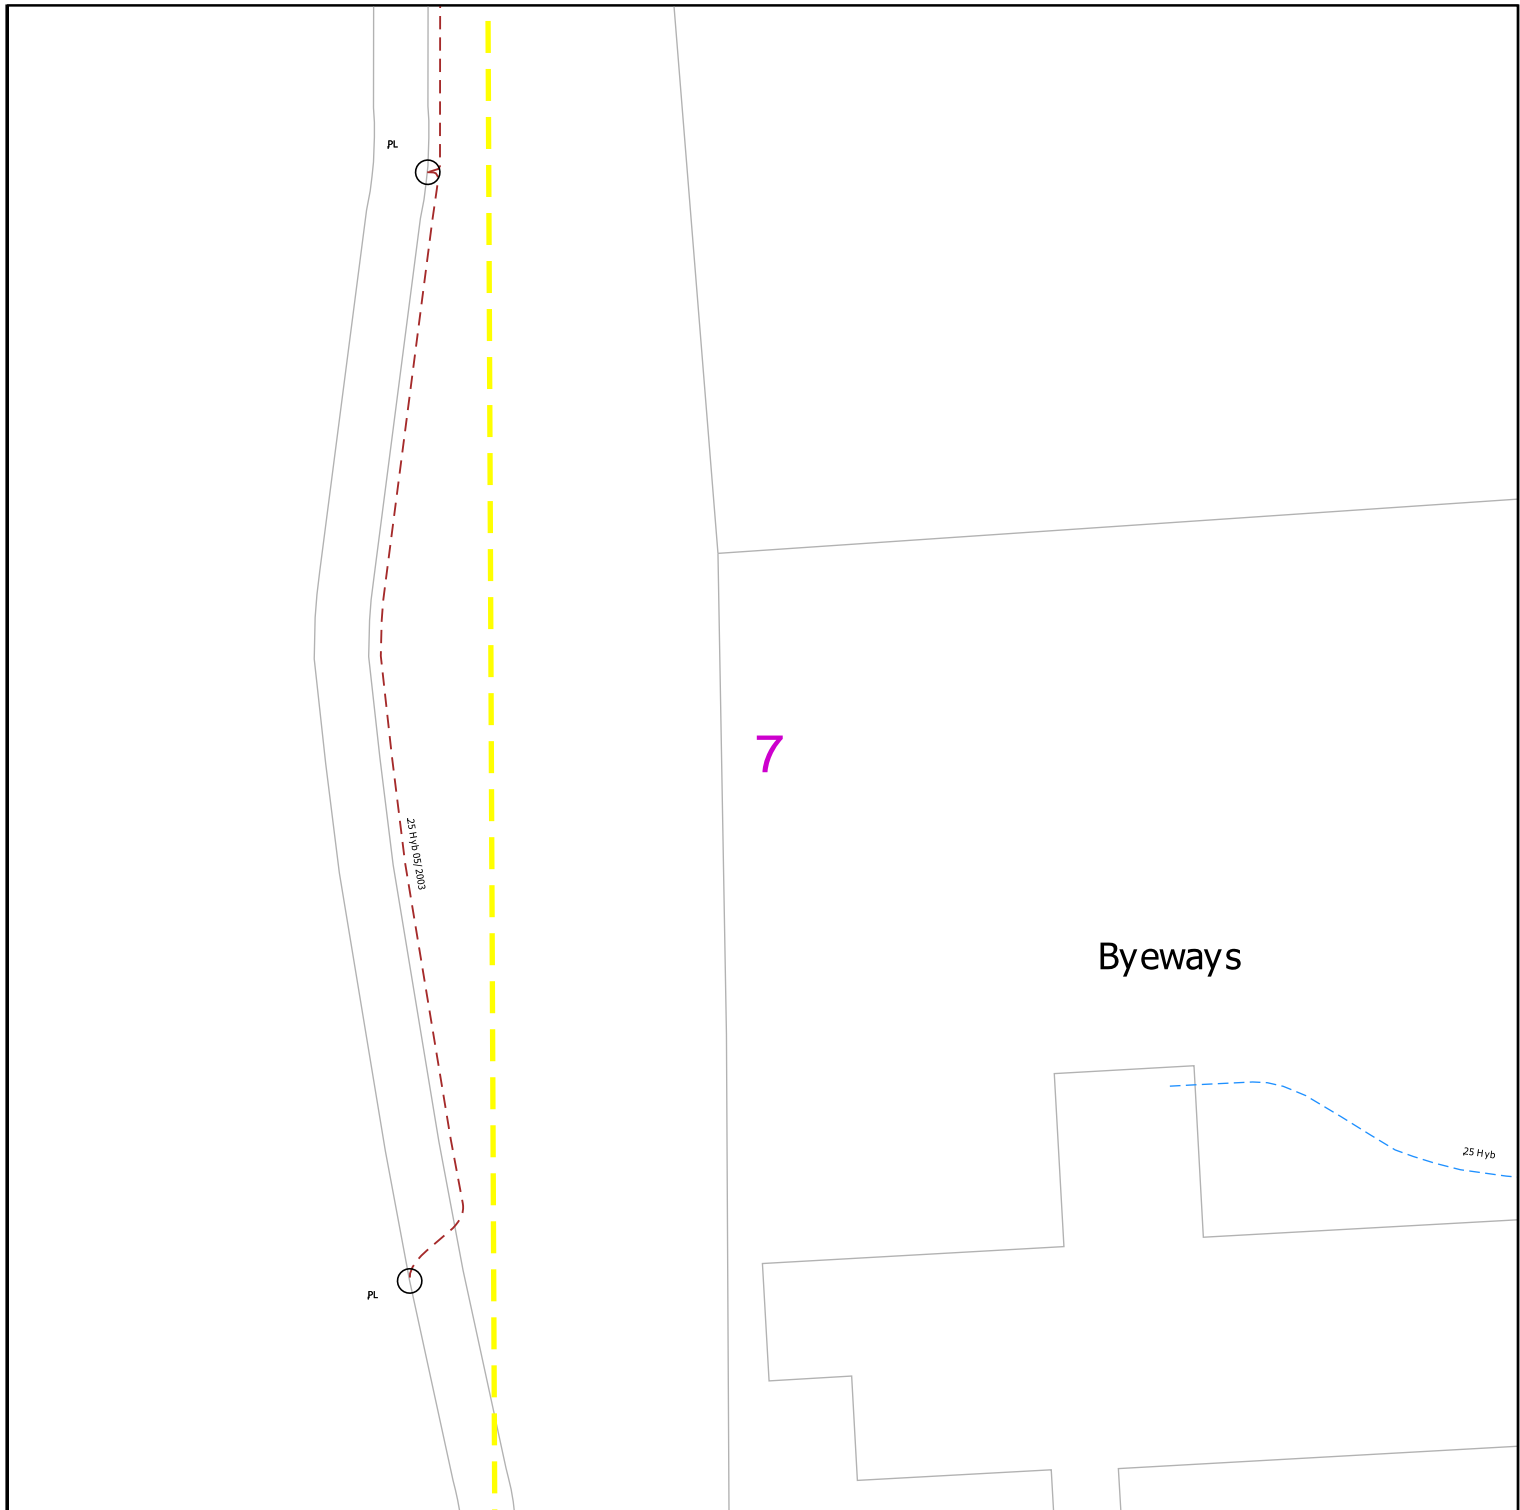

nationalgrid Electricity Distribution

Contact Us
Mapping Enquiries:
 All areas 0121 623 9780
General Enquiries:
 All areas 0800 096 3080

Date Requested: 19/09/2025
 Job Reference: 38759319
 Site Location: 336784 189787
 Requested by: Mr Geraint Roberts
 Your Scheme/Reference: 25/0589

0 2.5 m


Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E— Underground Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	--	--	--

PDF designed for A4 colour print only with no page scaling

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

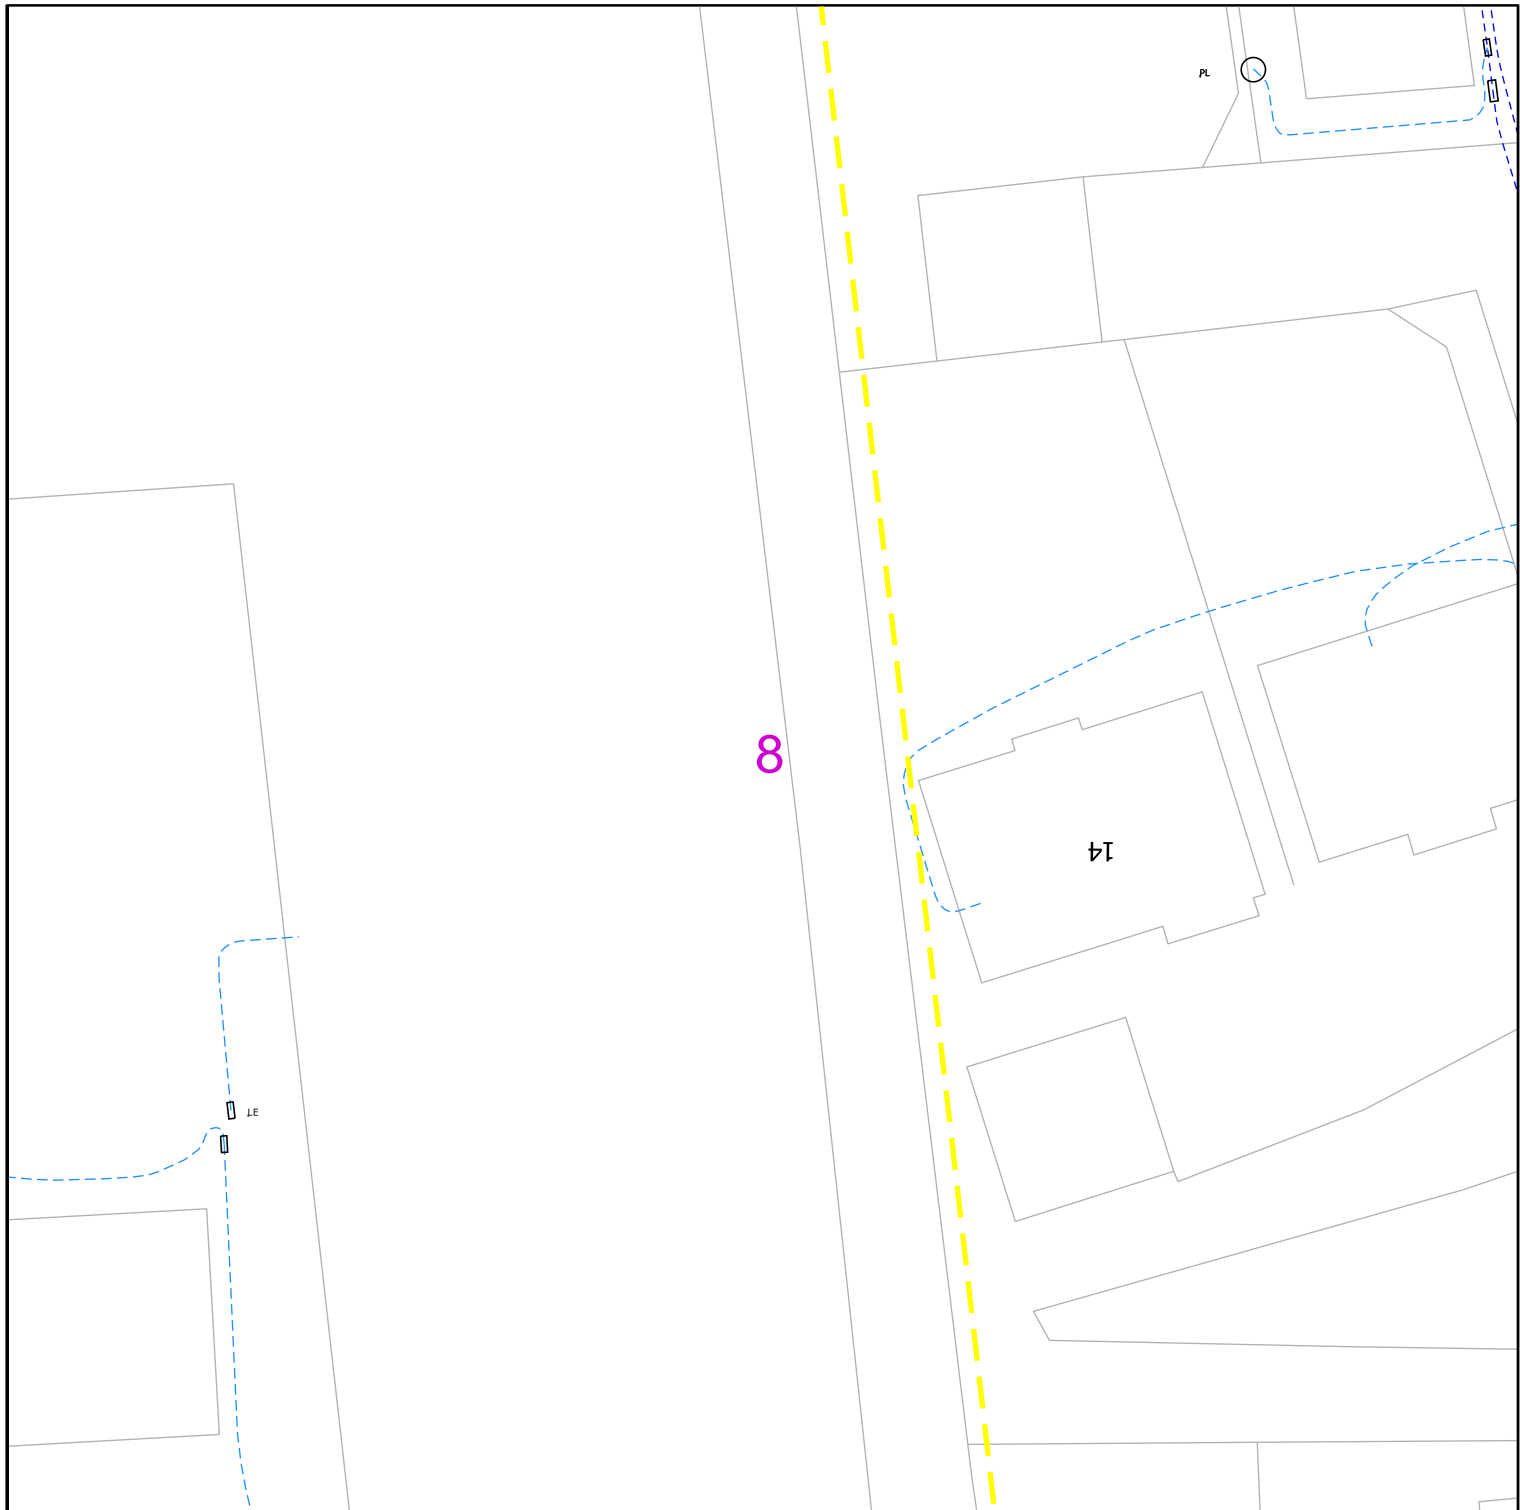

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ○—○ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — —	Pilot Cables — P — P — Pole Mounted Transformer ○ Ground Mounted Transformer □
Site Location Line/Area 			PME Earth —E— Underground Earth —E—	

PDF designed for A4 colour print only with no page scaling


IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Scale: 1:250 (When plotted at A4)

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

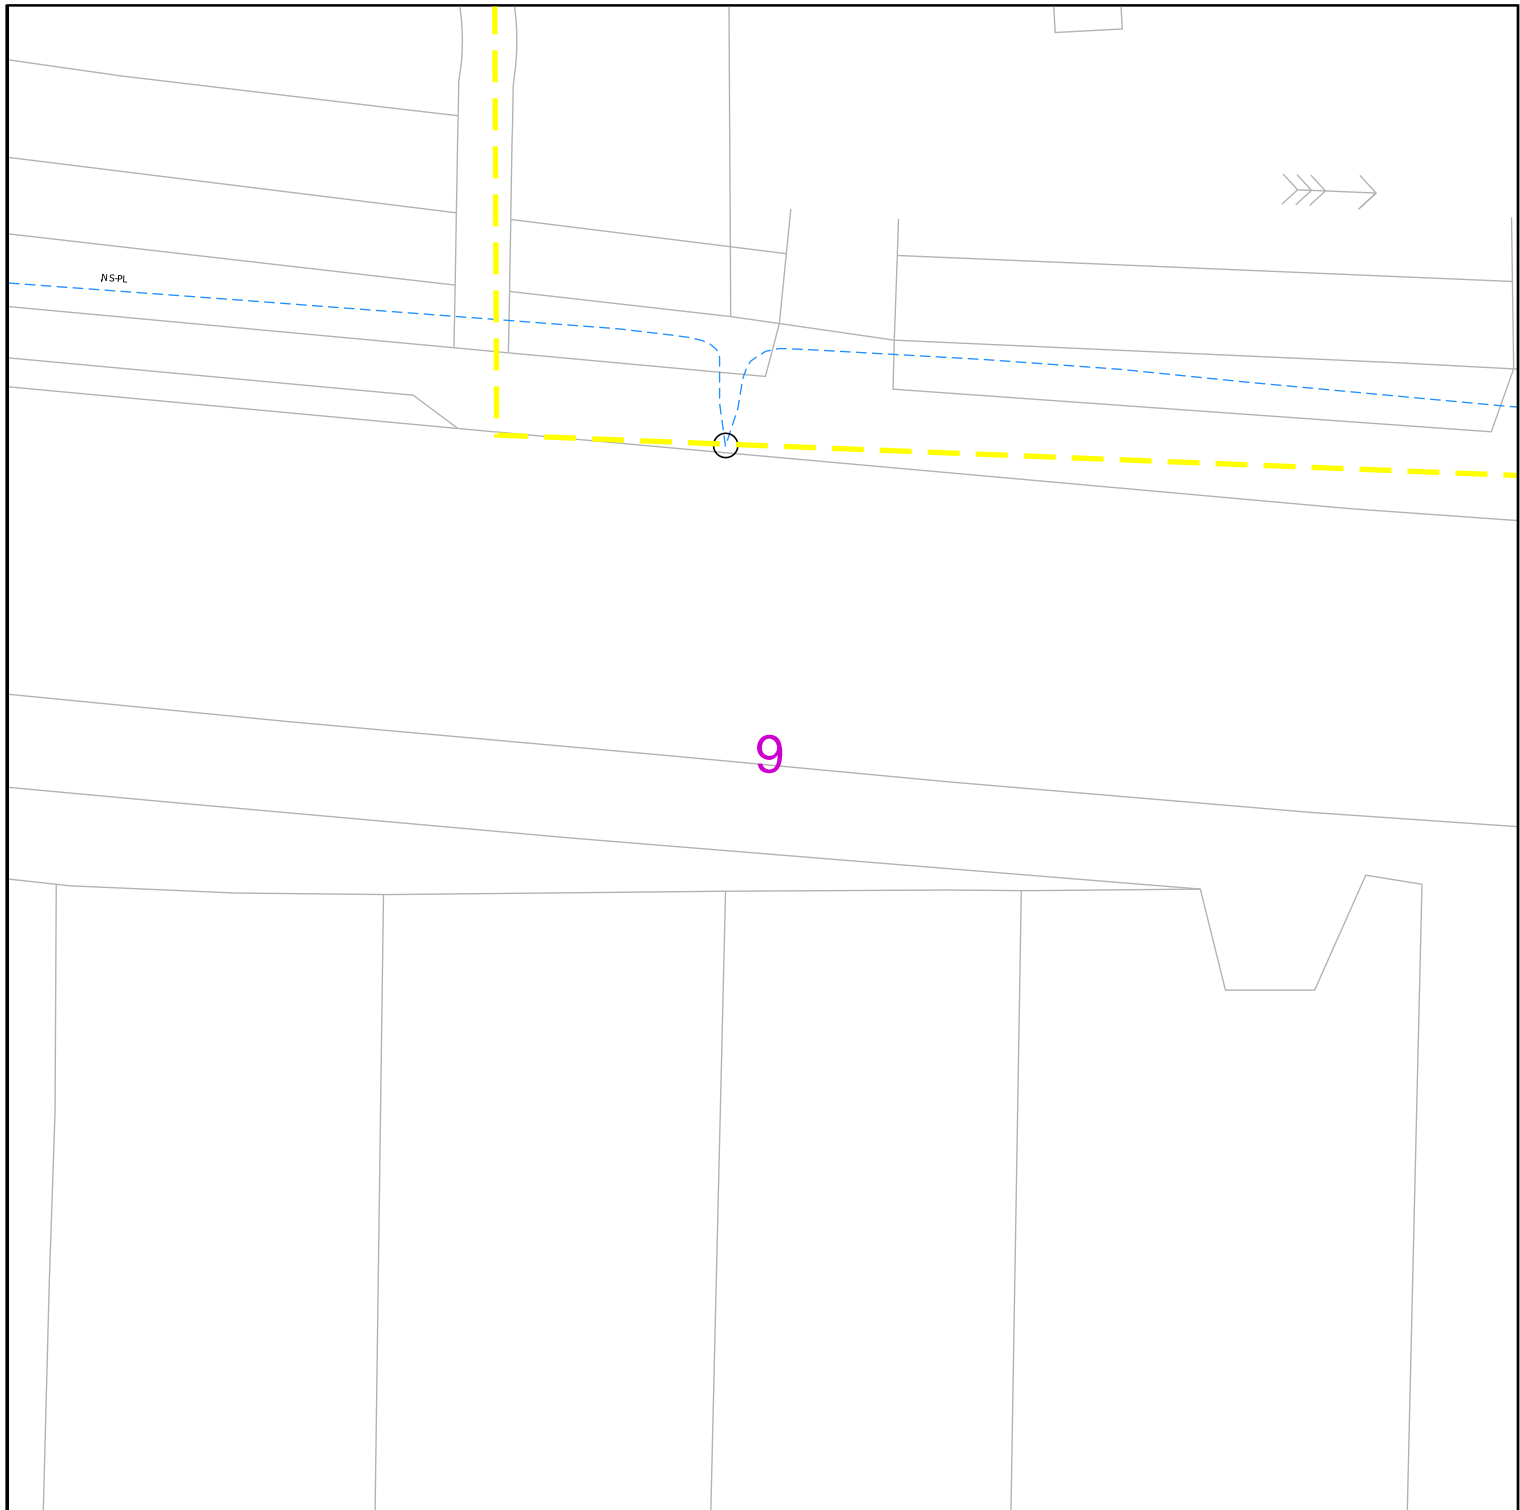

nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

Scale: 1:250 (When plotted at A4)

0 2.5 m

Link Box ●	Overhead Line ○—○ PL ○—○ Service ○—○ LV ○—○ HV (11kV) ○—○ HV (33kV) ○—○ HV (66kV) ⊠—⊠ HV (132kV)	Underground Cable -	National Grid Telecoms —S—S— Private Cables — — — — — PME Earth —E— Underground Earth —E—	Pilot Cables —P—P— Pole Mounted Transformer ○ Ground Mounted Transformer □
----------------------	--	---	--	--


PDF designed for A4 colour print only with no page scaling

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
 NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

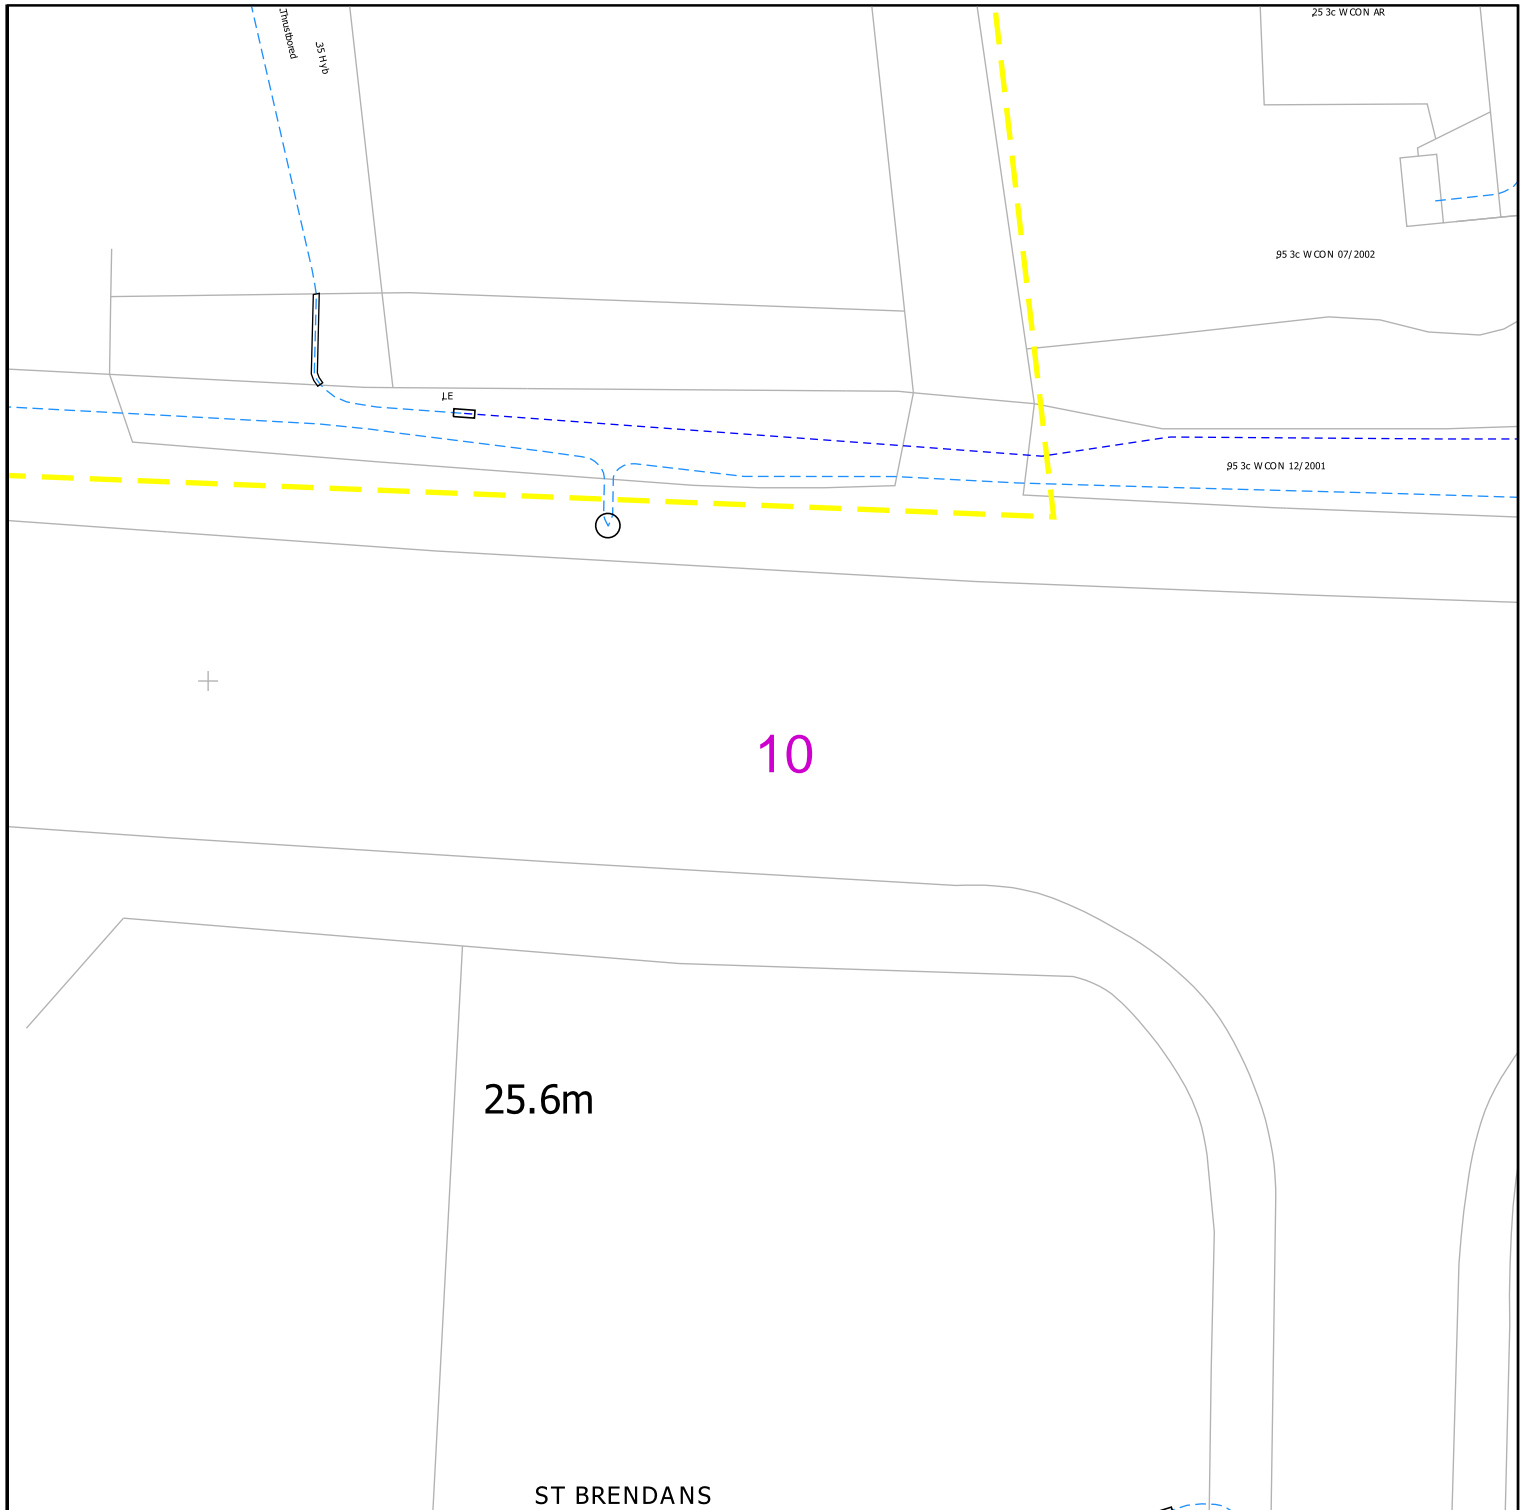


nationalgrid Electricity Distribution

Contact Us

Mapping Enquiries:
All areas 0121 623 9780

General Enquiries:
All areas 0800 096 3080

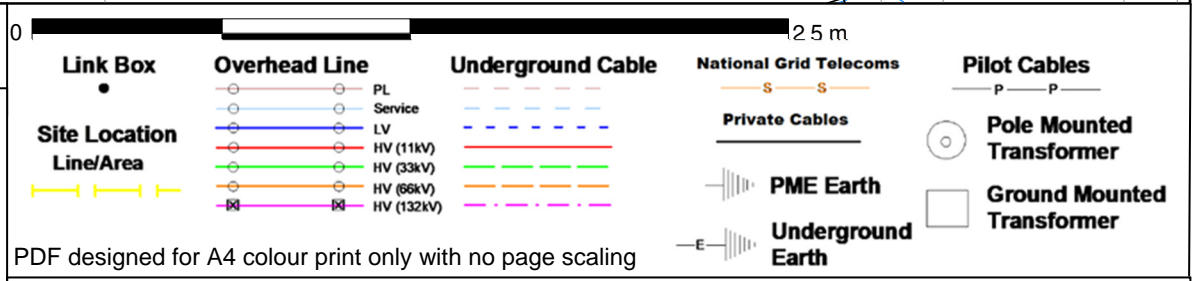

Date Requested: 19/09/2025
Job Reference: 38759319
Site Location: 336784 189787
Requested by: Mr Geraint Roberts
Your Scheme/Reference: 25/0589

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our General Enquiries number.
- Advice should be sought from the National Grid Electricity Distribution General Enquiries team for any work that is to take place in proximity to 132kV underground cables and 132kV overhead lines.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA: 0800 6783 105

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432
NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

Scale: 1:250 (When plotted at A4)