


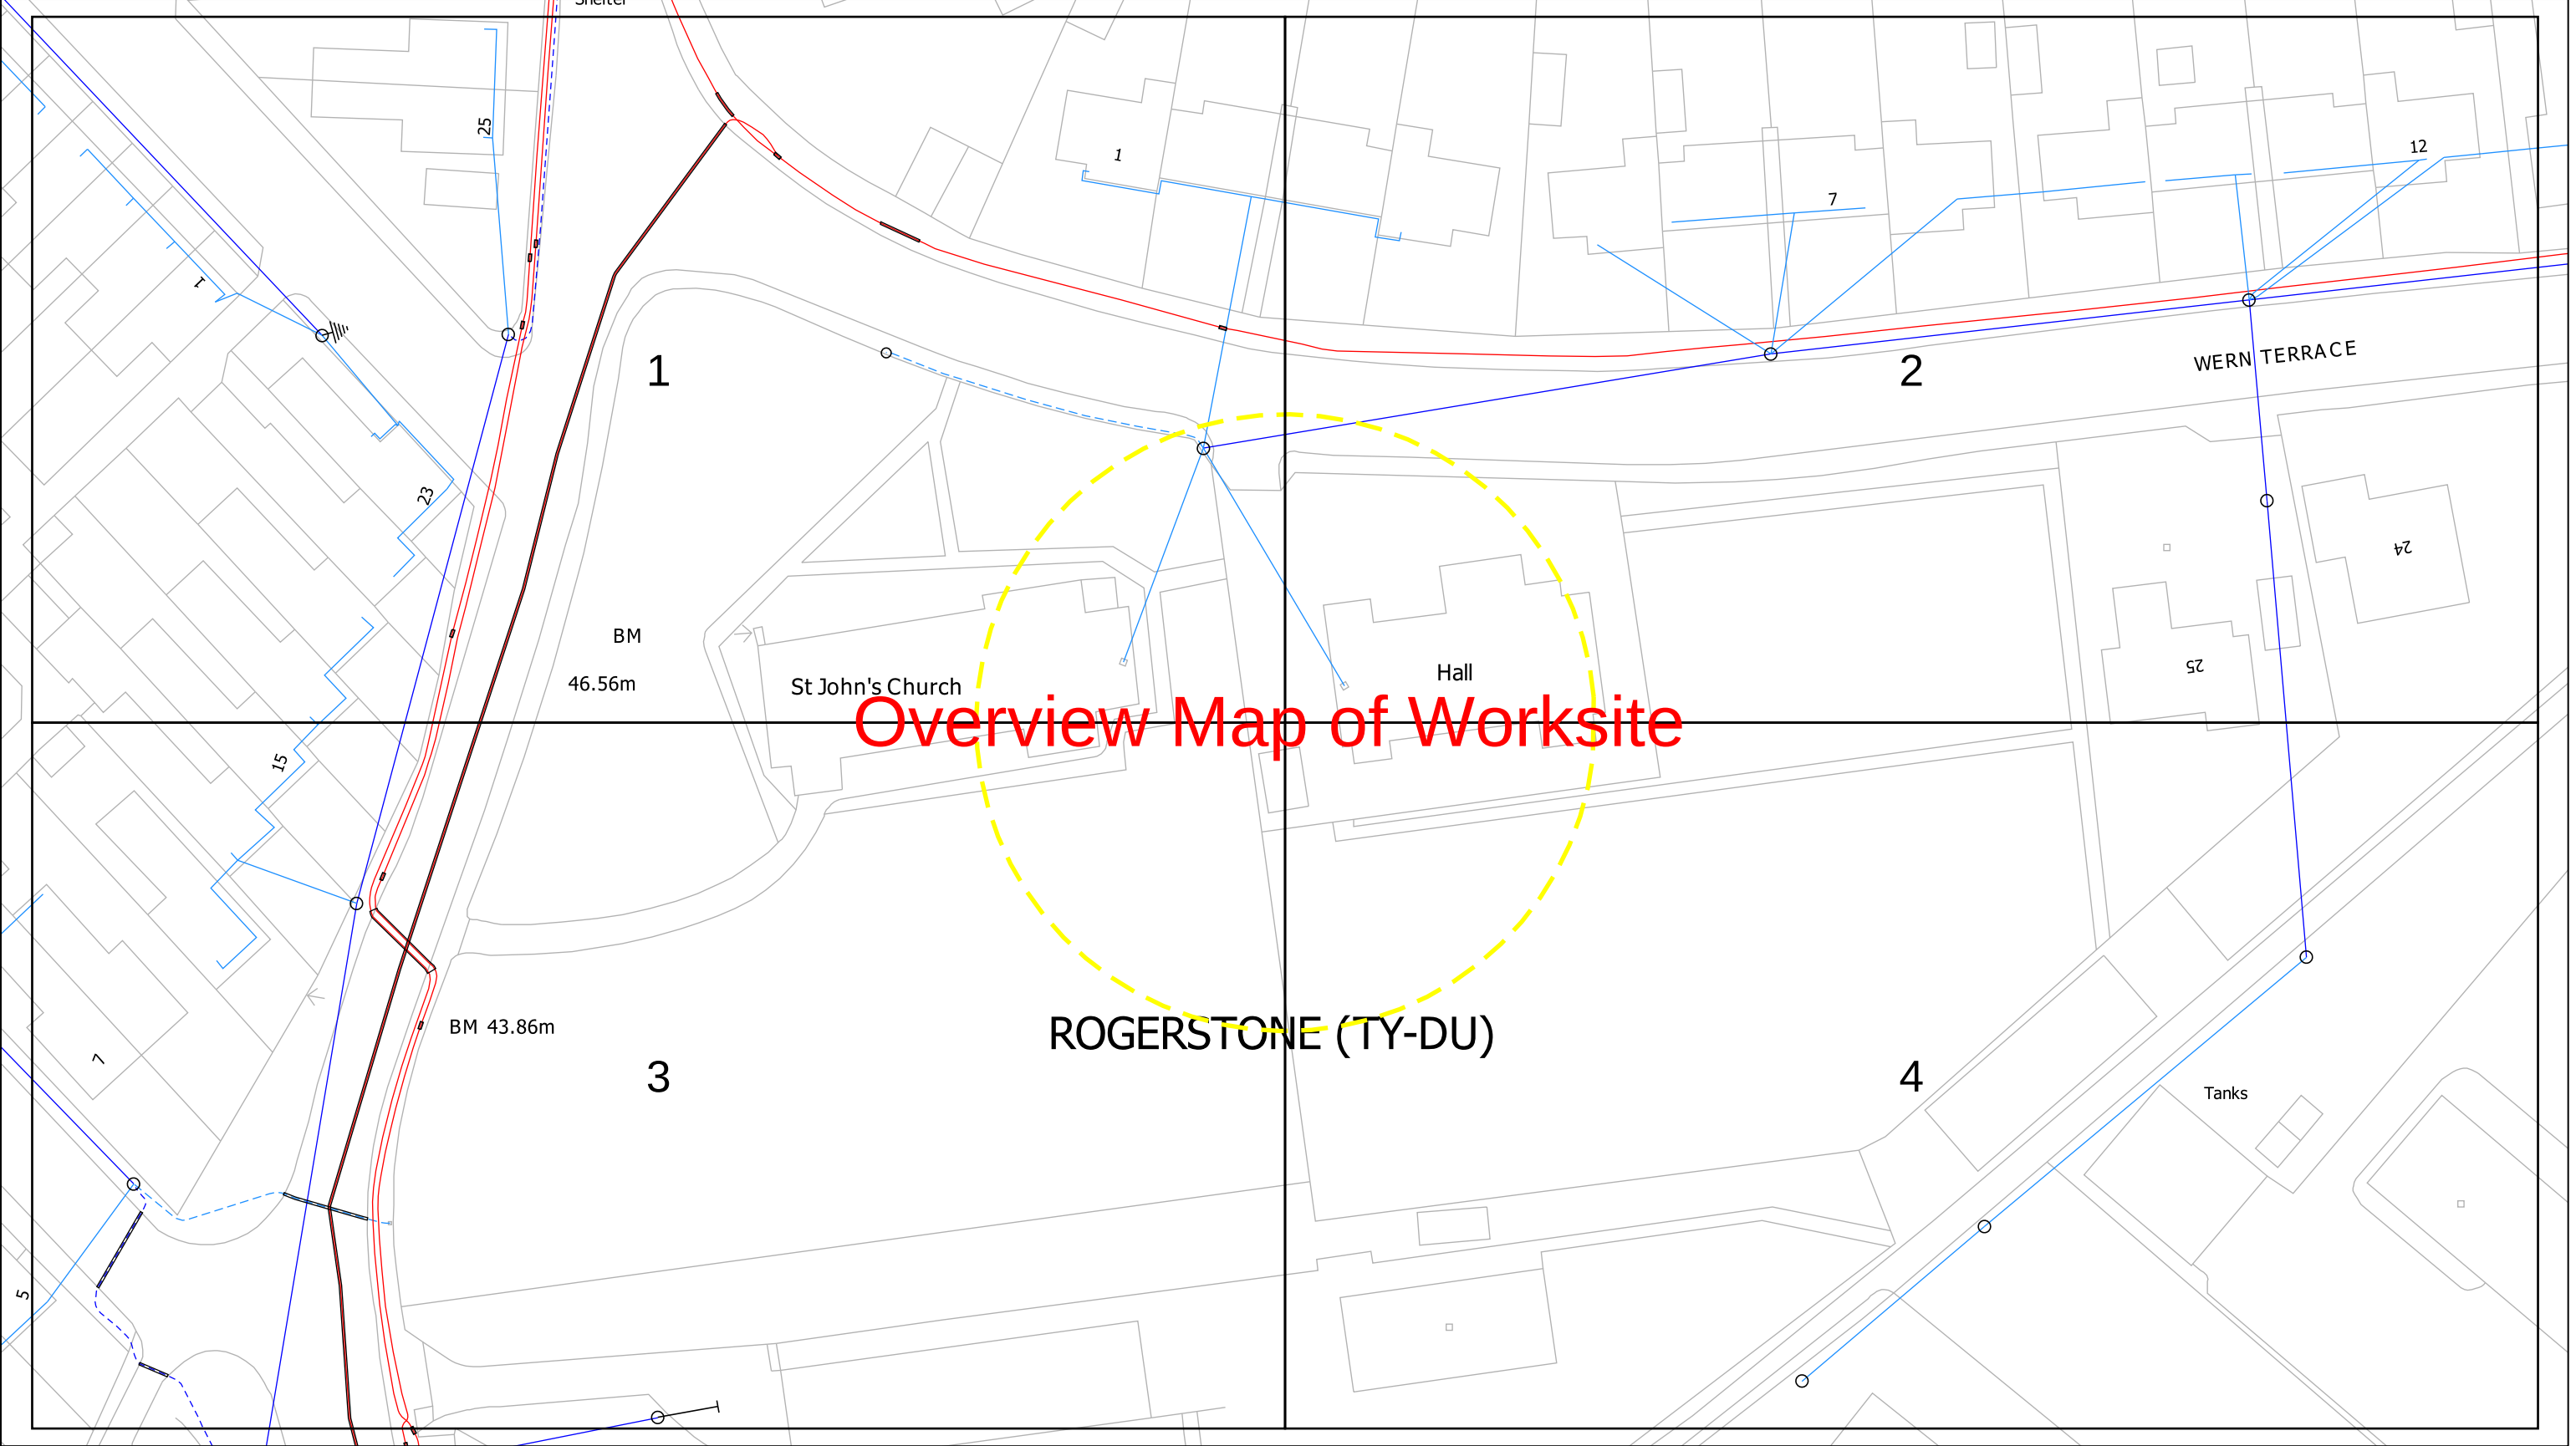

**Contact Us**

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 13/03/2026

Job Reference: 40801630

Site Location: 326743 188572

Requested by:  
Miss Jenny Clemence  
Your Scheme/Reference: St John Baptist

Scale: 1:513 (When plotted at A3)

- IMPORTANT NOTICES**
- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
  - Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
  - You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
  - When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
  - For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
  - Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

**Link Box**

**Site Location**

**Line/Area**

**Overhead Line**

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

**Underground Cable**

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

**National Grid Telecoms**

**Private Cables**

**PME Earth**

**Underground Earth**

**Pilot Cables**

**Pole Mounted Transformer**

**Ground Mounted Transformer**

PDF designed for A3 colour print only with no page scaling


**Report damage immediately KEEP EVERYONE AWAY FROM THE AREA**

**0800 6783 105**

**nationalgrid**

**Electricity Distribution**

Email: NGED.MapResponse@NationalGrid.co.uk

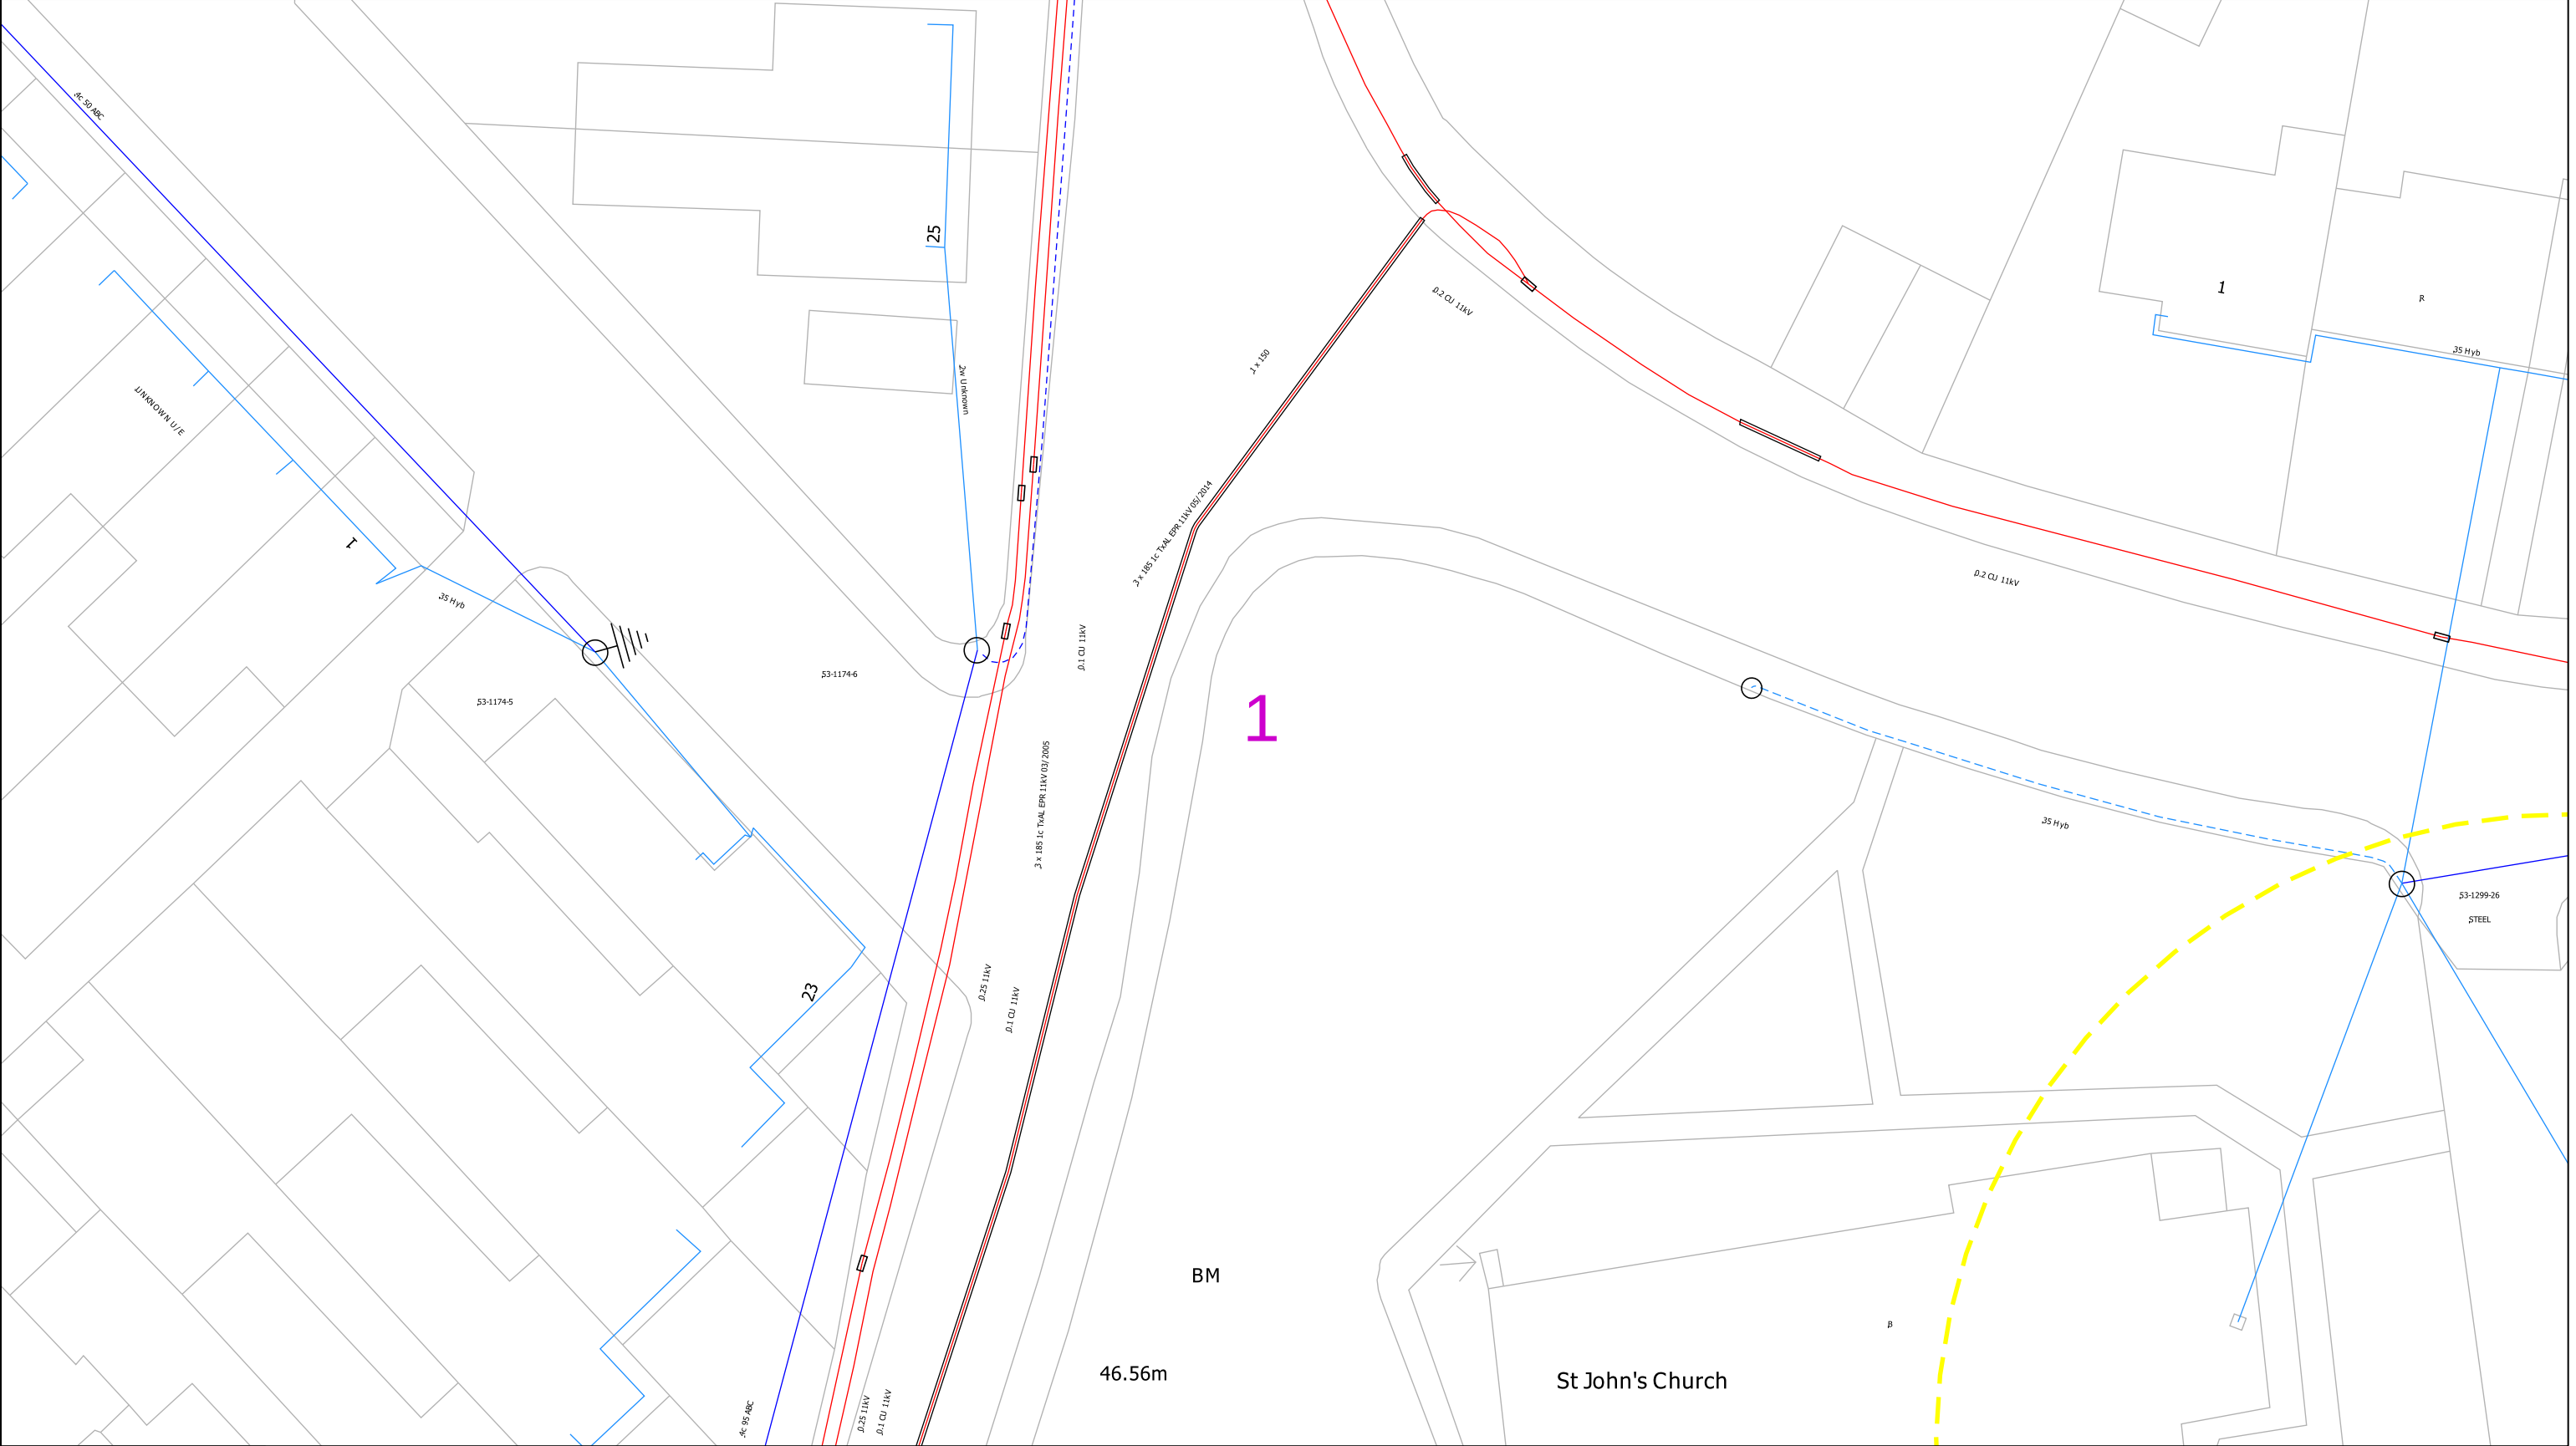

**Contact Us**  
  
Mapping Enquiries: 0121 623 9780  
  
General Enquiries: 0800 096 3080

Date Requested: 13/03/2026  
Job Reference: 40801630  
Site Location: 326743 188572  
Requested by:  
Miss Jenny Clemence  
Your Scheme/Reference: St John Baptist

Scale: 1:250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

0

25m

**Link Box**  
●

**Site Location**  
Line/Area

**Overhead Line**

- PL
- Service
- LV
- HV (11kV)
- HV (33kV)
- HV (66kV)
- HV (132kV)

**Underground Cable**

**National Grid Telecoms**

**Private Cables**

**Pilot Cables**

**Pole Mounted Transformer**

**Ground Mounted Transformer**

**PME Earth**

**Underground Earth**

PDF designed for A3 colour print only with no page scaling


**Report damage immediately KEEP EVERYONE AWAY FROM THE AREA**  
**0800 6783 105**

**nationalgrid**

**Electricity Distribution**

Email: NGED.MapResponse@NationalGrid.co.uk

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432. NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

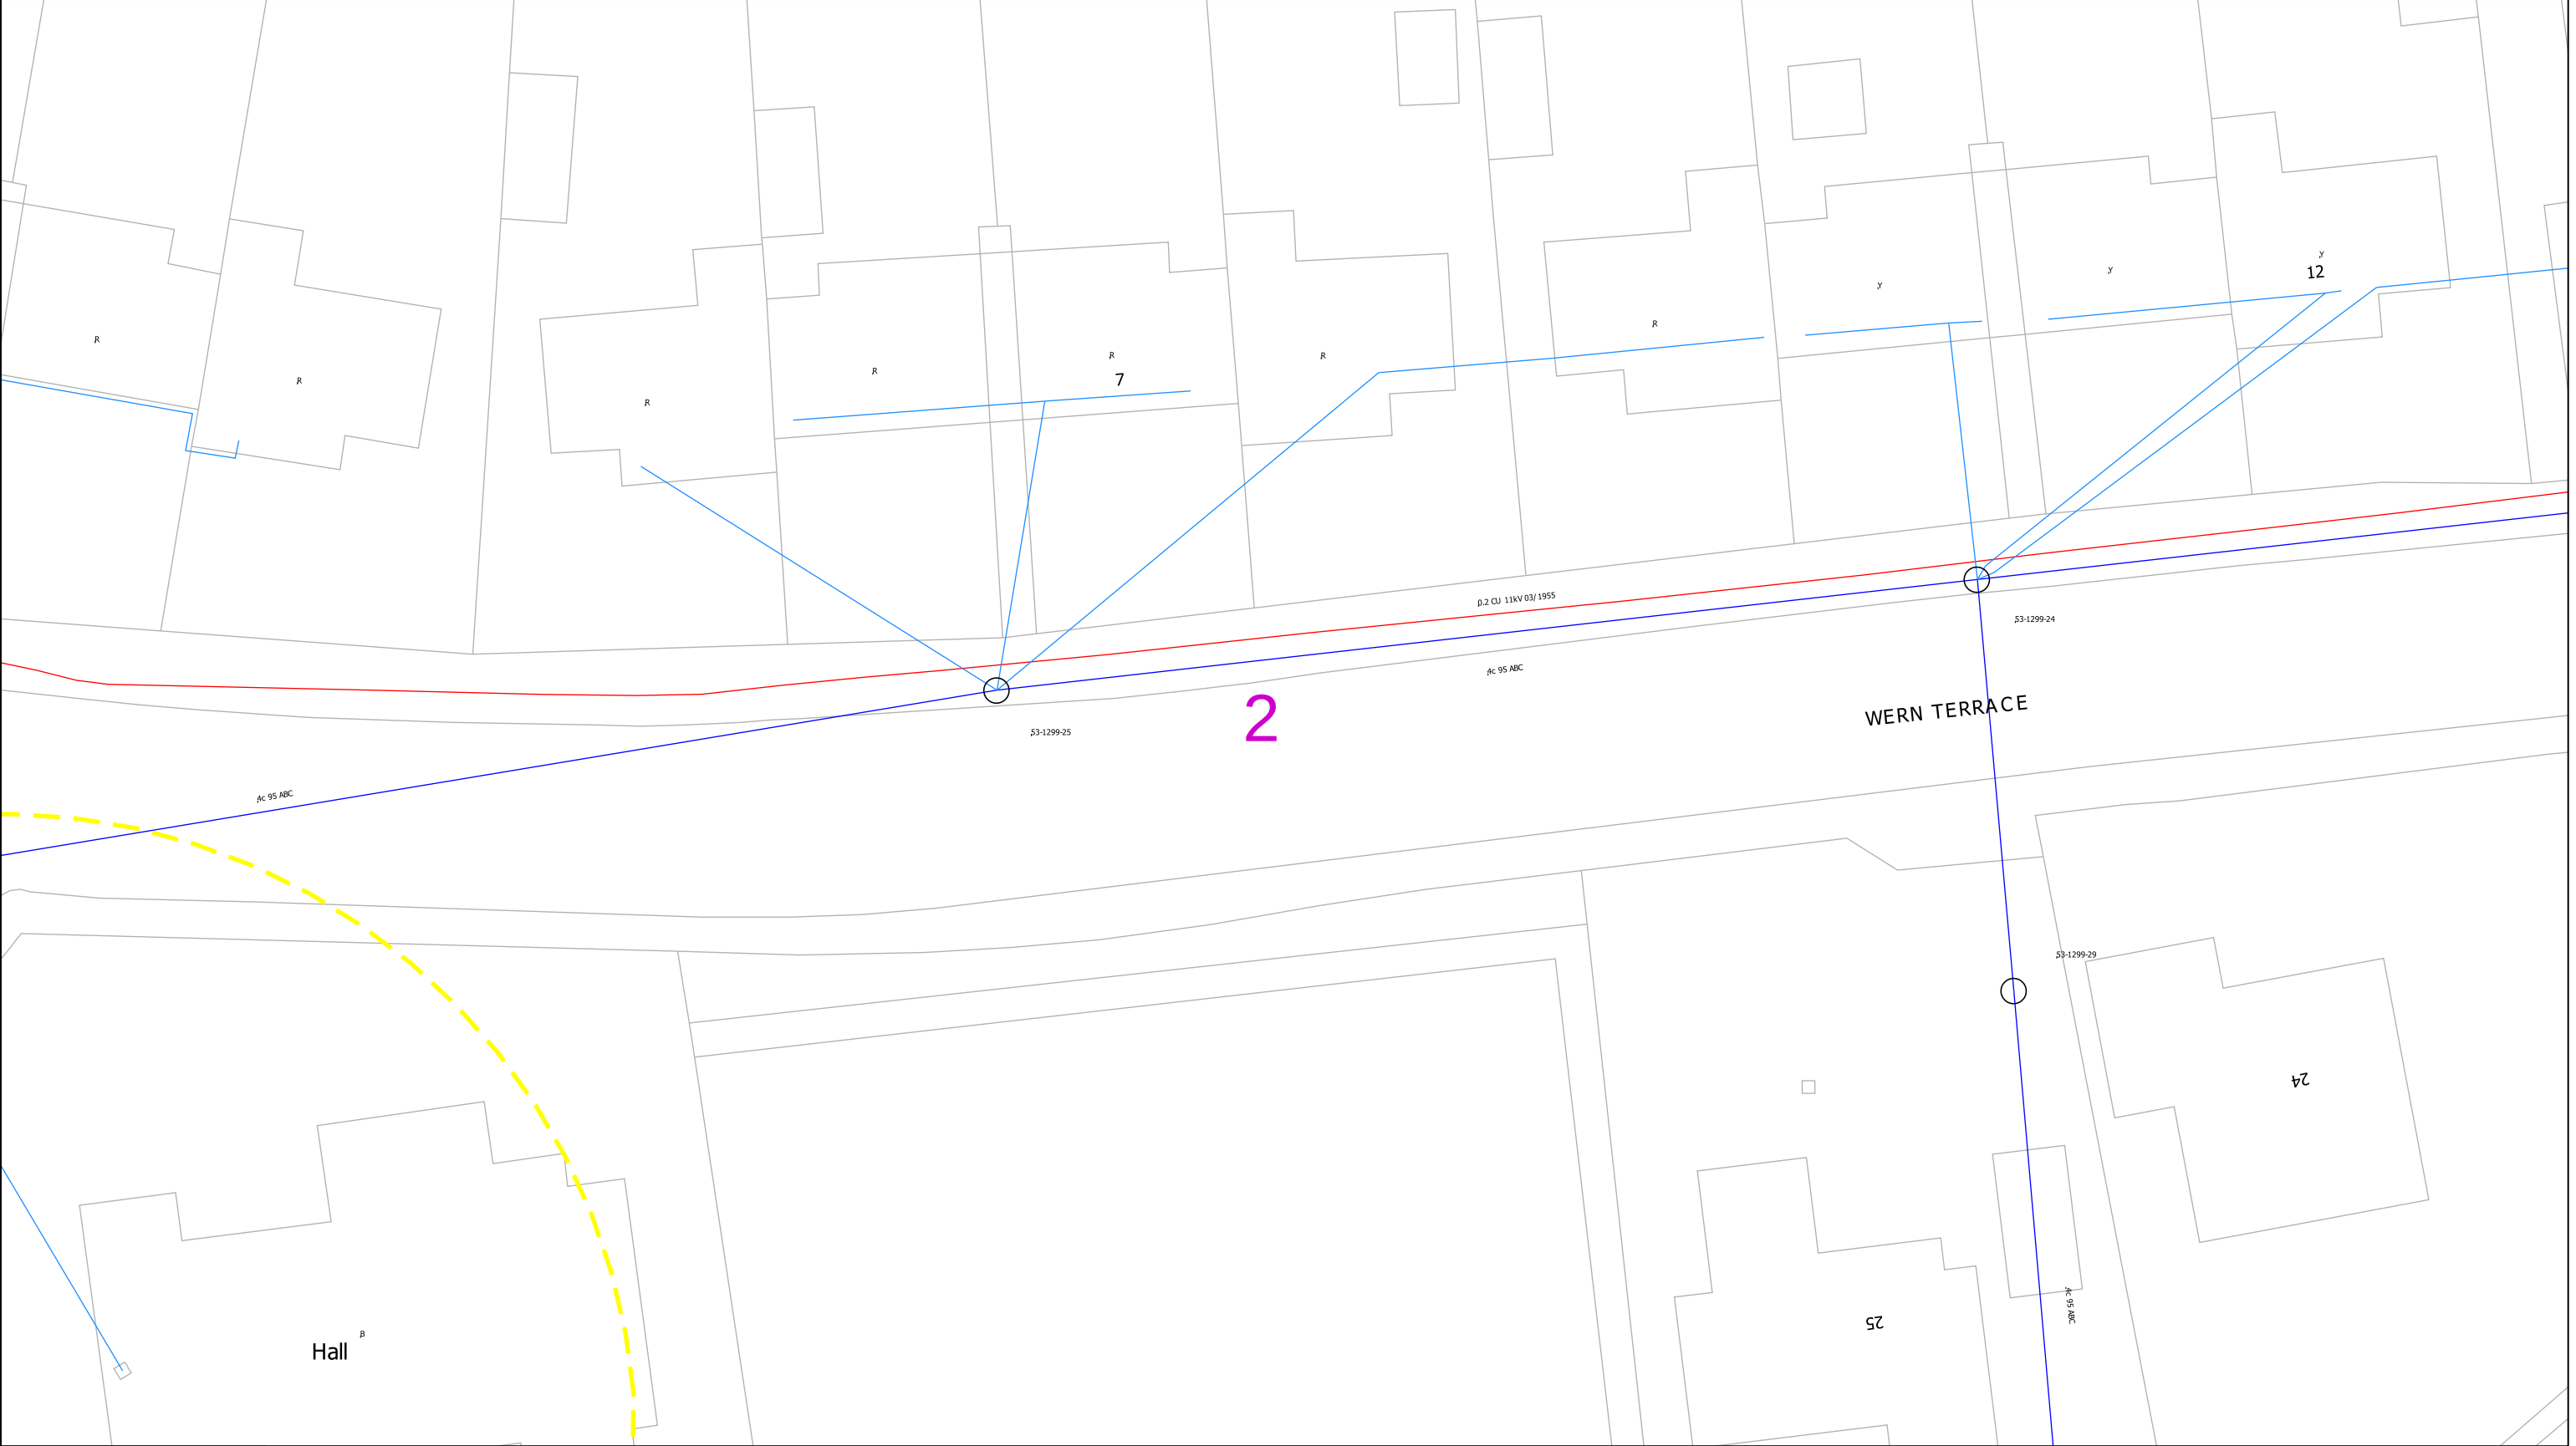

**Contact Us**

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 13/03/2026

Job Reference: 40801630

Site Location: 326743 188572

Requested by:  
Miss Jenny Clemence

Your Scheme/Reference: St John Baptist

Scale: 1:250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

0 25m

|                      |                                                                                                                              |                                                                                                        |                                                                                 |                                                                                                                |
|----------------------|------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|
| <b>Link Box</b><br>● | <b>Overhead Line</b><br>—○— PL<br>—○— Service<br>—○— LV<br>—○— HV (11kV)<br>—○— HV (33kV)<br>—○— HV (66kV)<br>—■— HV (132kV) | <b>Underground Cable</b><br>- - - - -<br>- - - - -<br>- - - - -<br>- - - - -<br>- - - - -<br>- - - - - | <b>National Grid Telecoms</b><br>—S—S—<br><b>Private Cables</b><br>     <br>—E— | <b>Pilot Cables</b><br>—P—P—<br><b>Pole Mounted Transformer</b><br>○<br><b>Ground Mounted Transformer</b><br>□ |
|----------------------|------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|

PDF designed for A3 colour print only with no page scaling


**Report damage immediately KEEP EVERYONE AWAY FROM THE AREA**

**0800 6783 105**

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk

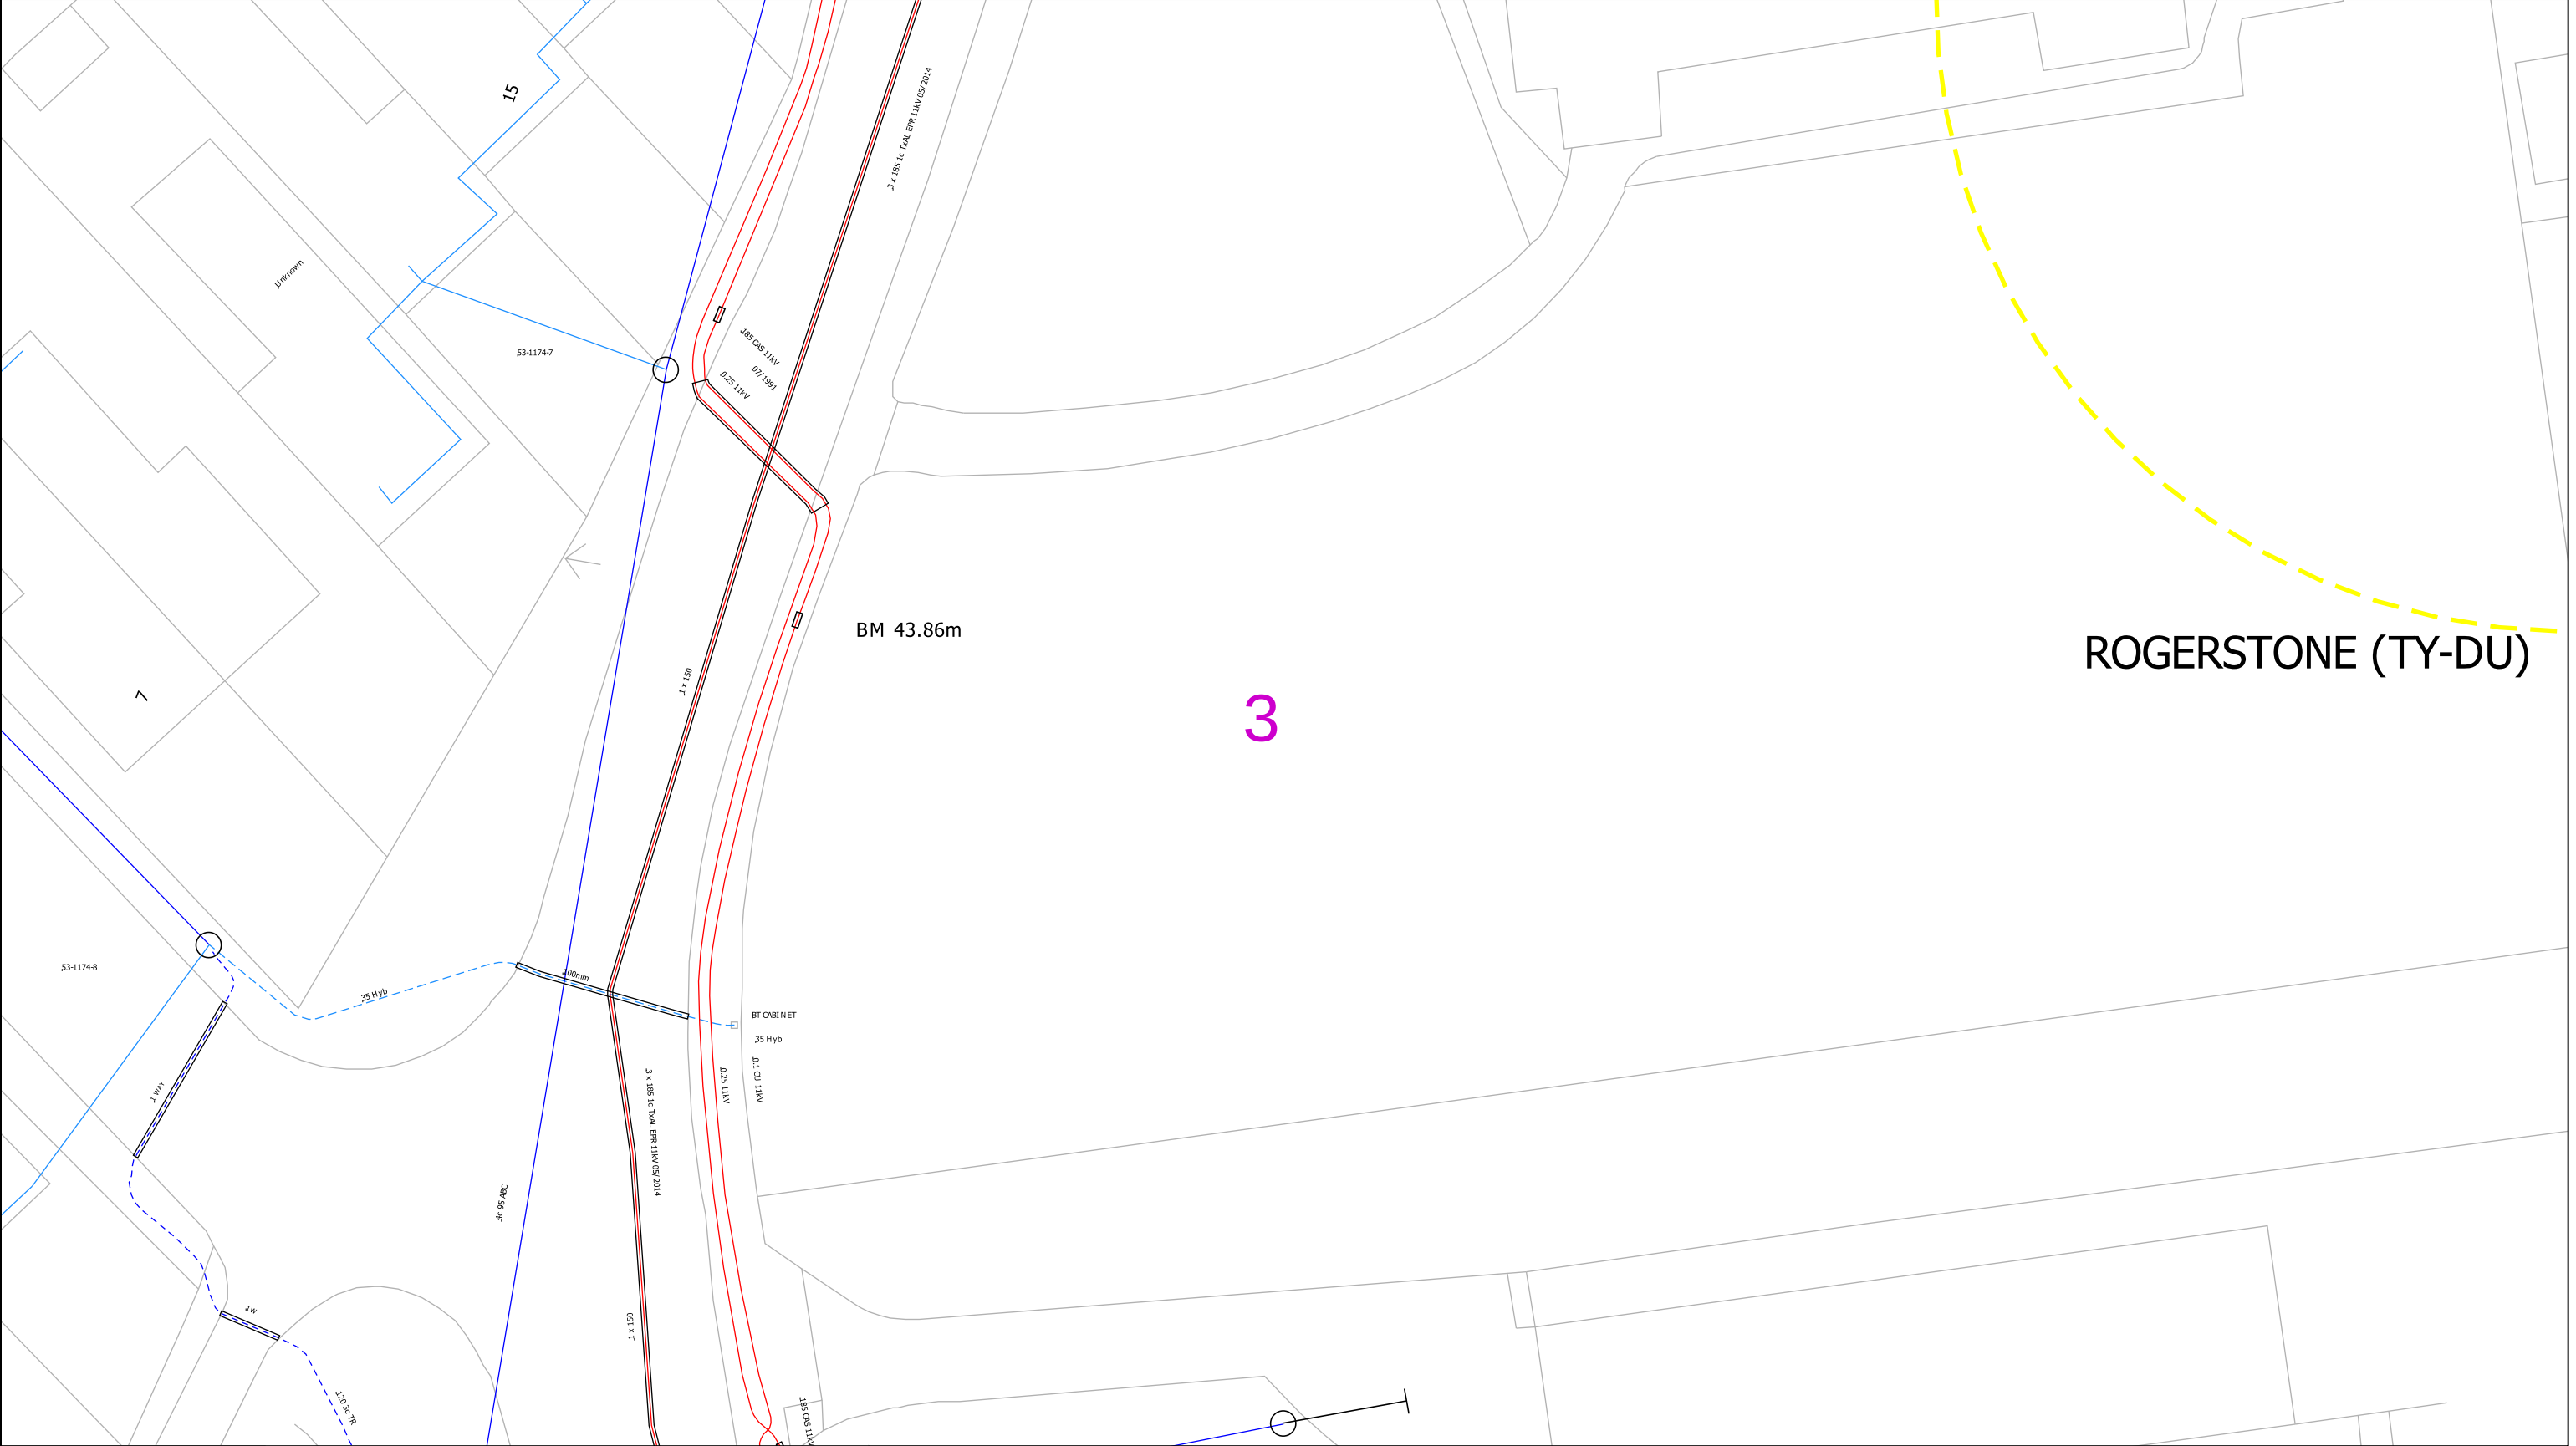

ROGERSTONE (TY-DU)

**Contact Us**  
  
Mapping Enquiries: 0121 623 9780  
  
General Enquiries: 0800 096 3080

Date Requested: 13/03/2026  
Job Reference: 40801630  
Site Location: 326743 188572  
Requested by:  
Miss Jenny Clemence  
Your Scheme/Reference: St John Baptist

Scale: 1:250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

025m

Link Box

Site Location

Line/Area

Overhead Line

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

National Grid Telecoms

Private Cables

PME Earth

Underground Earth

Pilot Cables

Pole Mounted Transformer

Ground Mounted Transformer

PDF designed for A3 colour print only with no page scaling


Report damage immediately KEEP EVERYONE AWAY FROM THE AREA  
0800 6783 105

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432. NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

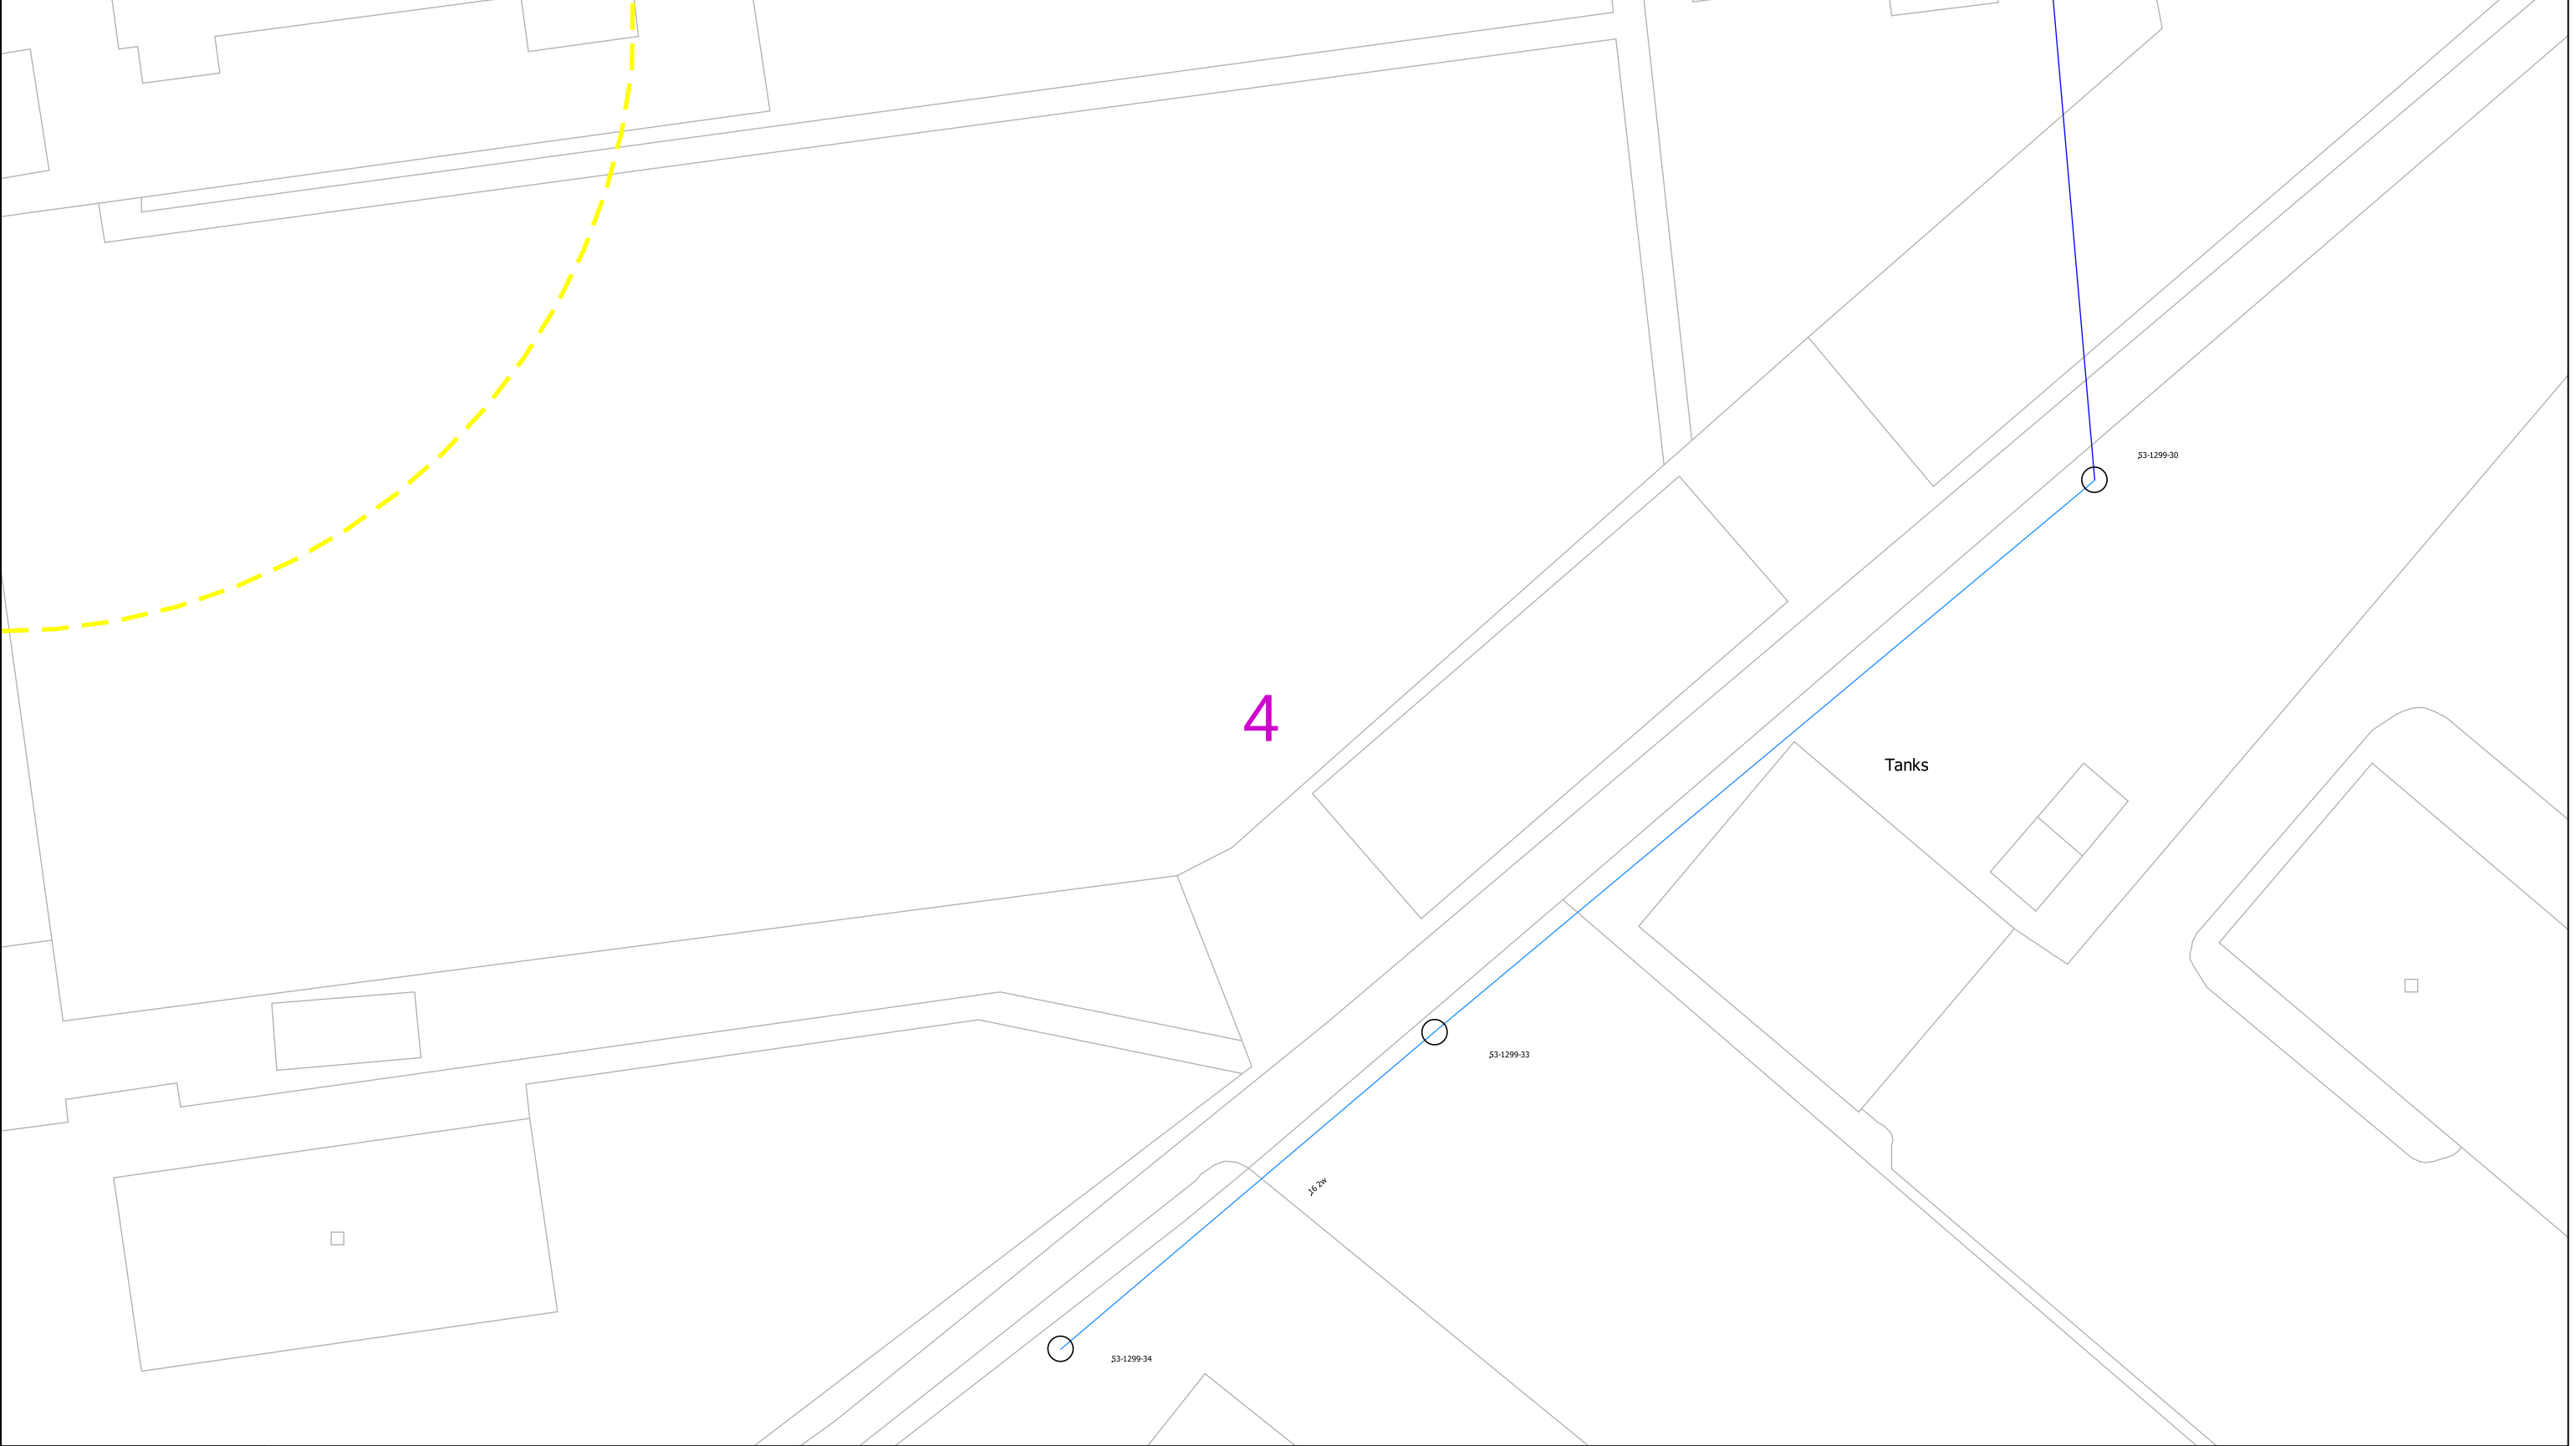

**Contact Us**

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 13/03/2026

Job Reference: 40801630

Site Location: 326743 188572

Requested by:

Miss Jenny Clemence

Your Scheme/Reference: St John Baptist

Scale: 1:250 (When plotted at A3)

**IMPORTANT NOTICES**

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

PDF designed for A3 colour print only with no page scaling

**Report damage immediately KEEP EVERYONE AWAY FROM THE AREA**

**0800 6783 105**

**Link Box**

●

**Site Location**

—

**Line/Area**

—

**Overhead Line**

— PL

— Service

— LV

— HV (11kV)

— HV (33kV)

— HV (66kV)

— HV (132kV)

**Underground Cable**

---

---

---

---

---

---

---

**National Grid Telecoms**

— S — S —

**Private Cables**

—

**PME Earth**

— E —

**Underground Earth**

—

**Pilot Cables**

— P — P —

**Pole Mounted Transformer**

○

**Ground Mounted Transformer**

□

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk