


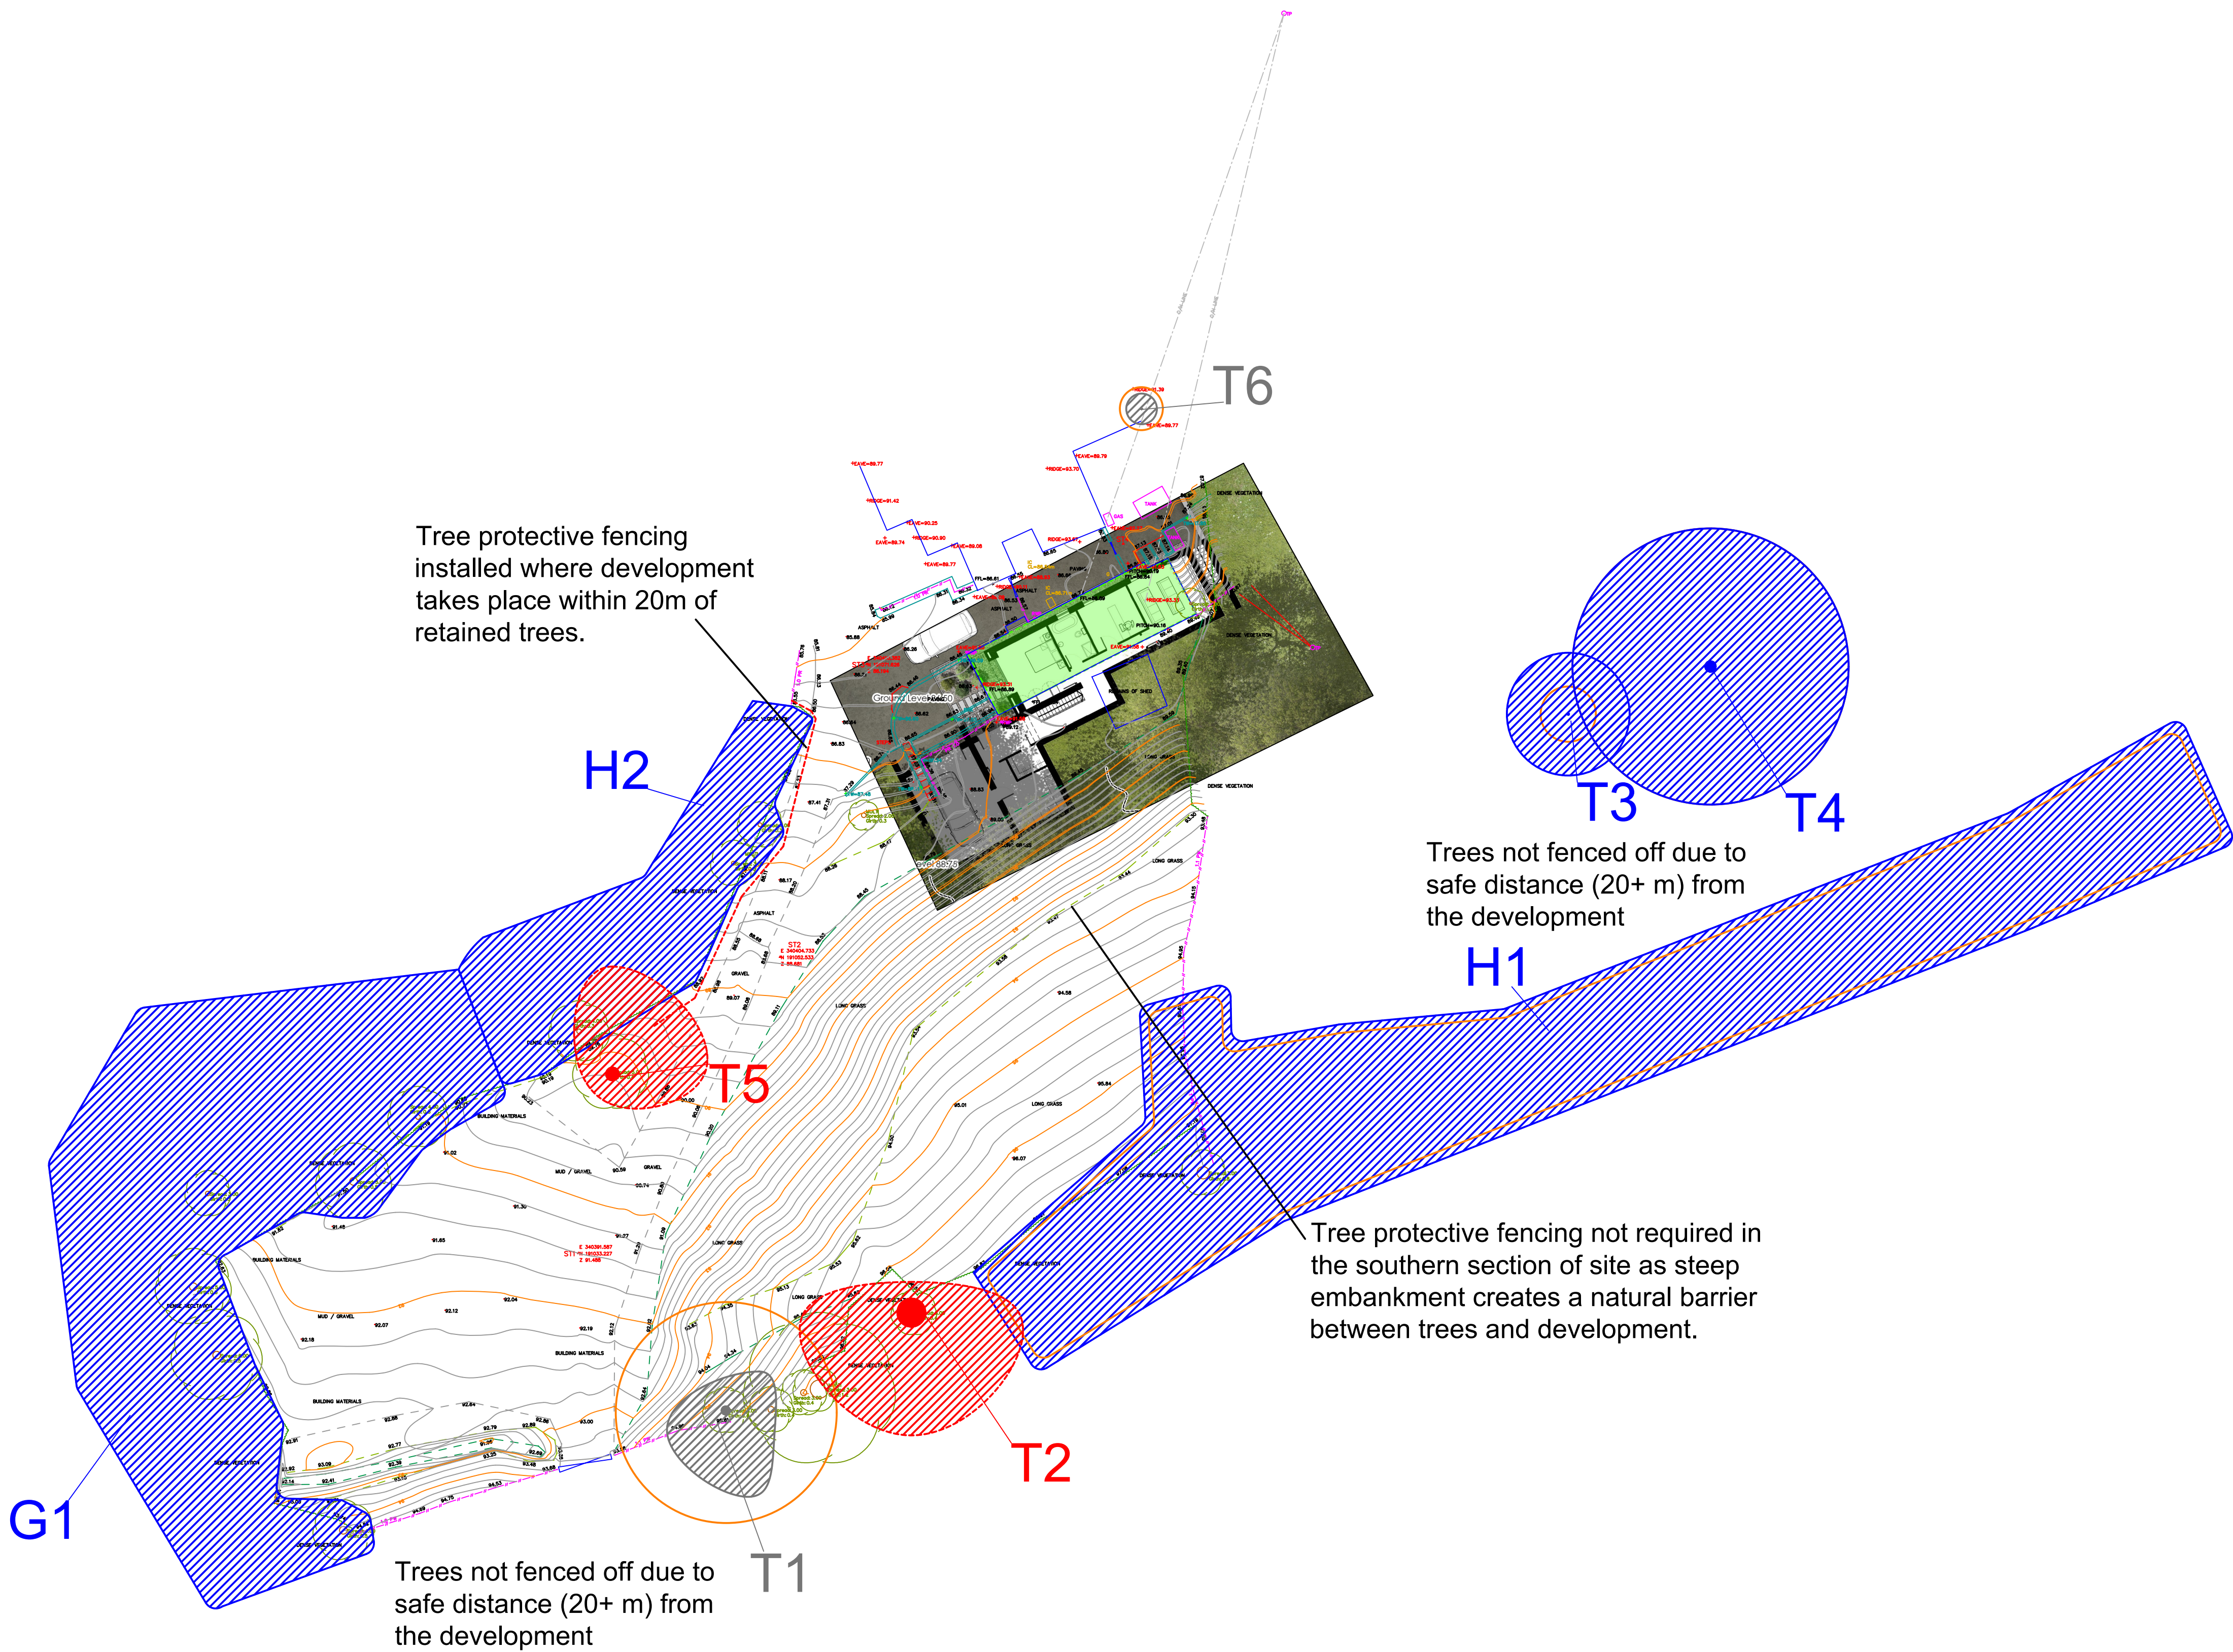

Ref	Tag	Species	Height	Stem Diam (mm)	Life Stage	Life Expectancy	Retention Category	RPA Area (m ²)	RPA Radius (m)
G1	N/A	Field maple (<i>Acer campestre</i>), Common hawthorn (<i>Crataegus monogyna</i>), Pedunculate oak (<i>Quercus robur</i>), Common ash (<i>Fraxinus excelsior</i>)	14	600 M		20-40	B2	163	7.2
H1	N/A	Hazel (<i>Corylus avellana</i>), Mixed species (<i>Mixed species</i>), Common holly (<i>Ilex aquifolium</i>)	7	120 M		20-40	B2	6.5	1.4
H2	N/A	Hazel (<i>Corylus avellana</i>), Common hawthorn (<i>Crataegus monogyna</i>), Common holly (<i>Ilex aquifolium</i>)	7	120 M		20-40	B2	6.5	1.4
T1	151	Common ash (<i>Fraxinus excelsior</i>)	12	600 M		10-20	C2	163	7.2
T2	162	Sweet chestnut (<i>Castanea sativa</i>)	13	1900 M		<10	U	0	0
T3	N/A	Horse chestnut (<i>Aesculus hippocastanum</i>)	6	150 EM		20-40	B2	10	1.8
T4	N/A	Wild cherry (<i>Prunus avium</i>)	12	750 M		20-40	B2	254	9
T5	163	Common ash (<i>Fraxinus excelsior</i>)	16	900 M		<10	U	0	0
T6	N/A	Common ash (<i>Fraxinus excelsior</i>)	8	120 Y		10-20	C2	6.5	1.4

Key

- Category A.
Trees with high retention value.

- Category B.
Trees with moderate retention value.

- Category C.
Trees with low retention value.

- Category U.
Trees unsuitable for retention due to condition

- Root Protection Area (RPA)

Tree Key

Canopy extents, hatched area represents area within the canopy.

Location of tree base, taken from position on TOPO or GPS.

Reference number
(T for trees, G for groups, W for woodlands, H for hedges).

RPA- an indication of the estimated minimum rooting area required by the tree.
Calculated in accordance with BS5837.

Tree Protective Fence

Tree Removal/Retention and Protection Plan
Little Hunters Lodge

1:300 at A1	
Client	C2J Planners
Survey Code	26011
Drawn by	BC
Surveyed by	JC
Date	05/03/2026

Tree Check

Arboriculture Ltd.

Ben Clark

TechArborA, Dip Arb L4 (ABC)

Tree Check Arboriculture Ltd.

Tel. 07736236152

Email:ben@treecheck.co.uk

www.Treecheck.co.uk

Drawing designed to be viewed in colour.
Indicative only, check all RPA's on site in accordance with table.