

This drawing must not be scaled.
Figured dimensions, levels, etc. only are to be used.
Any inaccuracies, etc. must be notified to the Project Supervisor. This drawing is copyright detail drawings and larger scale drawings take precedence over smaller scale drawings.

GENERAL NOTES

Glazing within 800m of FFL is to be in compliance with BS 6262-4. Windows in critical locations (e.g. low-level glazing, near doors) must use safety glazing that meets BS EN 12600.

Window restrictors must be a mechanical device that limits the vertical or opening movement of the sash/casement so that an opening of not more than 100mm is possible at any point even with the application of a significant additional opening force. It can either be fixed, that is, cannot be overridden, or can only be overridden by means of a removable key or other device. In both cases above, restrictors should only be fitted using tamper-proof fittings.

Double glazed units must achieve a U-value of 1.4 W/m²K or better. Alternatively, windows must achieve a Window Energy Rating (WER) of Band B or better.

REVISIONS

Rev	Date	Description	By
05.05.26	Issued for information		NH



Bwrdd Iechyd Prifysgol

Aneurin Bevan

University Health Board

Works & Estates Management Centre

St. Cadocs Hospital

Lodge Road

Caerleon

NP18 3XQ

PROJECT TITLE
Royal Gwent Hospital
Cardiff Road, Newport
Replacement of B Block windows

DRAWING TITLE
Phase 2 - Proposed replacement window types

DRAWN BY
NH

CHK BY

PROJECT REF
RGH B

SCALE
1 : 25
original paper size of A1

REVISION

DATE


STATUS
D1

SUITABILITY
Suitable for Costing


DRAWING NO.
Project Originator Volume Level Type Role Number
RGH B ABUHB XX XXX DT A 103





Window types 01 & 02 - South elevation
1 : 25

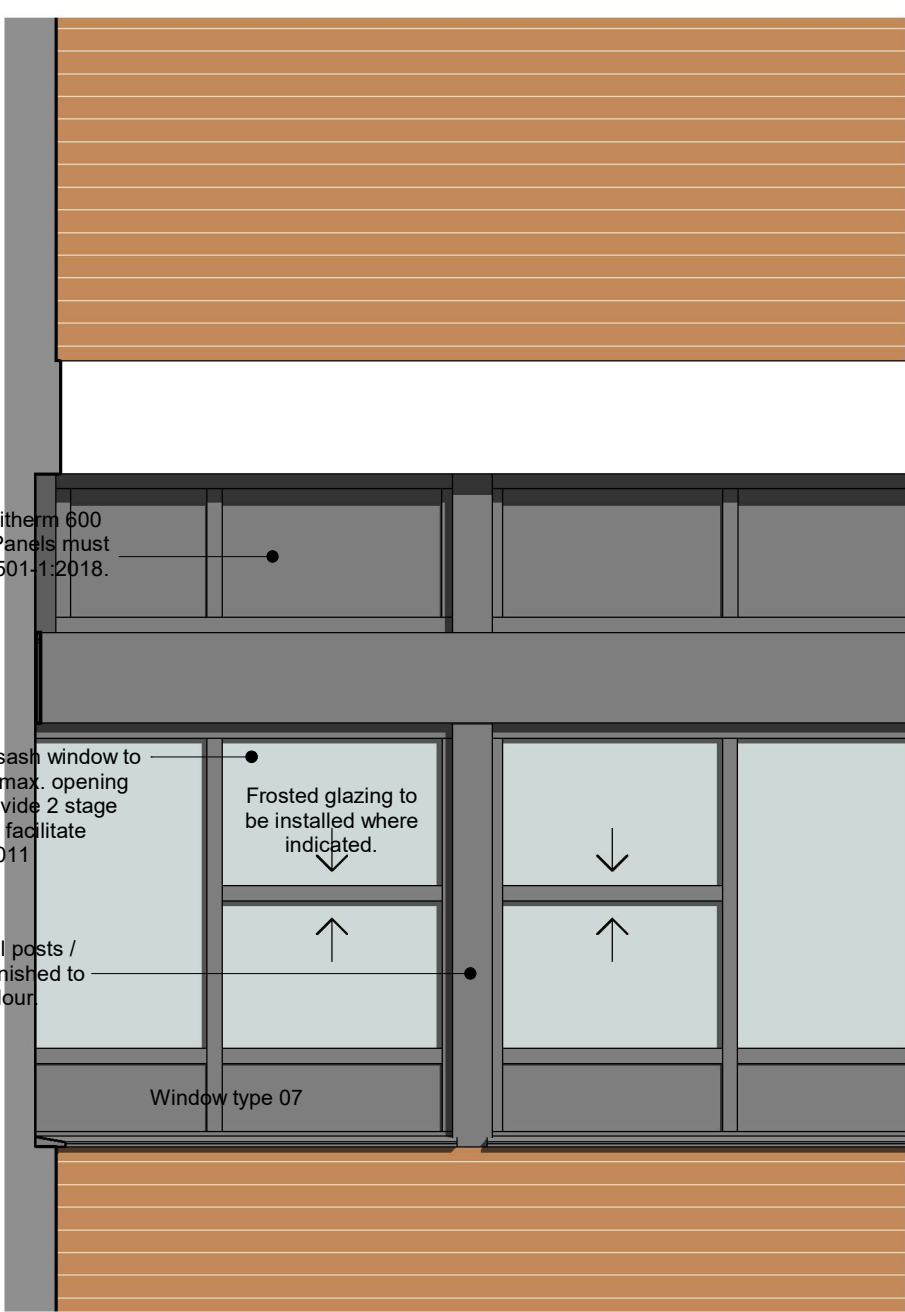

Window type 07 - North elevation
1 : 25

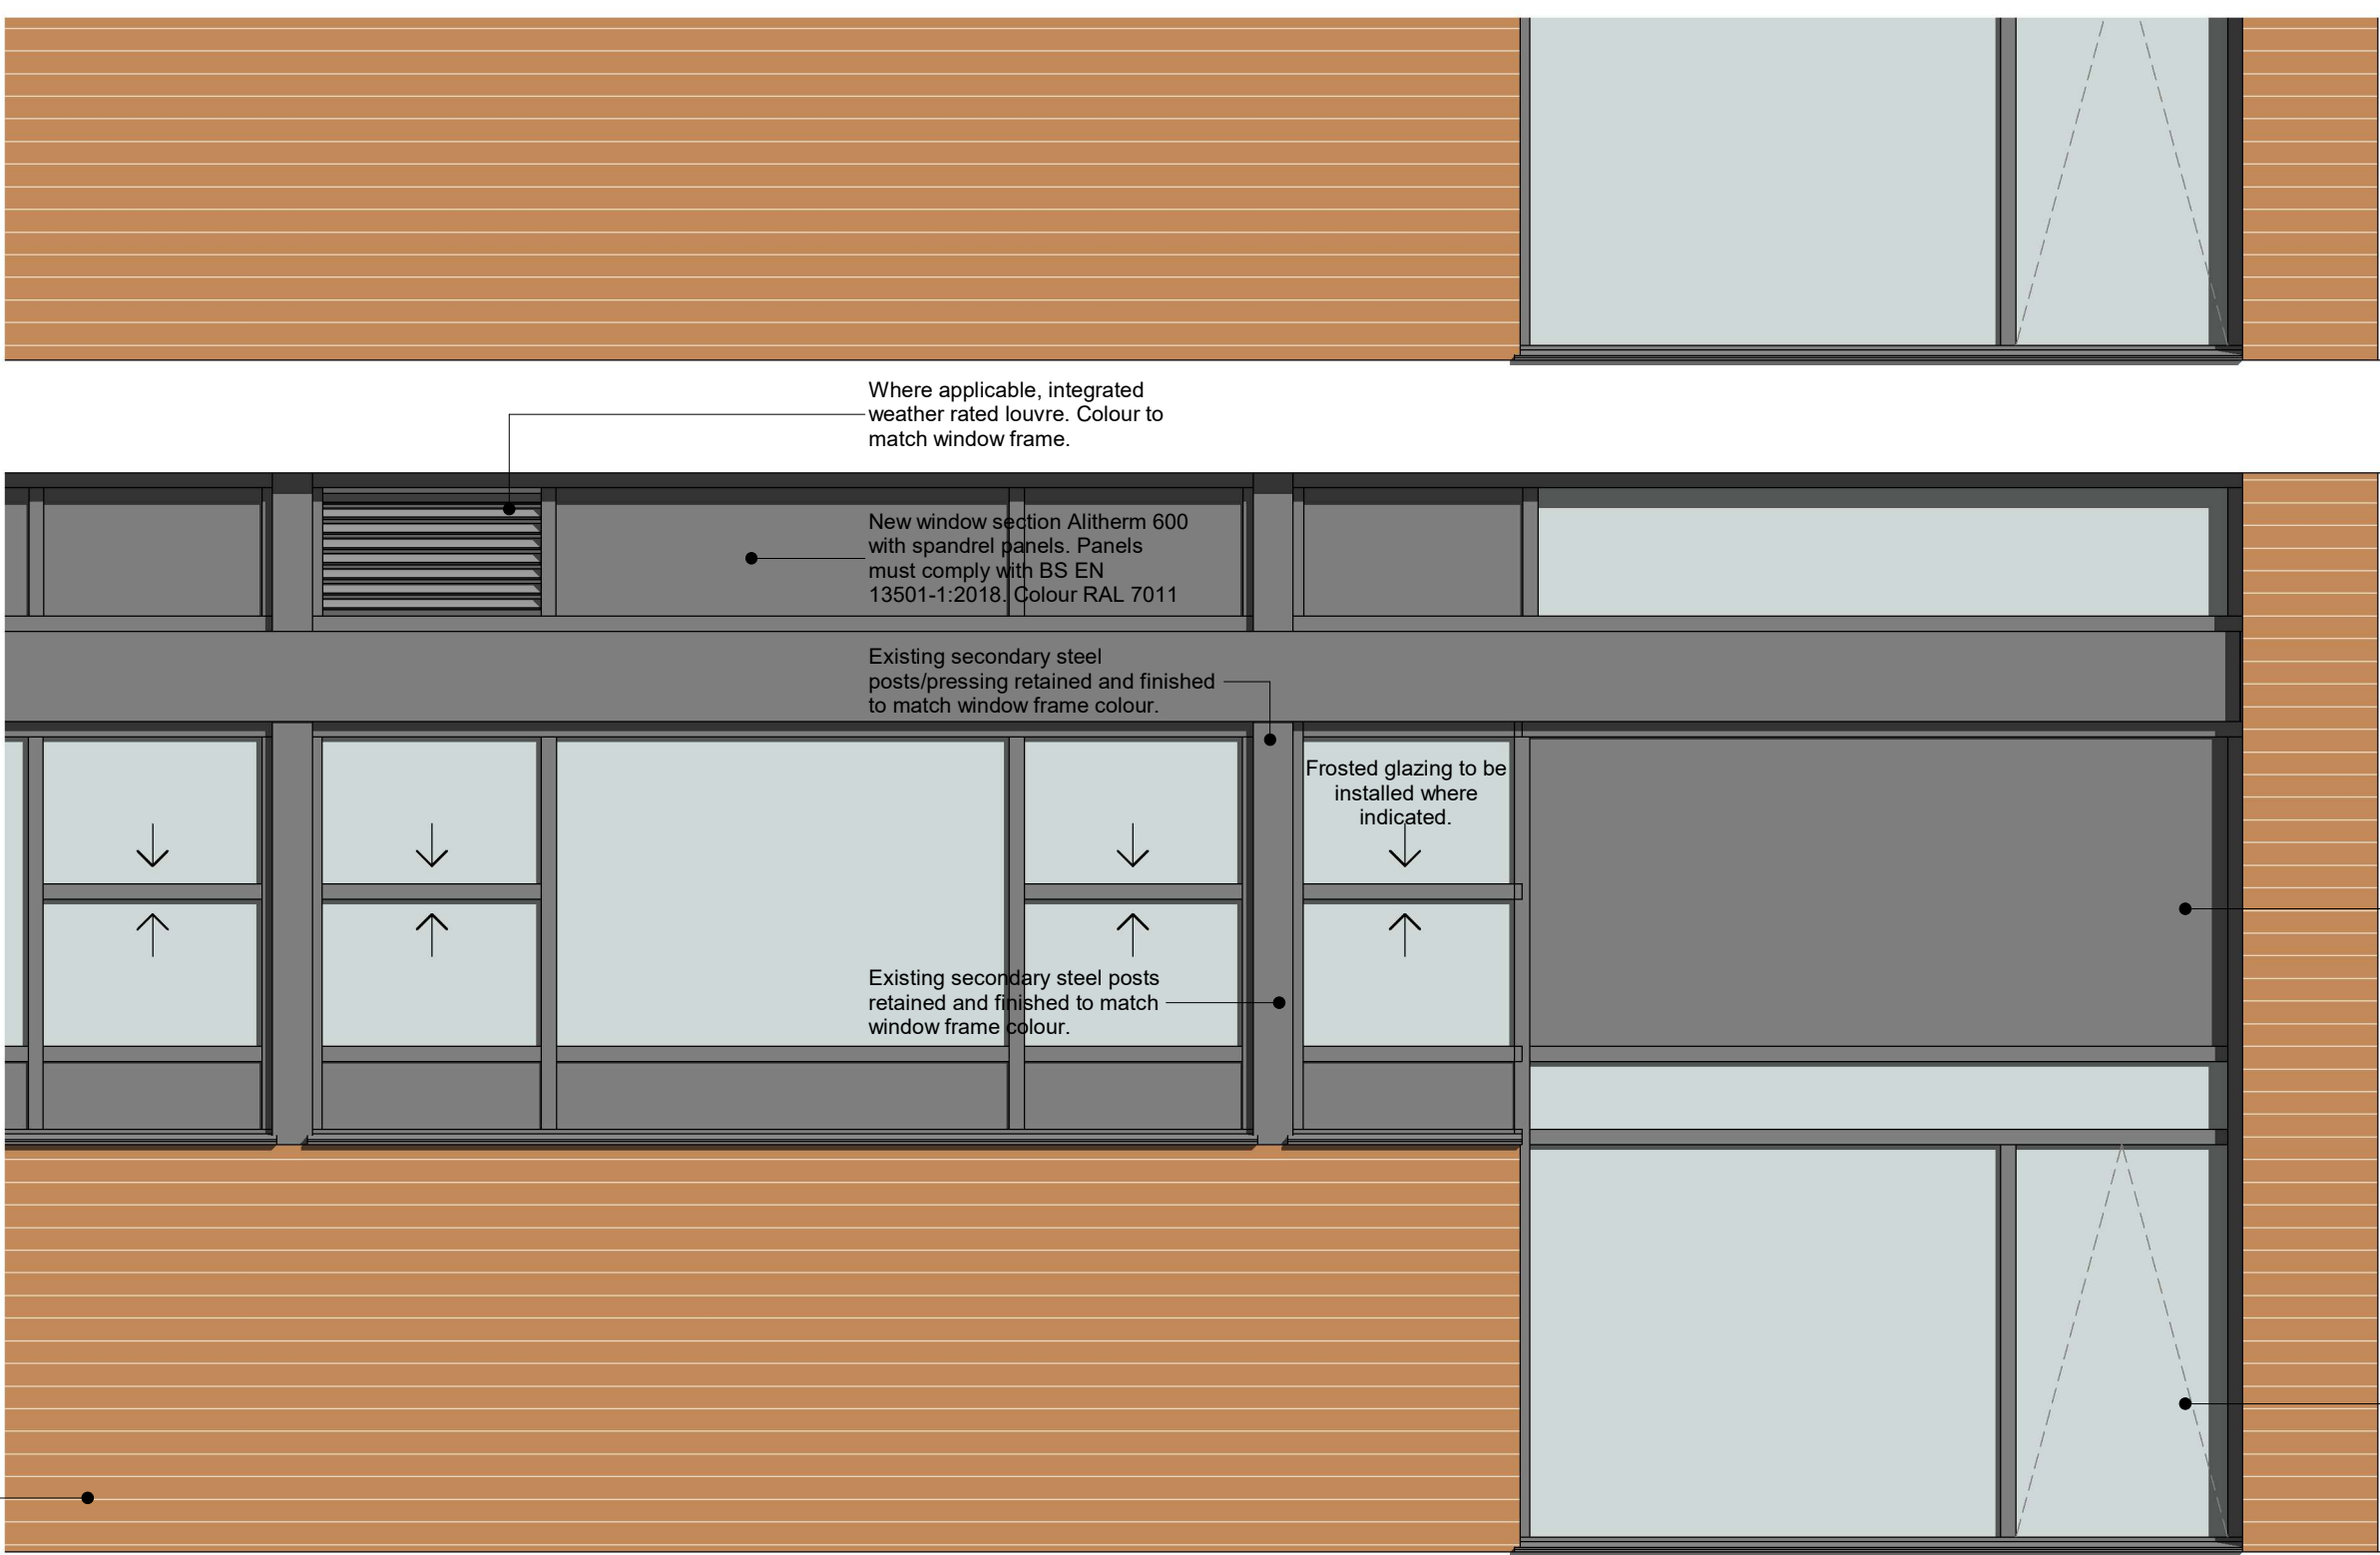

Window types 04, 05 & 06 - North elevation
1 : 25

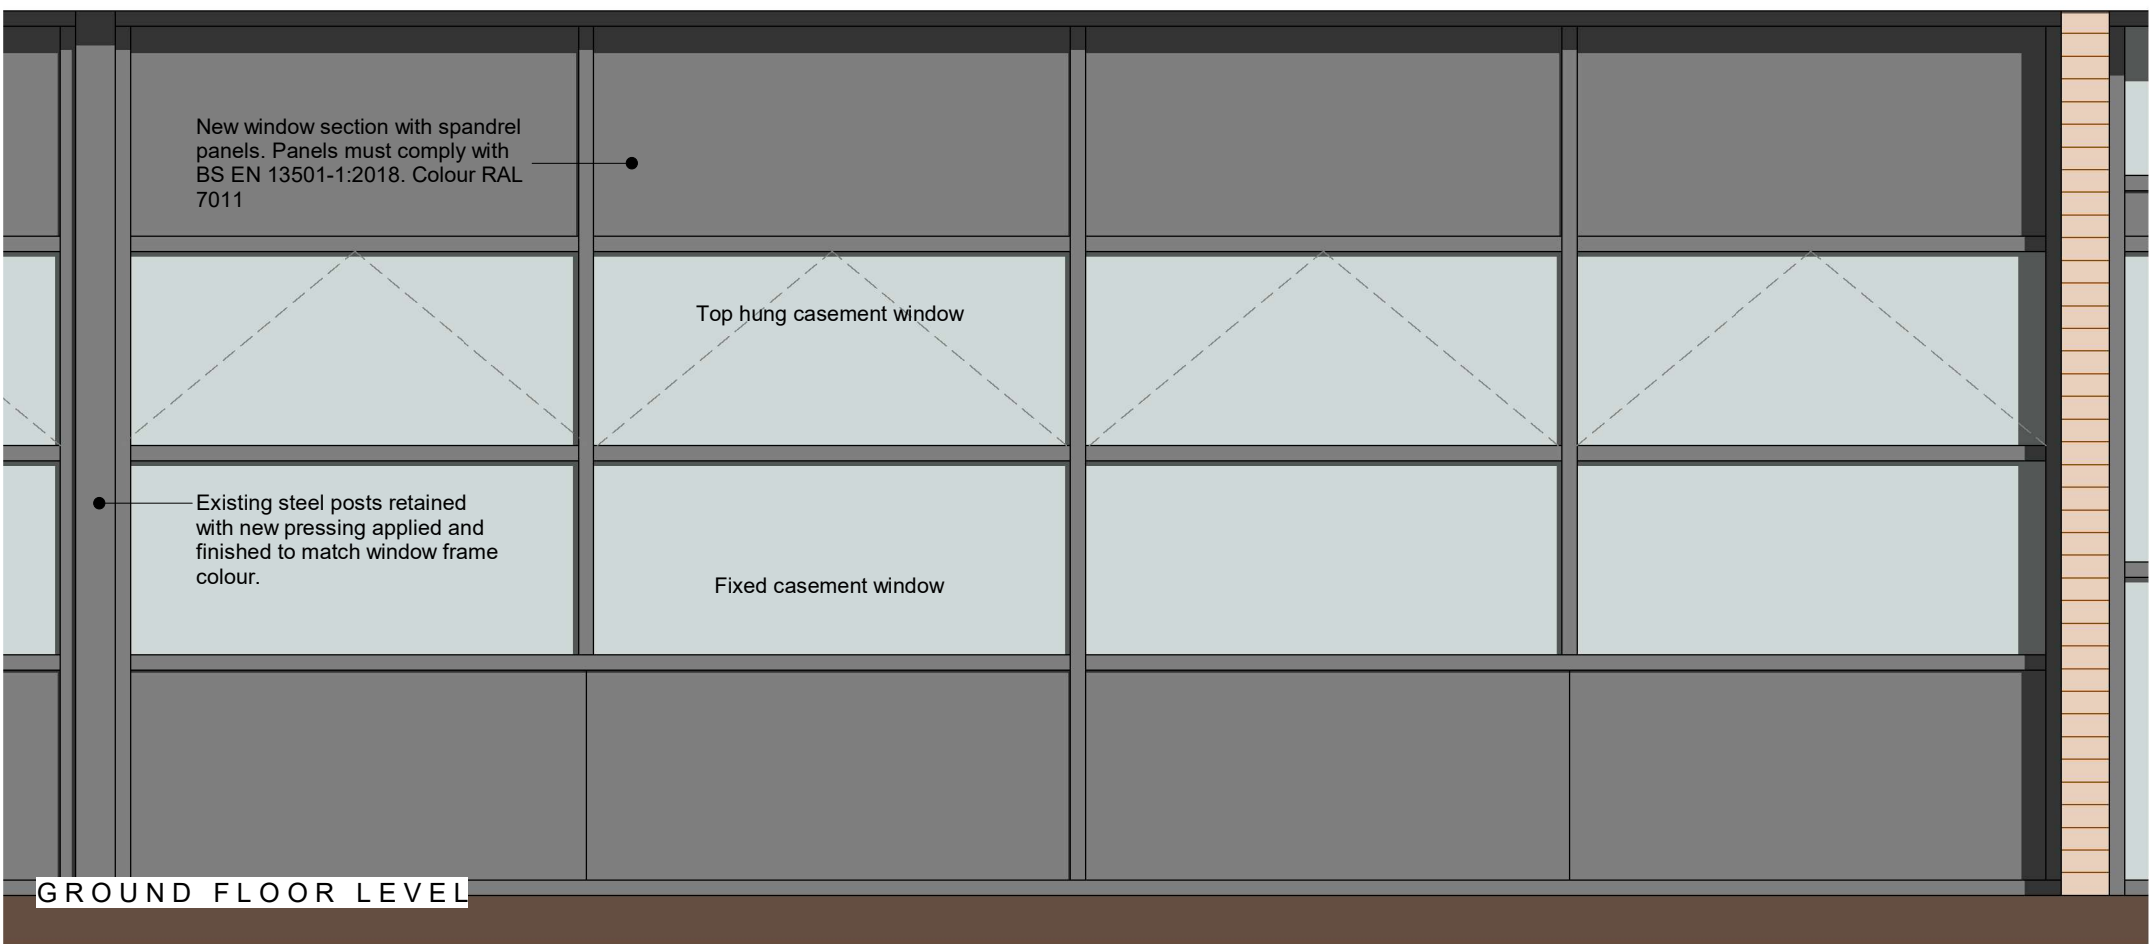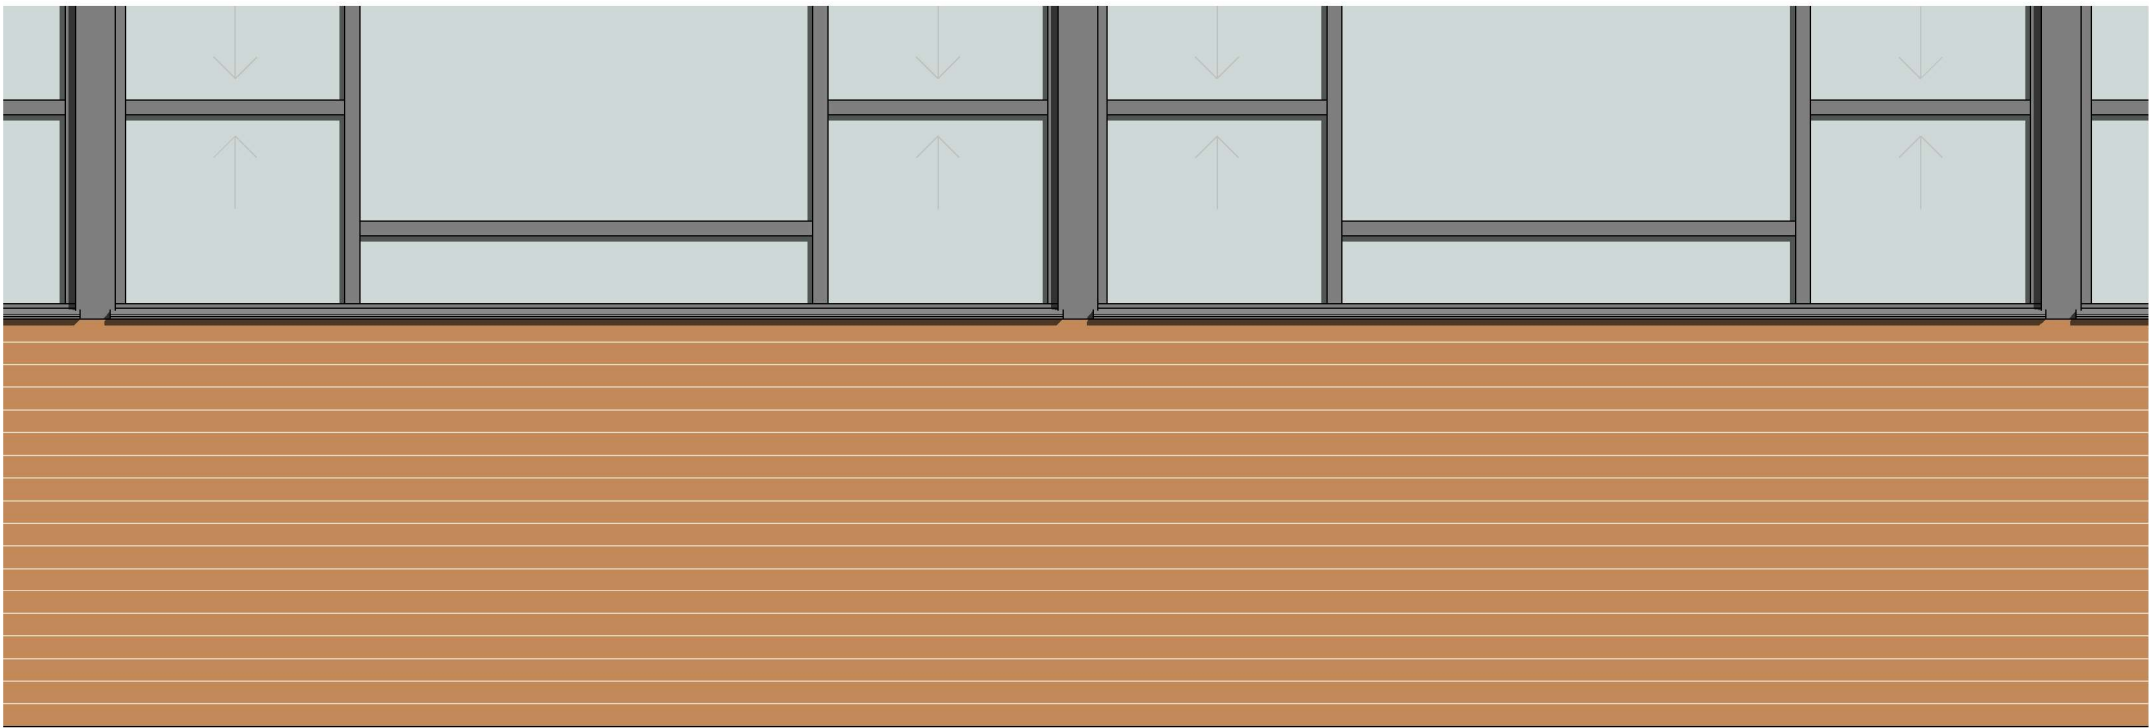

Window type 03 - South elevation
1 : 25