


72,000 litre leachate storage requirement (SSAFO, 2010)

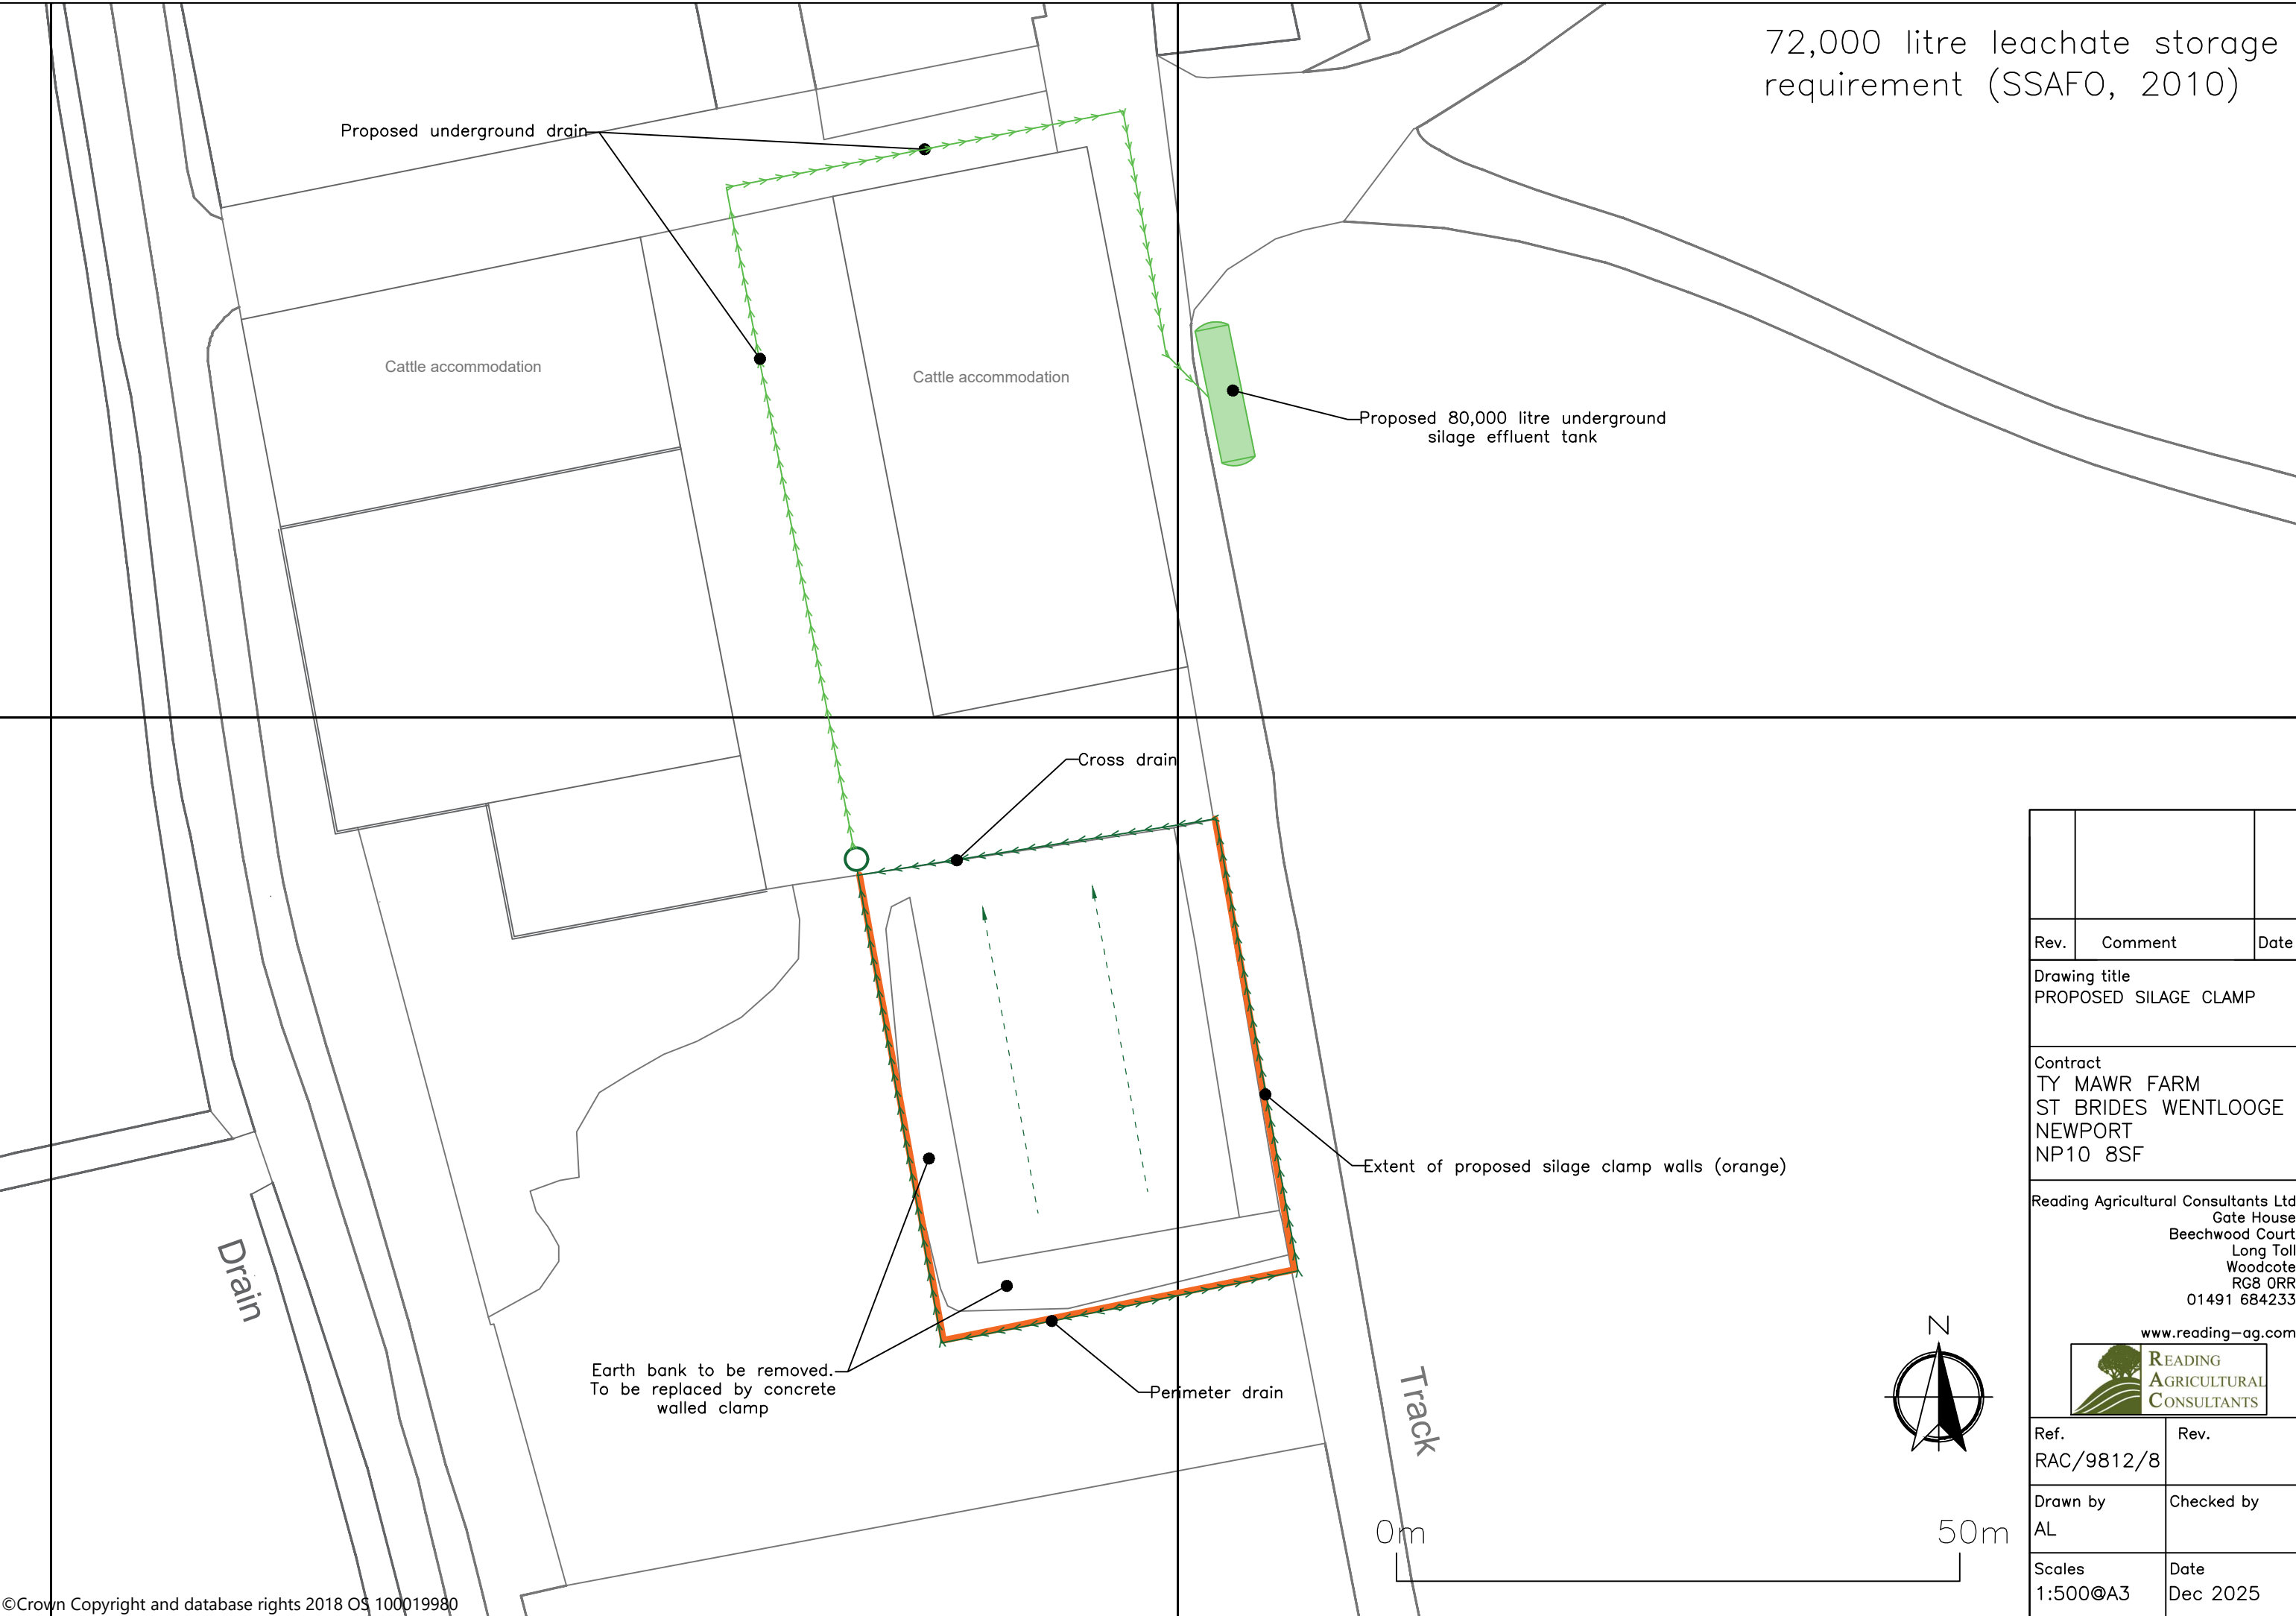

Rev.	Comment	Date
Drawing title PROPOSED SILAGE CLAMP		
Contract TY MAWR FARM ST BRIDES WENTLOOGE NEWPORT NP10 8SF		
Reading Agricultural Consultants Ltd Gate House Beechwood Court Long Toll Woodcote RG8 0RR 01491 684233 www.reading-ag.com		
Ref. RAC/9812/8		Rev.
Drawn by AL		Checked by
Scales 1:500@A3		Date Dec 2025