


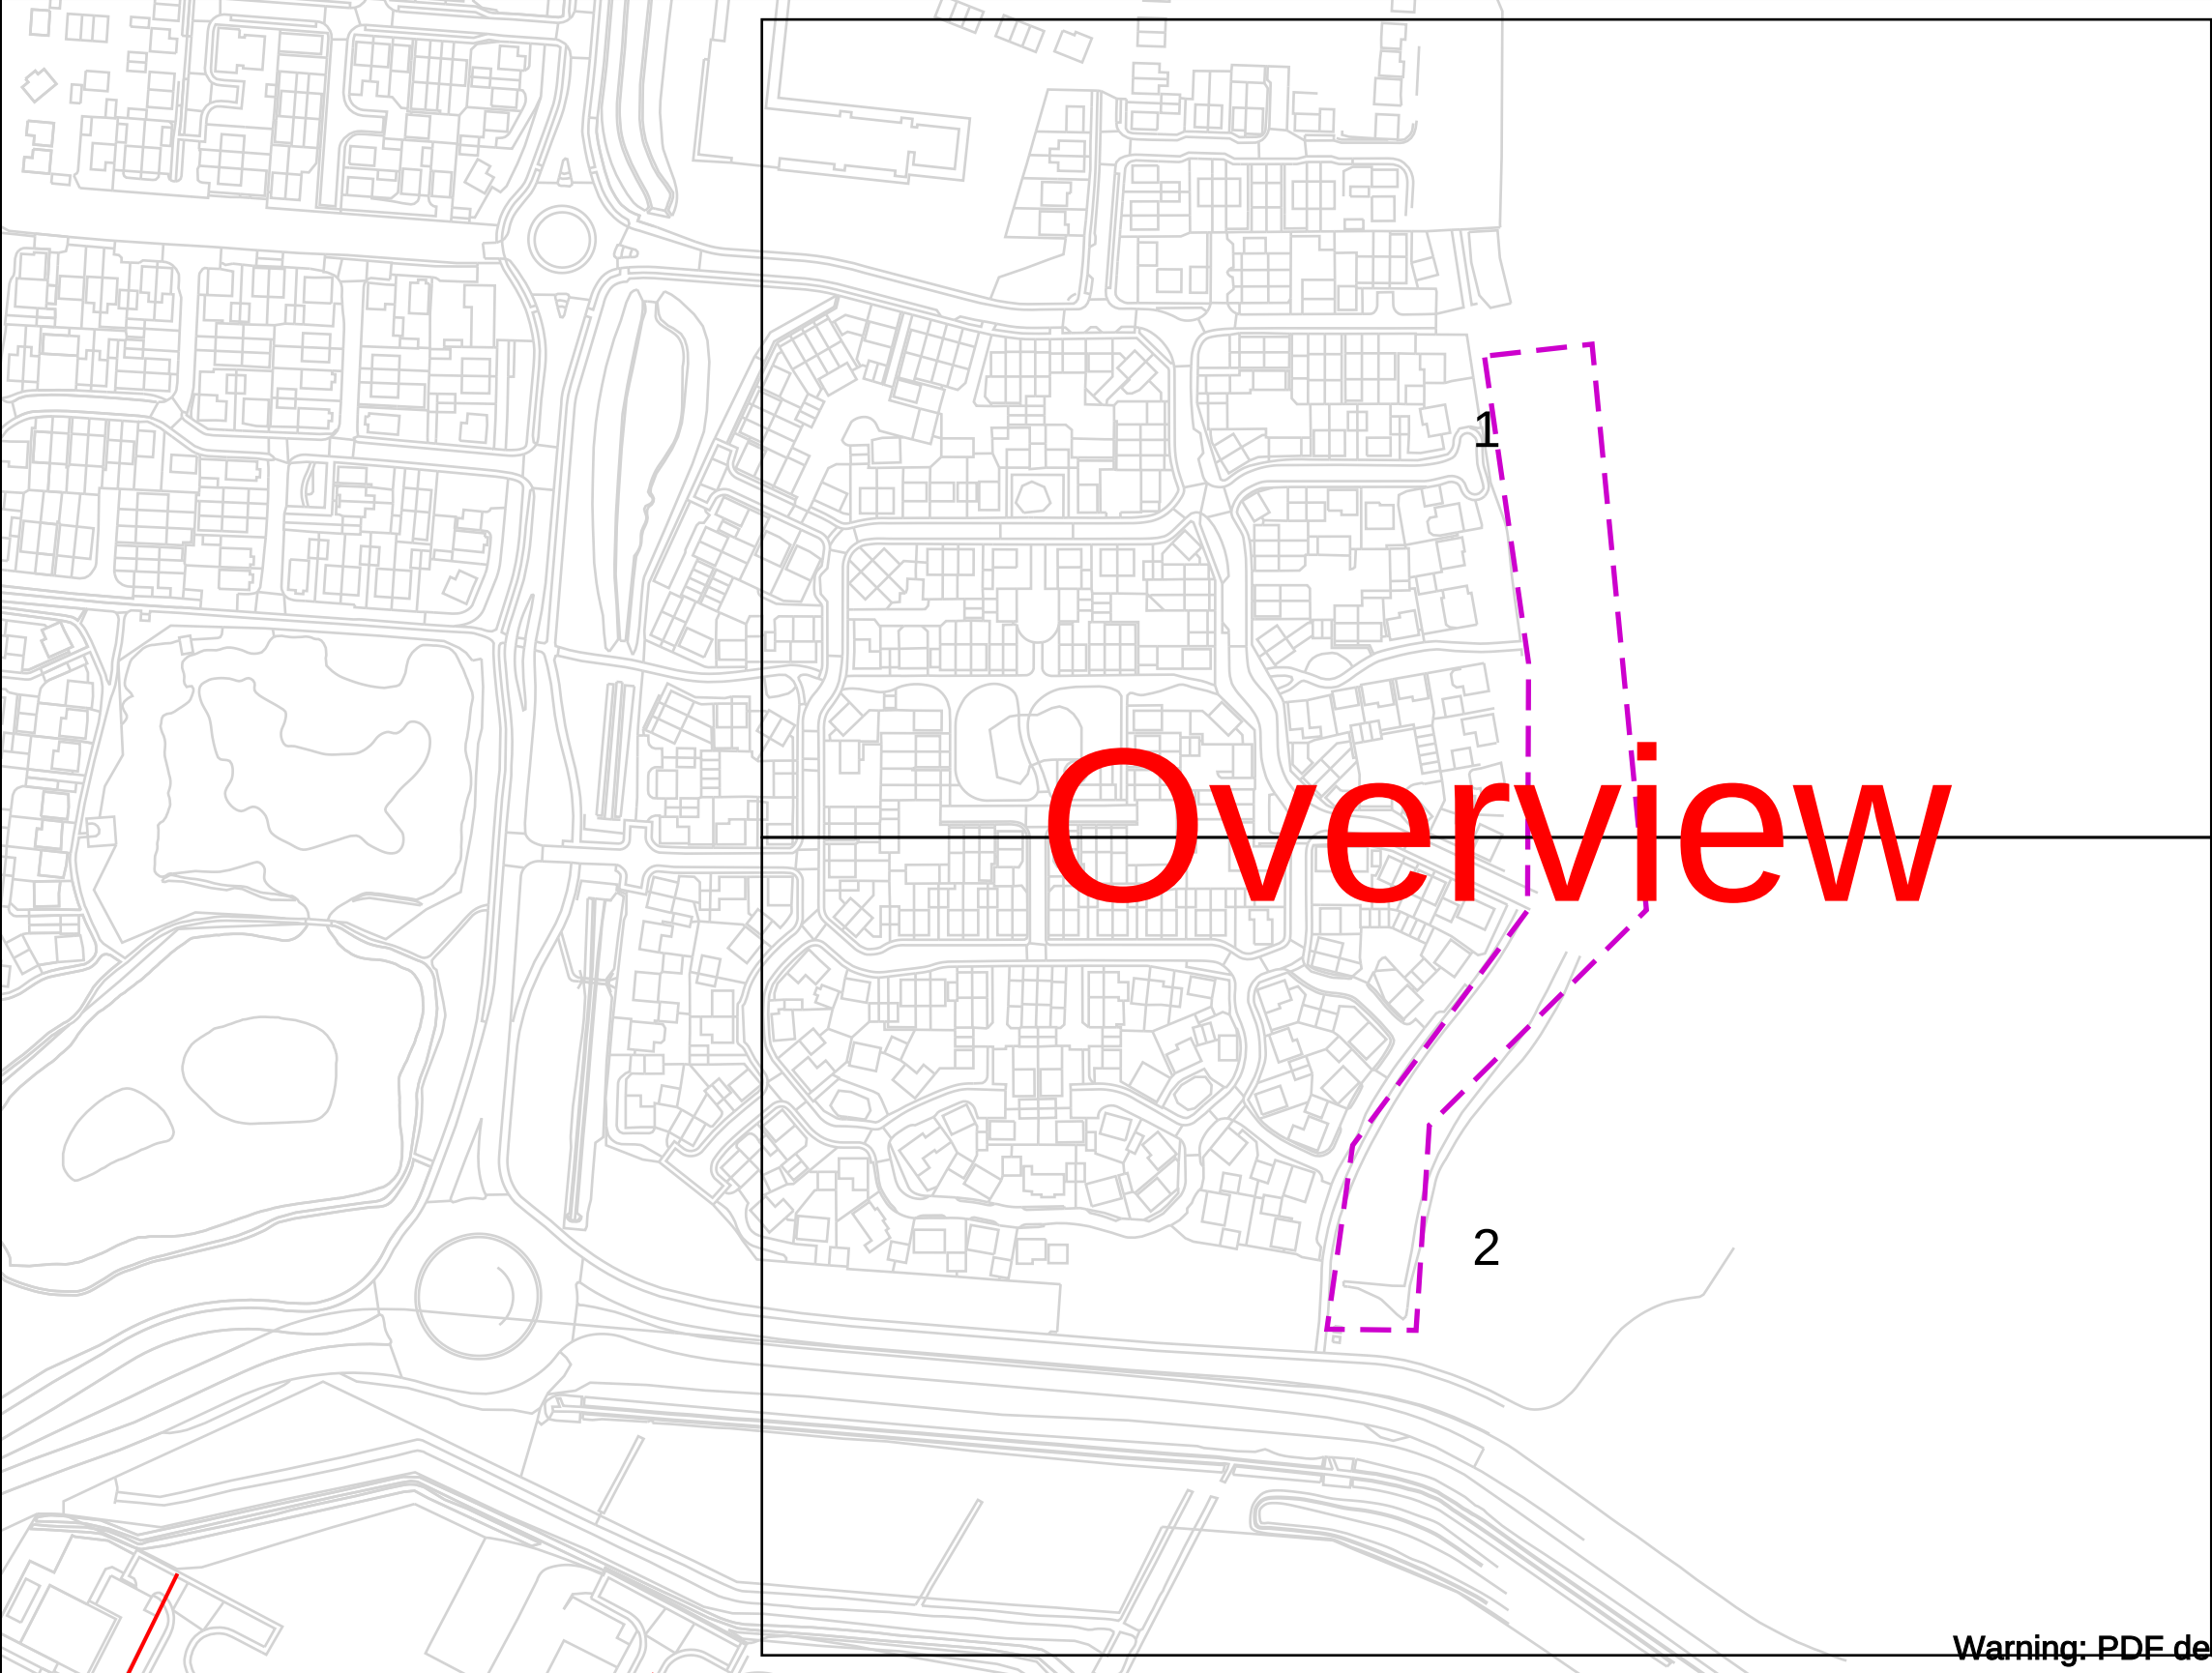

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us
Mapping Enquiries: 02920 278 912
General Enquiries: 0800 912 2999

Date Requested: 03/09/2025
Job Reference: 38576552
Site Location: 335518 186663
Requested by:
Mr Geraint Roberts
Your Scheme/Reference:
25/0453

Scale: 1:2563 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

In case of an emergency call 0800 111 999

Dig Sites

Area:  Line: 

 Low Pressure (LP) 21mbar – 75mbar

 Medium Pressure (MP) 350mbar – 2bar

 Intermediate Pressure (IP) 2bar – 7bar

 High Pressure (HP) >7bar







Line/Fire Valve

Governor Station

Change of Diameter

End Cap

Depth of cover



Smell gas?
Call the Gas Emergency Service on
0800 111 999.



We need
10 days
notice



Dial
before you dig




Investigate
Before you dig, make sure
you know what's below.



Go ahead
Done your research?
Now you can dig safely.

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2025. All rights reserved. Ordnance Survey Licence number 0100044308.

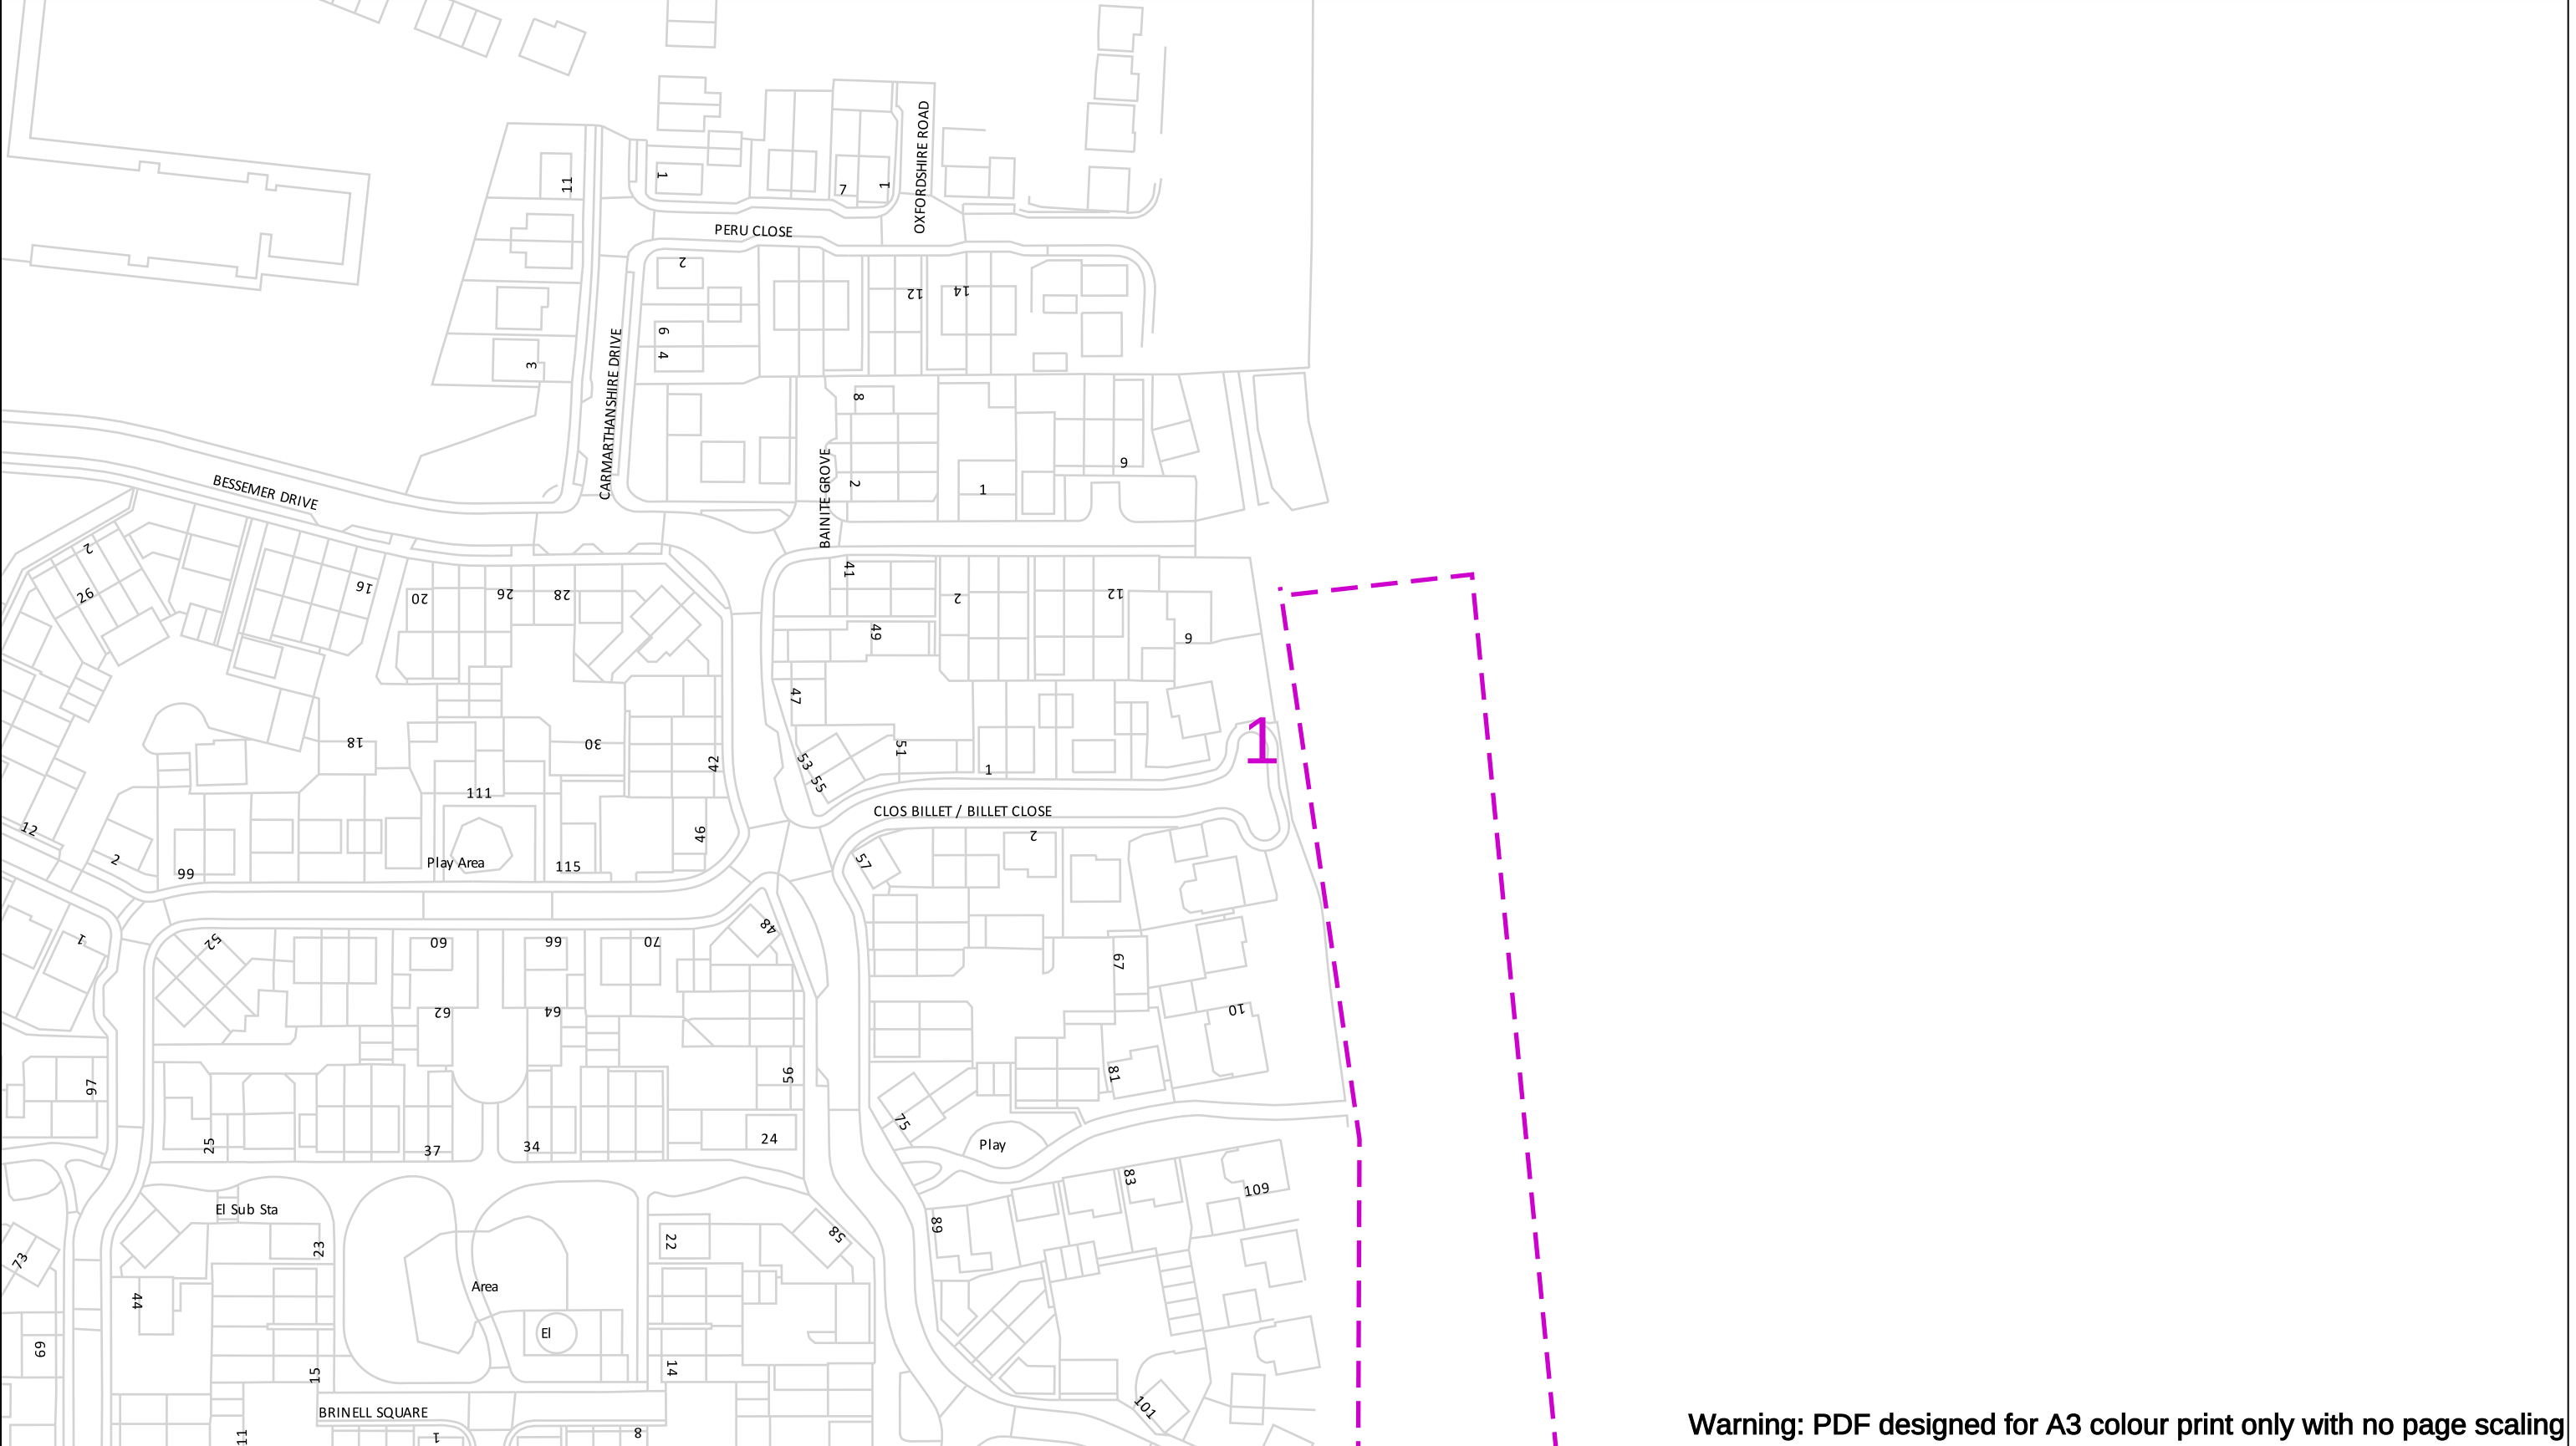

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us
Mapping Enquiries: 02920 278 912
General Enquiries: 0800 912 2999

Date Requested: 03/09/2025

Job Reference: 38576552

Site Location: 335518 186663

Requested by:
Mr Geraint Roberts

Your Scheme/Reference: 25/0453

Scale: 1:1250 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed
- The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter
- Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated
- You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used
- It is your responsibility to ensure this information is provided to all persons working near our plant
- If in doubt call the WWU dig team on 02920 278912

In case of an emergency call 0800 111 999

Dig Sites

Area:

Line:

Low Pressure (LP) 21mbar – 75mbar

Medium Pressure (MP) 350mbar – 2bar

Intermediate Pressure (IP) 2bar – 7bar

High Pressure (HP) >7bar

Line/Fire Valve

Governor Station

Change of Diameter

End Cap

Depth of cover

WALES&WEST
UTILITIES

Smell gas?
Call the Gas Emergency Service on
0800 111 999.

Dial
before
you dig

We need
10 days'
notice

Investigate

Before you dig, make sure
you know what's below.

Go ahead

Done your research?
Now you can dig safely.

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2025. All rights reserved. Ordnance Survey Licence number 0100044308.



Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2025. All rights reserved. Ordnance Survey Licence number 0100044308.