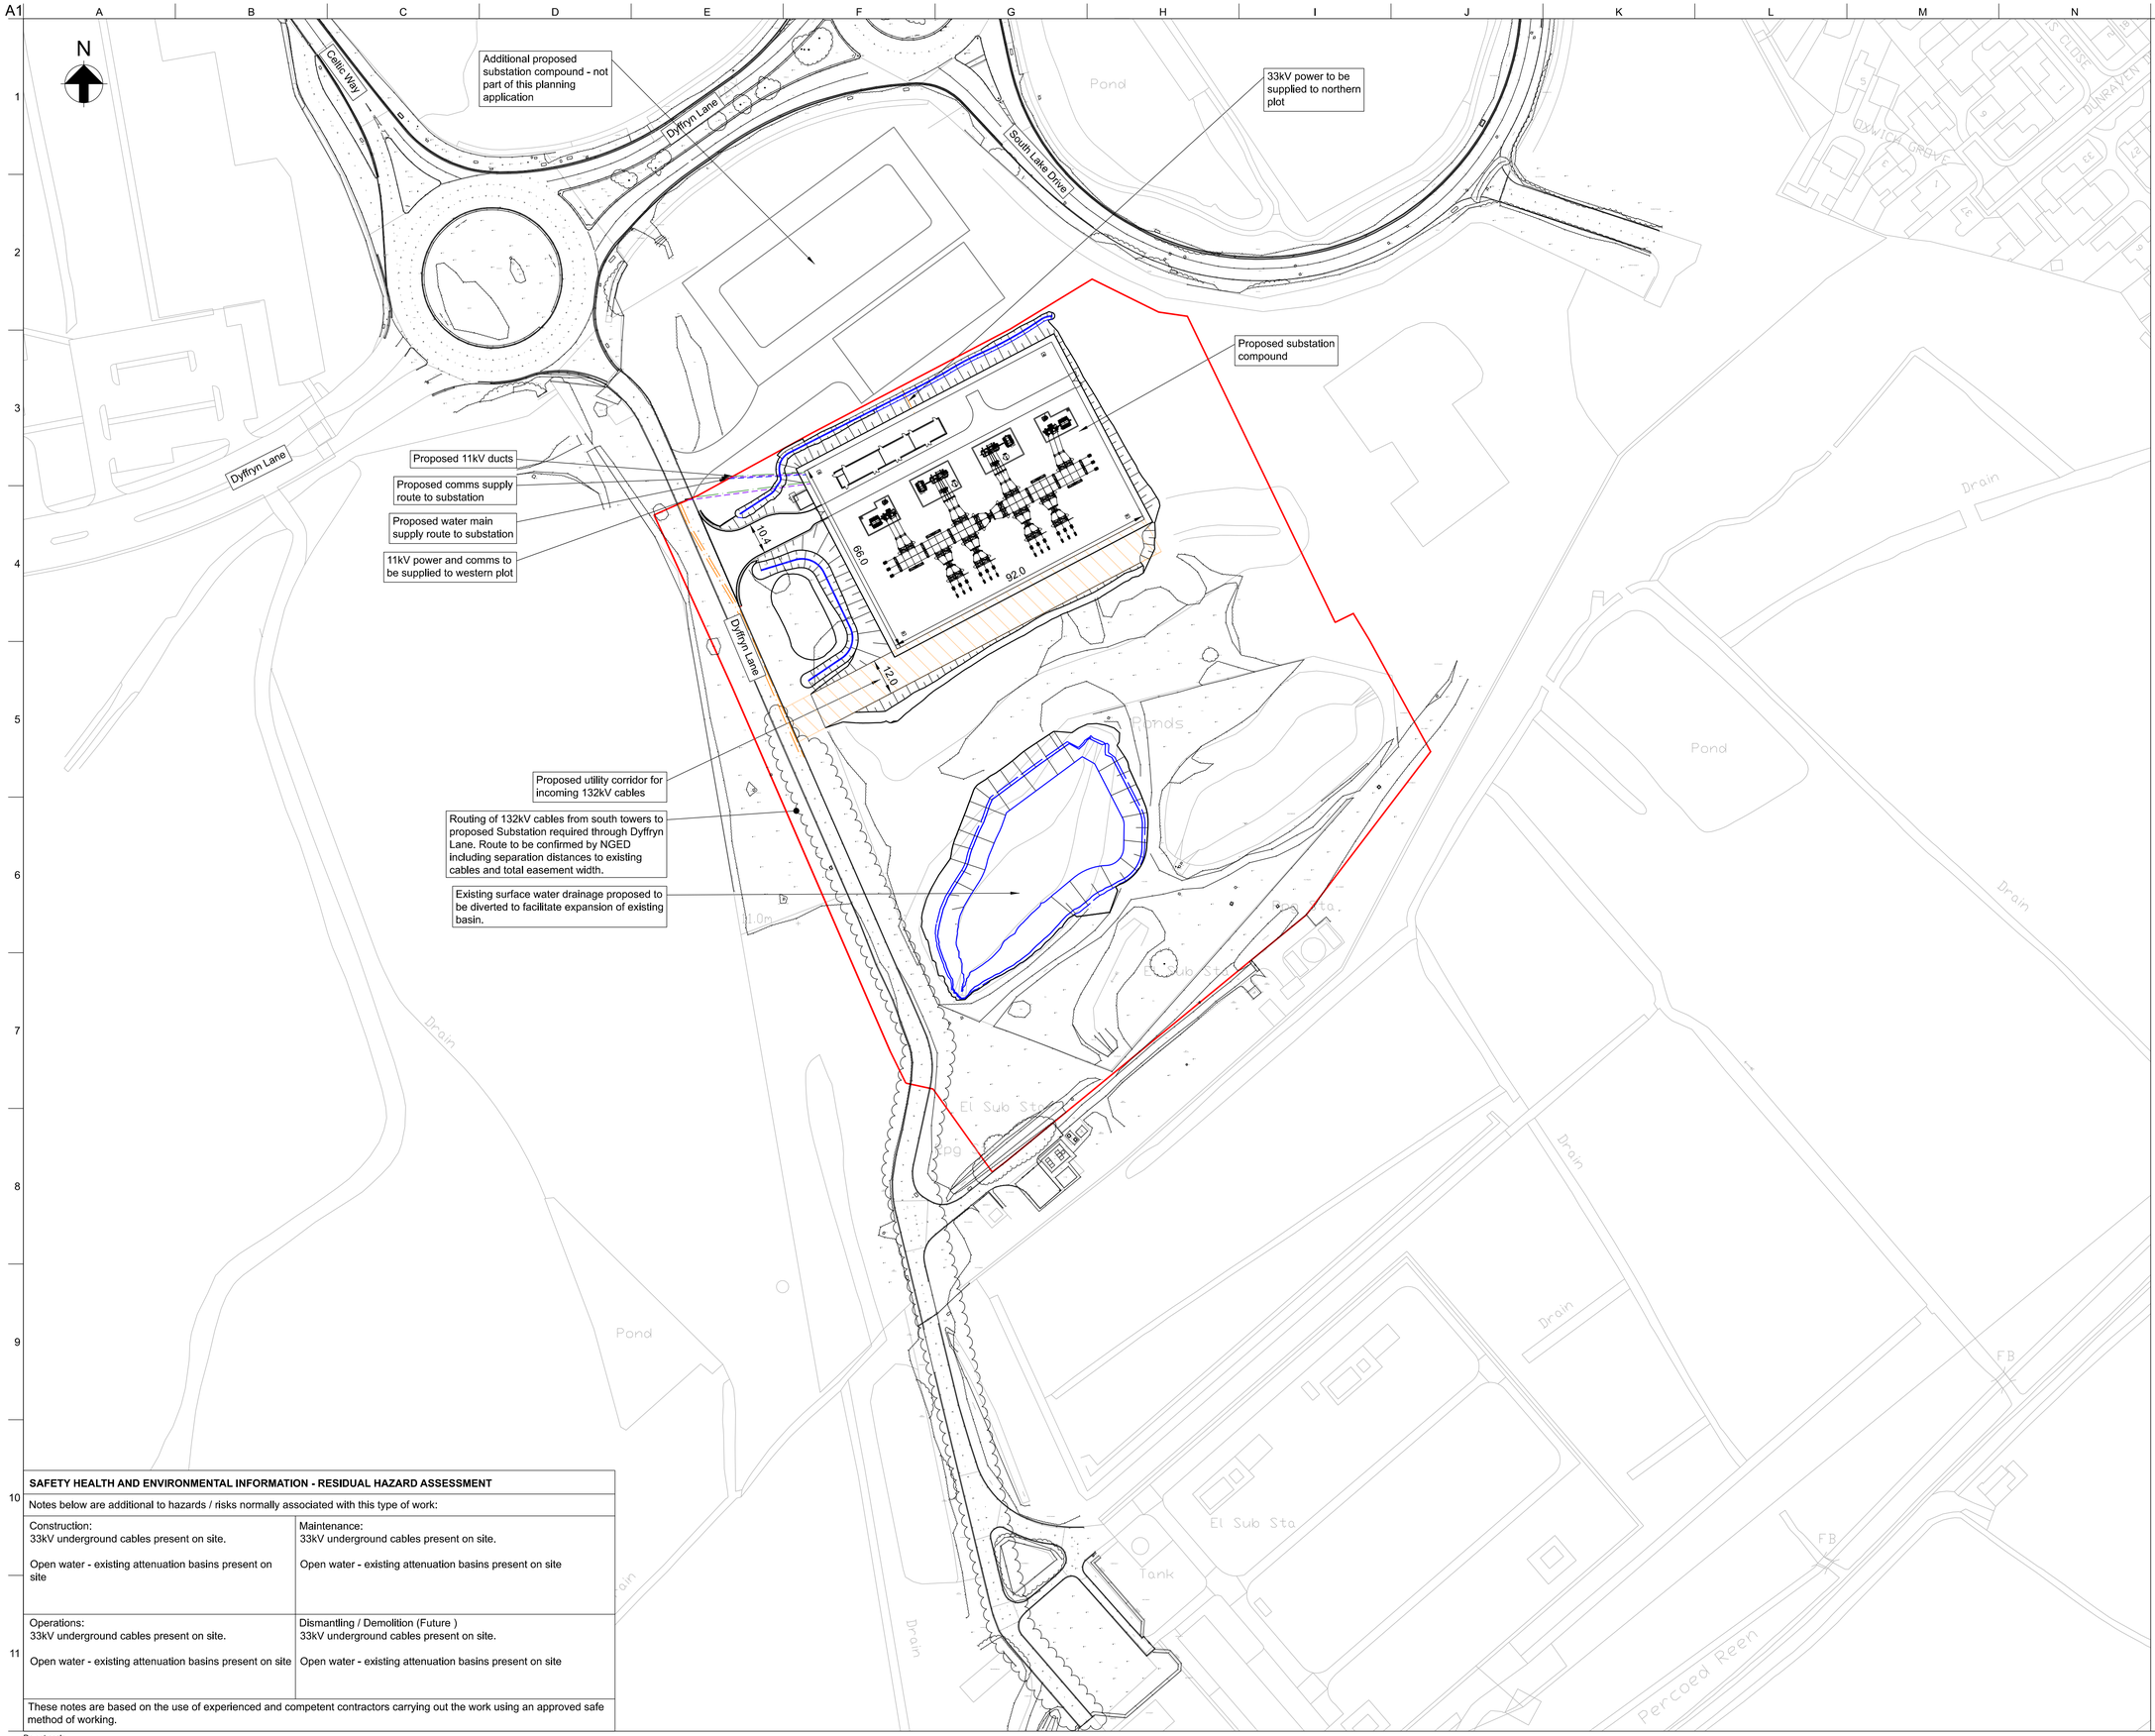


SAFETY HEALTH AND ENVIRONMENTAL INFORMATION - RESIDUAL HAZARD ASSESSMENT	
Notes below are additional to hazards / risks normally associated with this type of work:	
Construction: 33kV underground cables present on site. Open water - existing attenuation basins present on site	Maintenance: 33kV underground cables present on site. Open water - existing attenuation basins present on site
Operations: 33kV underground cables present on site. Open water - existing attenuation basins present on site	Dismantling / Demolition (Future) 33kV underground cables present on site. Open water - existing attenuation basins present on site
These notes are based on the use of experienced and competent contractors carrying out the work using an approved safe method of working.	

Legend

- Planning Application Boundary
- Proposed 33kV
- Proposed 11kV
- Proposed 132kV Utility Corridor
- Proposed Water Main
- Proposed Comms

Notes

1. The details shown on the drawing are for Planning and are subject to approval by Newport County Council.

2. All dimensions and chainages in metres (m) and elevations in metres Above Ordnance Datum (m AOD) unless noted otherwise. Do not scale from this drawing.

3. The topographical survey information shown on this drawing was received from Geo-Info Ltd on 29/06/2023. No responsibility is taken for its accuracy.

4. Proposed 132kV cables assumed to be laid circuit-to-circuit, indicative separation dimensions based on discussions with stakeholders. Overall corridor width to be informed by NGED.

5. Substation compound layout as provided by NGED on 26/09/2023.

6. Substation and associated infrastructure shown outside of site boundary is subject to a separate planning application. Features shown outside of the site boundary are subject to further third party design and are not intended for consideration as part of this planning application.

Issue	Date	By	Chkd	Appd
P04	09/06/25	CB	CL	DL
	Issued for Section 73 Approval			
P03	27/09/23	RL	JN	DL
	Issued for Planning			
P02	26/07/23	RL	JN	DL
	Re-issued for PAC			
P01	19/07/23	RL	JN	DL
	Issued for PAC			

ARUP

4 Pierhead St, Capital Waterside
Cardiff, CF10 4QP
T +44(0)29 20473727 F +44(0)29 20472277
www.arup.com

Client
Welsh Government

Job Title
Celtic Lakes

Drawing Title
Proposed Connections Plan

Scale at A1 1:1000

Discipline Civils

Drawing Status

Job No	Drawing No	Issue
293651	CG1030	P04

J:\293600\293651-0004 Internal Project Data\4-30 Drawings\4-31 Issue drawings\CG1030.dgn

Do not scale

© Arup