


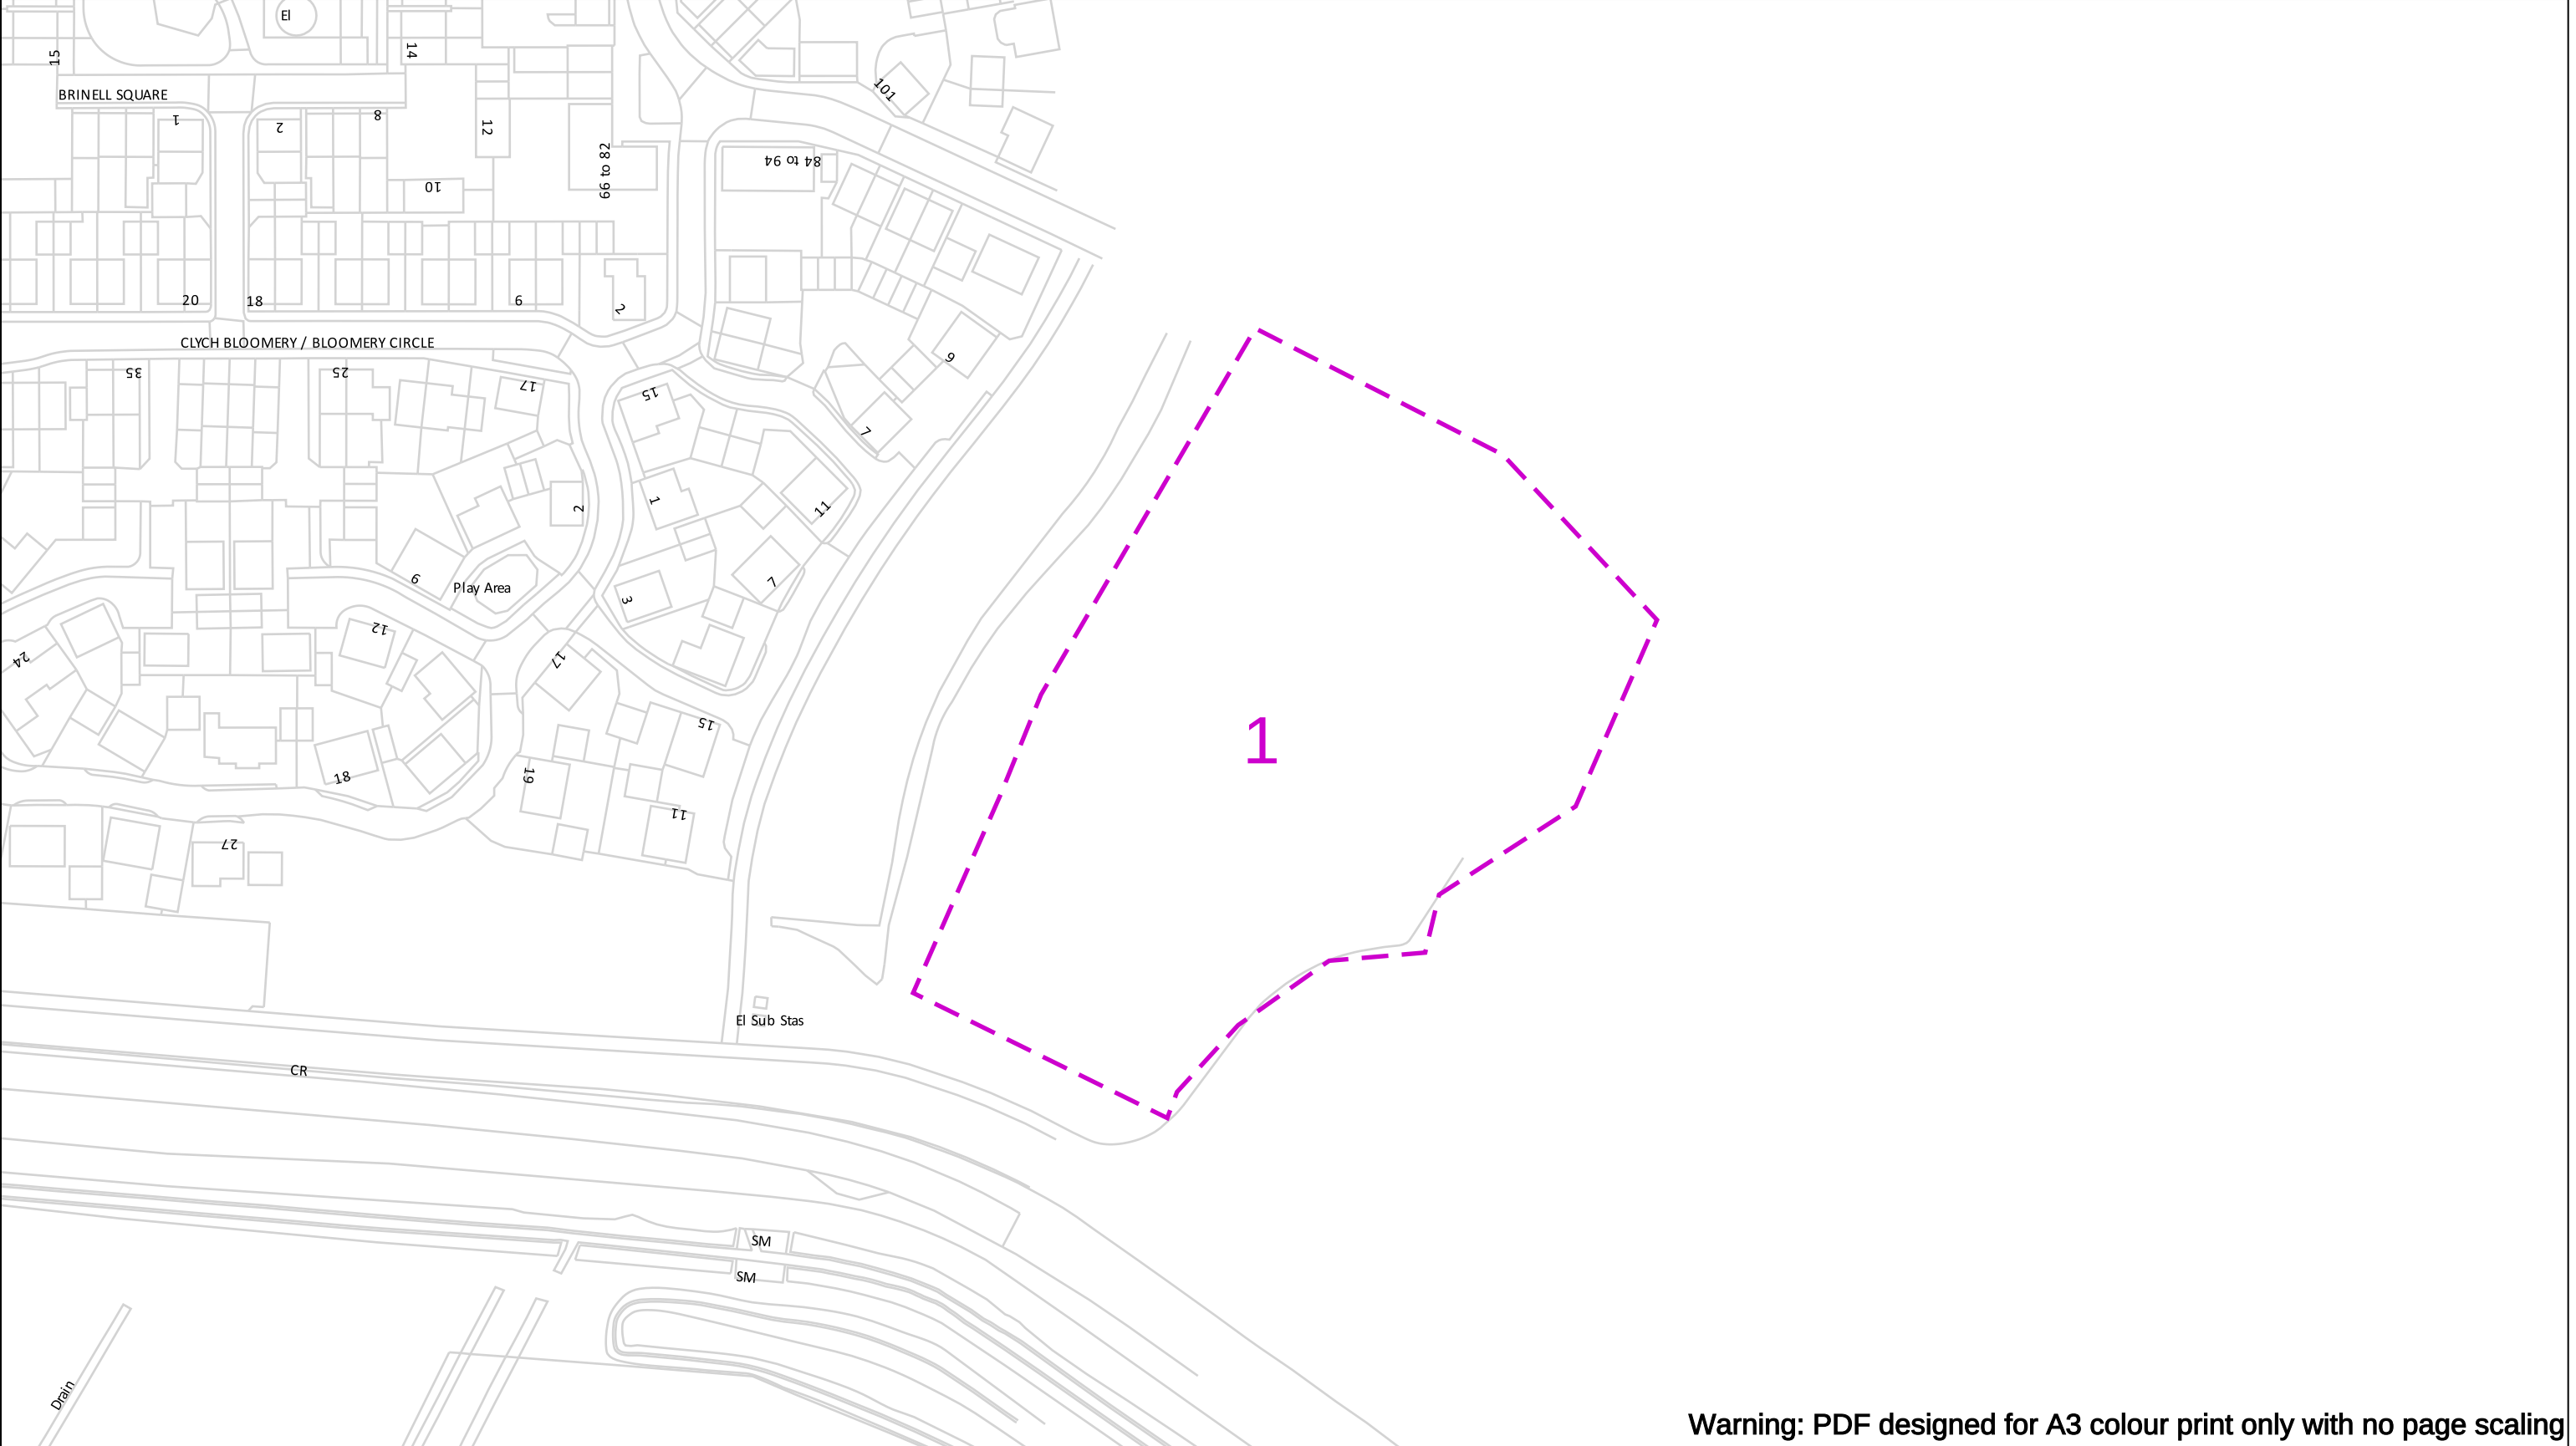

Warning: PDF designed for A3 colour print only with no page scaling

Contact Us Mapping Enquiries: 02920 278 912 General Enquiries: 0800 912 2999 Date Requested: 19/05/2025 Job Reference: 37335493 Site Location: 335564 186525 Requested by: Mr Geraint Roberts Your Scheme/Reference: 24/0782 Scale: 1:1250 (When plotted at A3)	IMPORTANT NOTICES • This information is given as a guide only and its accuracy cannot be guaranteed • The plan only shows those pipes owned by Wales & West Utilities (WWU) as its role as a licensed Gas Transporter • Service pipes, valves, syphons, stub connections etc. may not be shown but their presence should be anticipated • You must use safe digging practices in accordance with HS(G)47 to establish the actual position of mains, services and other apparatus before any mechanical excavation is used • It is your responsibility to ensure this information is provided to all persons working near our plant • If in doubt call the WWU dig team on 02920 278912	In case of an emergency call 0800 111 999 Dig Sites Low Pressure (LP) 21mbar – 75mbar Medium Pressure (MP) 350mbar – 2bar Intermediate Pressure (IP) 2bar – 7bar High Pressure (HP) >7bar Area: Line: Line/Fire Valve Governor Station Change of Diameter End Cap Depth of cover	WALES&WEST UTILITIES Dial before you dig We need 10 days' notice Smell gas? Call the Gas Emergency Service on 0800 111 999. Dial Call 029 2027 8912 before you start work. Investigate Before you dig, make sure you know what's below. Go ahead Done your research? Now you can dig safely.
--	---	--	--

Crown Copyright © - Reproduced by permission of Ordnance Survey on behalf of HMSO. And database right 2025. All rights reserved. Ordnance Survey Licence number 0100044308.