


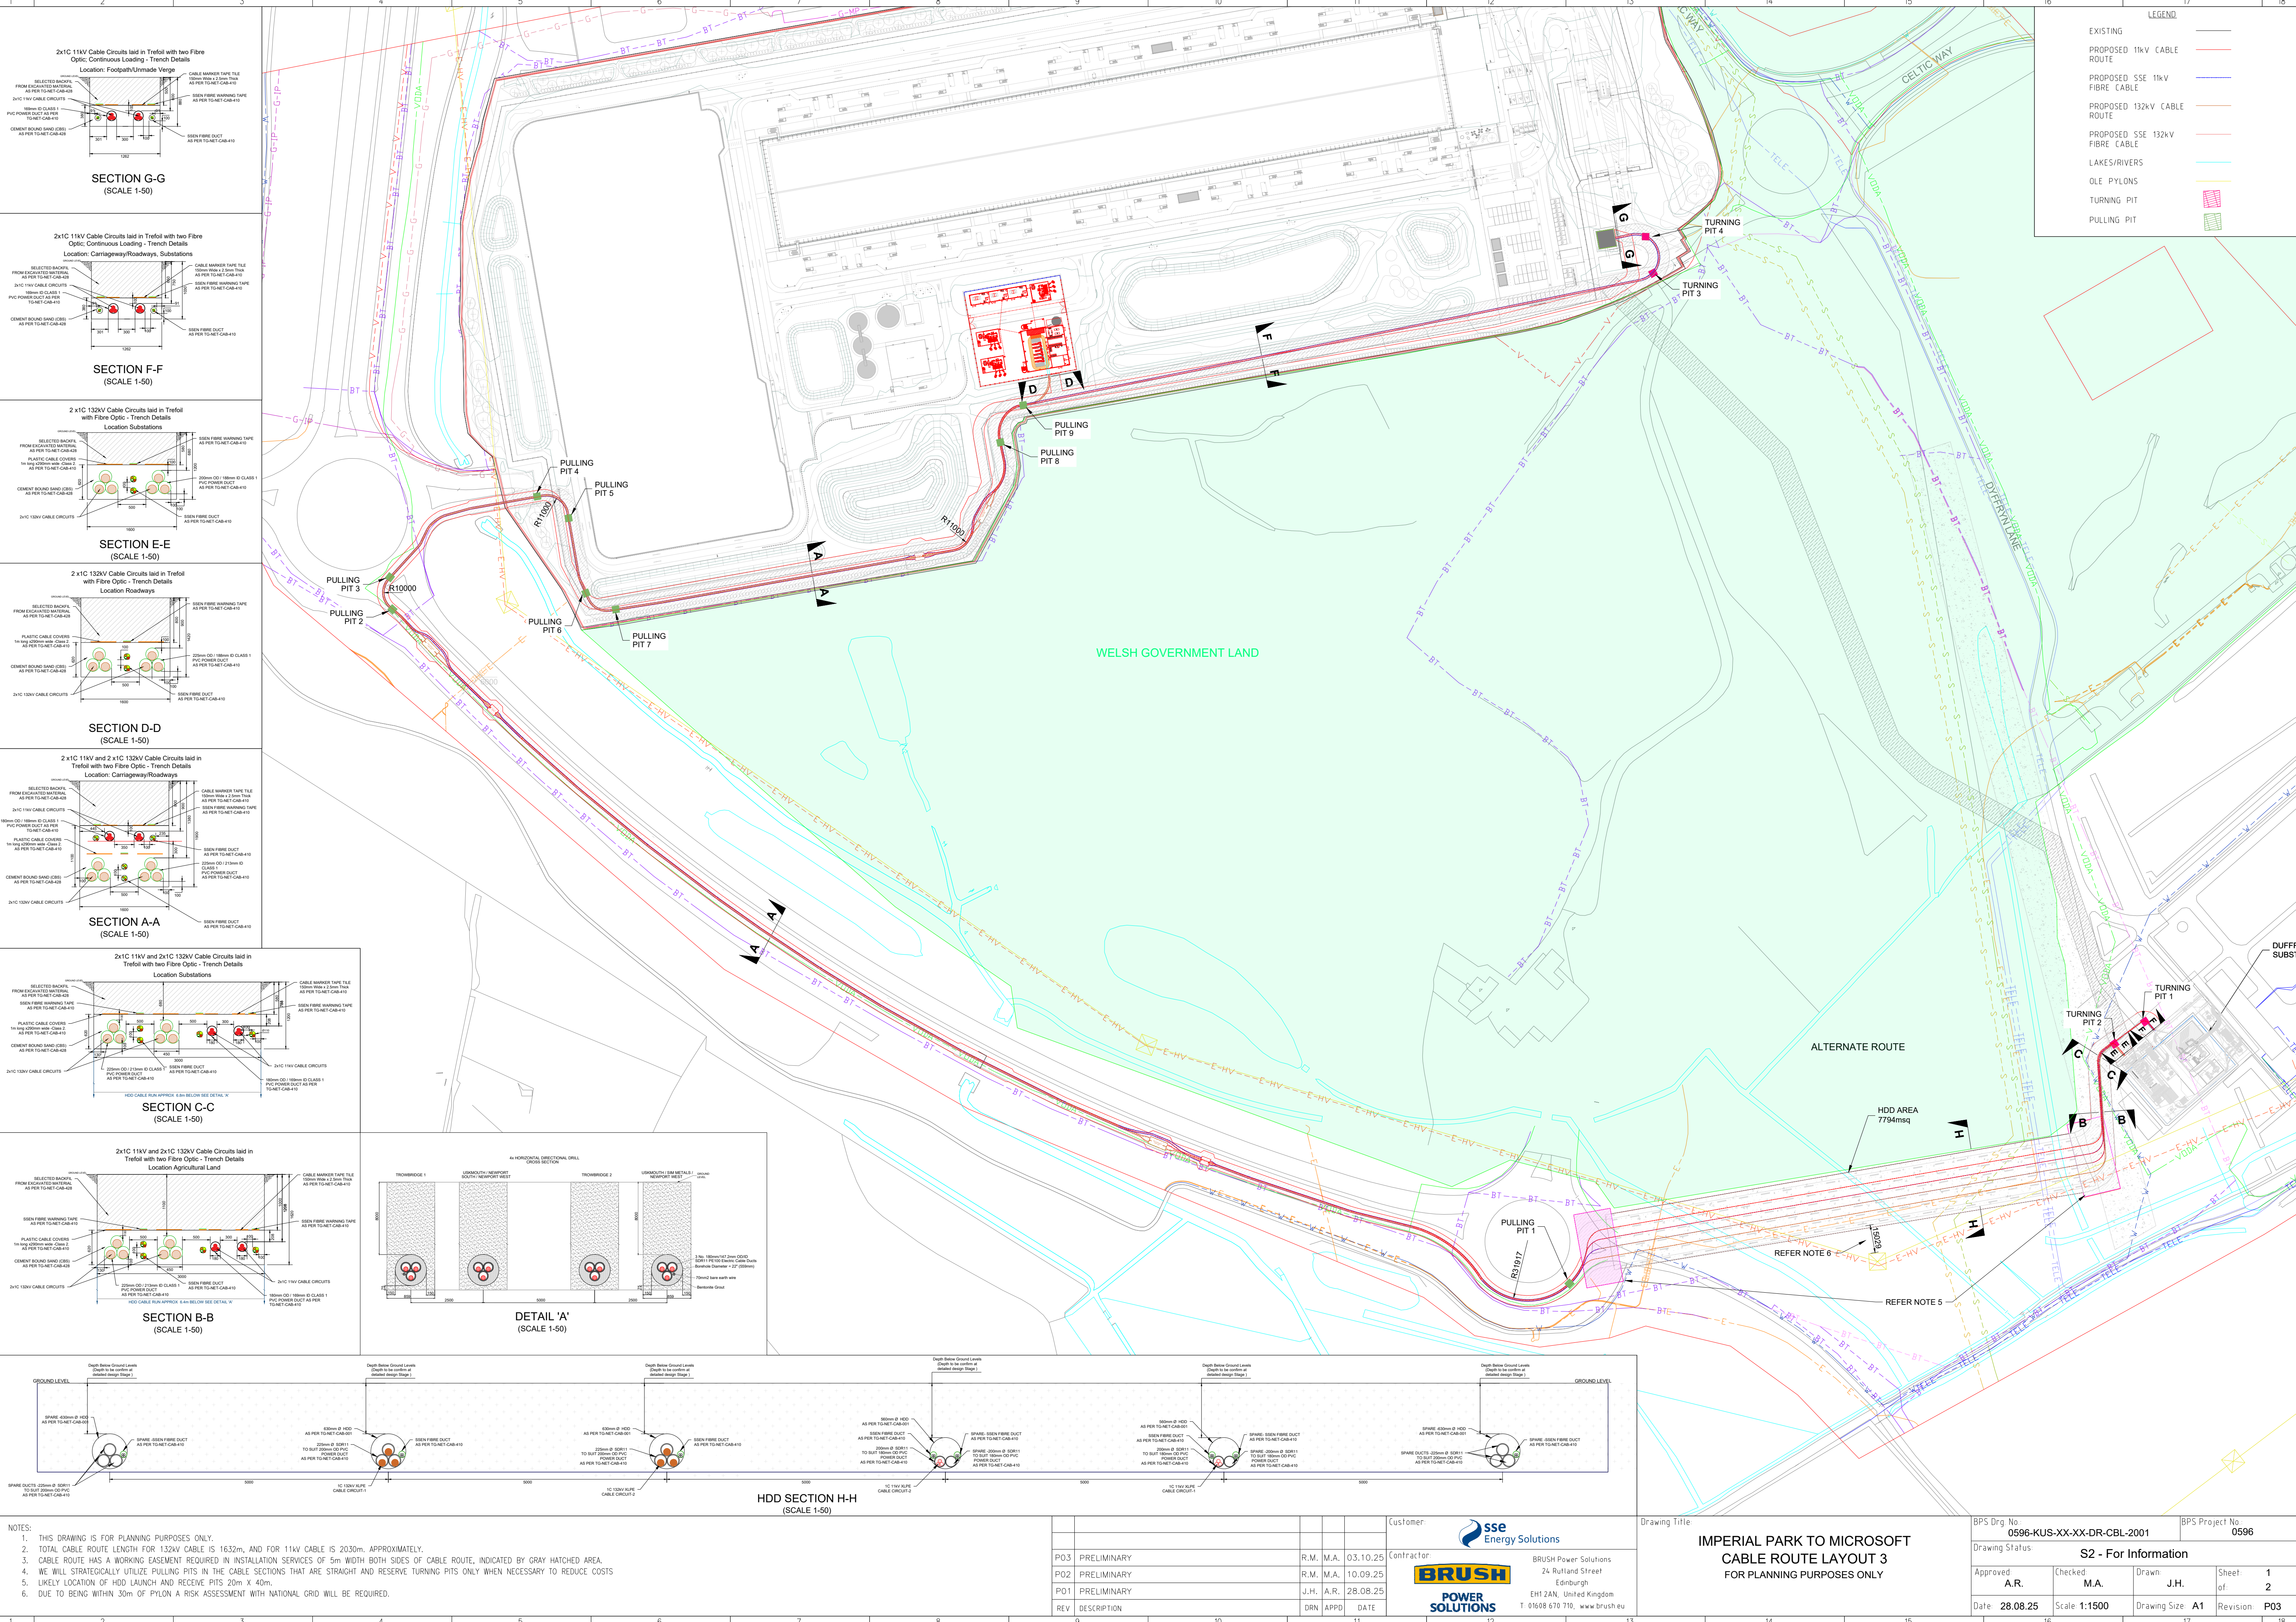

NOTES:

1. THIS DRAWING IS FOR PLANNING PURPOSES ONLY.
2. TOTAL CABLE ROUTE LENGTH FOR 132kV CABLE IS 1632m, AND FOR 11kV CABLE IS 2030m, APPROXIMATELY.
3. CABLE ROUTE HAS A WORKING EASEMENT REQUIRED IN INSTALLATION SERVICES OF 5m WIDTH BOTH SIDES OF CABLE ROUTE, INDICATED BY GRAY HATCHED AREA.
4. WE WILL STRATEGICALLY UTILIZE PULLING PITS IN THE CABLE SECTIONS THAT ARE STRAIGHT AND RESERVE TURNING PITS ONLY WHEN NECESSARY TO REDUCE COSTS
5. LIKELY LOCATION OF HDD LAUNCH AND RECEIVE PITS 20m X 40m.
6. DUE TO BEING WITHIN 30m OF PYLON A RISK ASSESSMENT WITH NATIONAL GRID WILL BE REQUIRED.

PO3	PRELIMINARY	R.M.	M.A.	03.10.25
PO2	PRELIMINARY	R.M.	M.A.	10.09.25
PO1	PRELIMINARY	J.H.	A.R.	28.08.25
REV	DESCRIPTION	DRN	APPD	DATE

Customer: **sse Energy Solutions**

Contractor: **BRUSH POWER SOLUTIONS**

BRUSH Power Solutions
24 Rutland Street
Edinburgh
EH1 2AN, United Kingdom
T: 01608 670 710, www.brush.eu

Drawing Title: **IMPERIAL PARK TO MICROSOFT CABLE ROUTE LAYOUT 3 FOR PLANNING PURPOSES ONLY**

BPS Drg No: 0596-KUS-XX-XX-DR-CBL-2001	BPS Project No: 0596
Drawing Status: S2 - For Information	
Approved: A.R.	Checked: M.A.
Drawn: J.H.	Sheet: 1
Date: 28.08.25	Scale: 1:1500
Drawing Size: A1	Revision: P03