


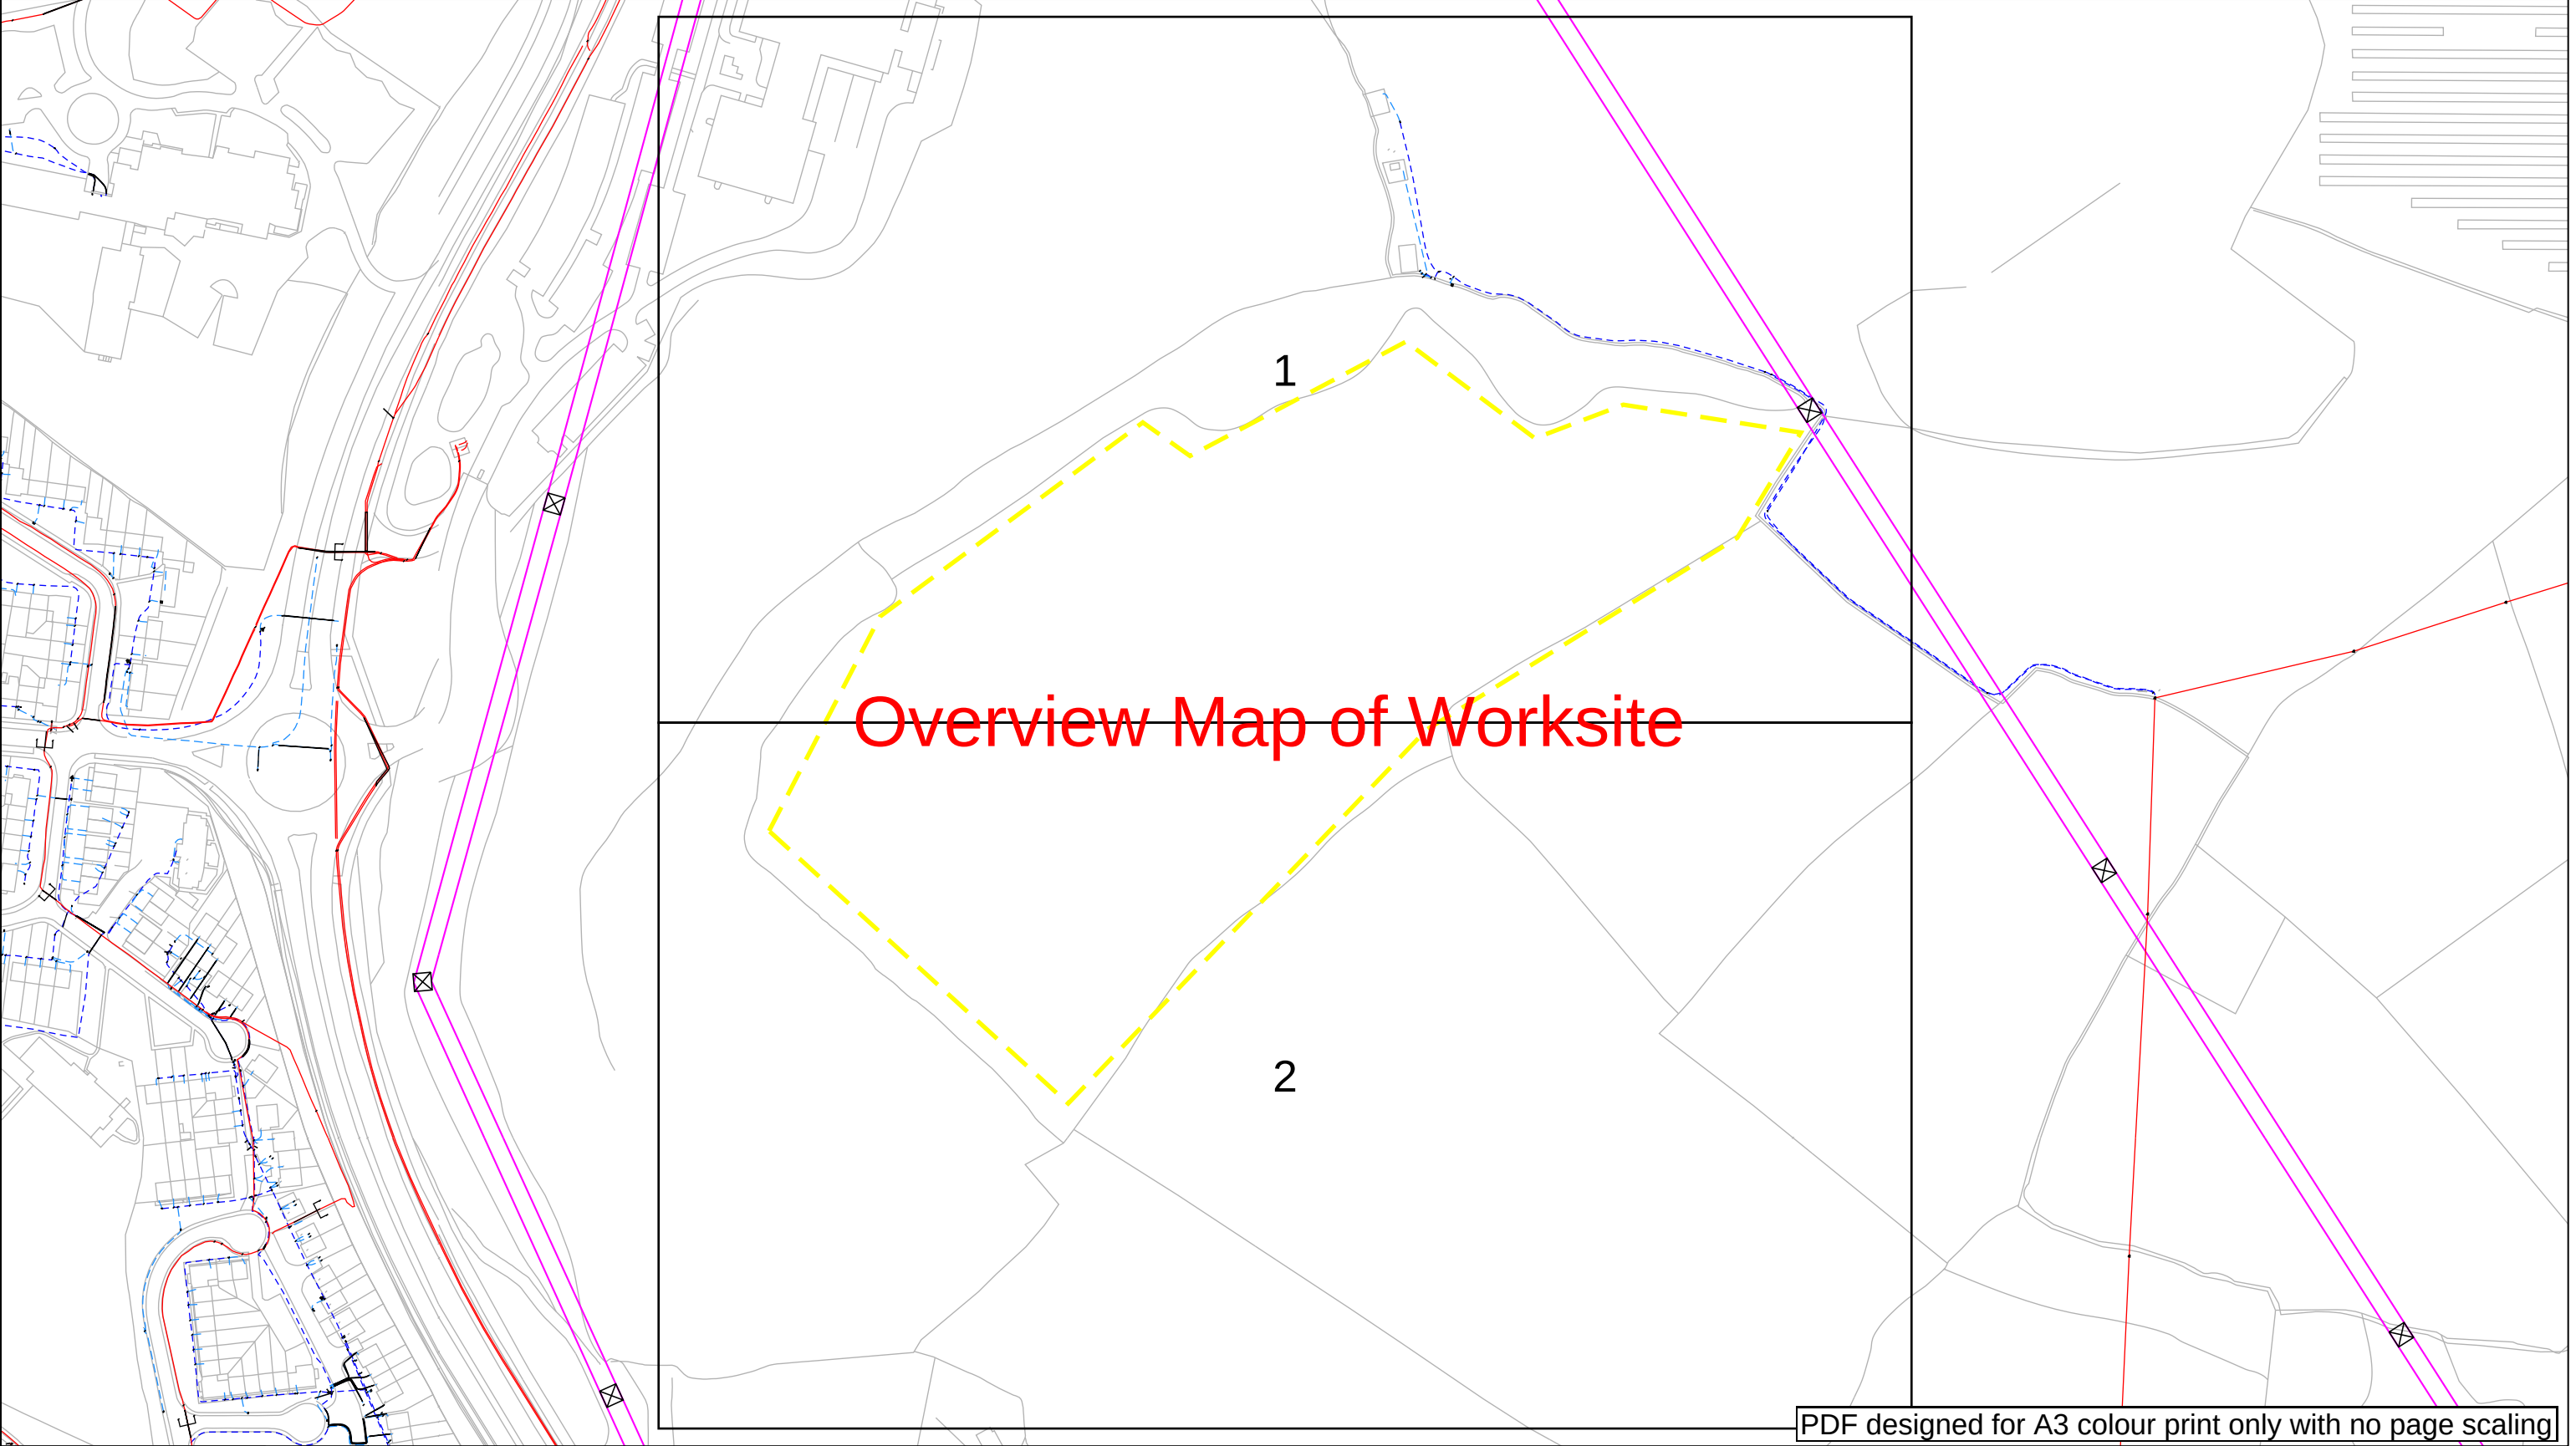

PDF designed for A3 colour print only with no page scaling

Contact Us

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 17/06/2024

Job Reference: 33763539

Site Location: 336301 189188

Requested by:
Mr Geraint Roberts

Your Scheme/Reference:
24/0467

Scale: 1:2563 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

Link Box

●

Site Location

Line/Area

— — — — —

Overhead Line

— — — — —

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

— — — — —

— — — — —

— — — — —

— — — — —

— — — — —

— — — — —

National Grid Telecoms

— — — — —

Private Cables

— — — — —

PME Earth

Underground Earth

Pilot Cables

— — — — —

Pole Mounted Transformer

Ground Mounted Transformer


Report damage immediately KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

nationalgrid

Electricity Distribution


Email: NGED.MapResponse@NationalGrid.co.uk

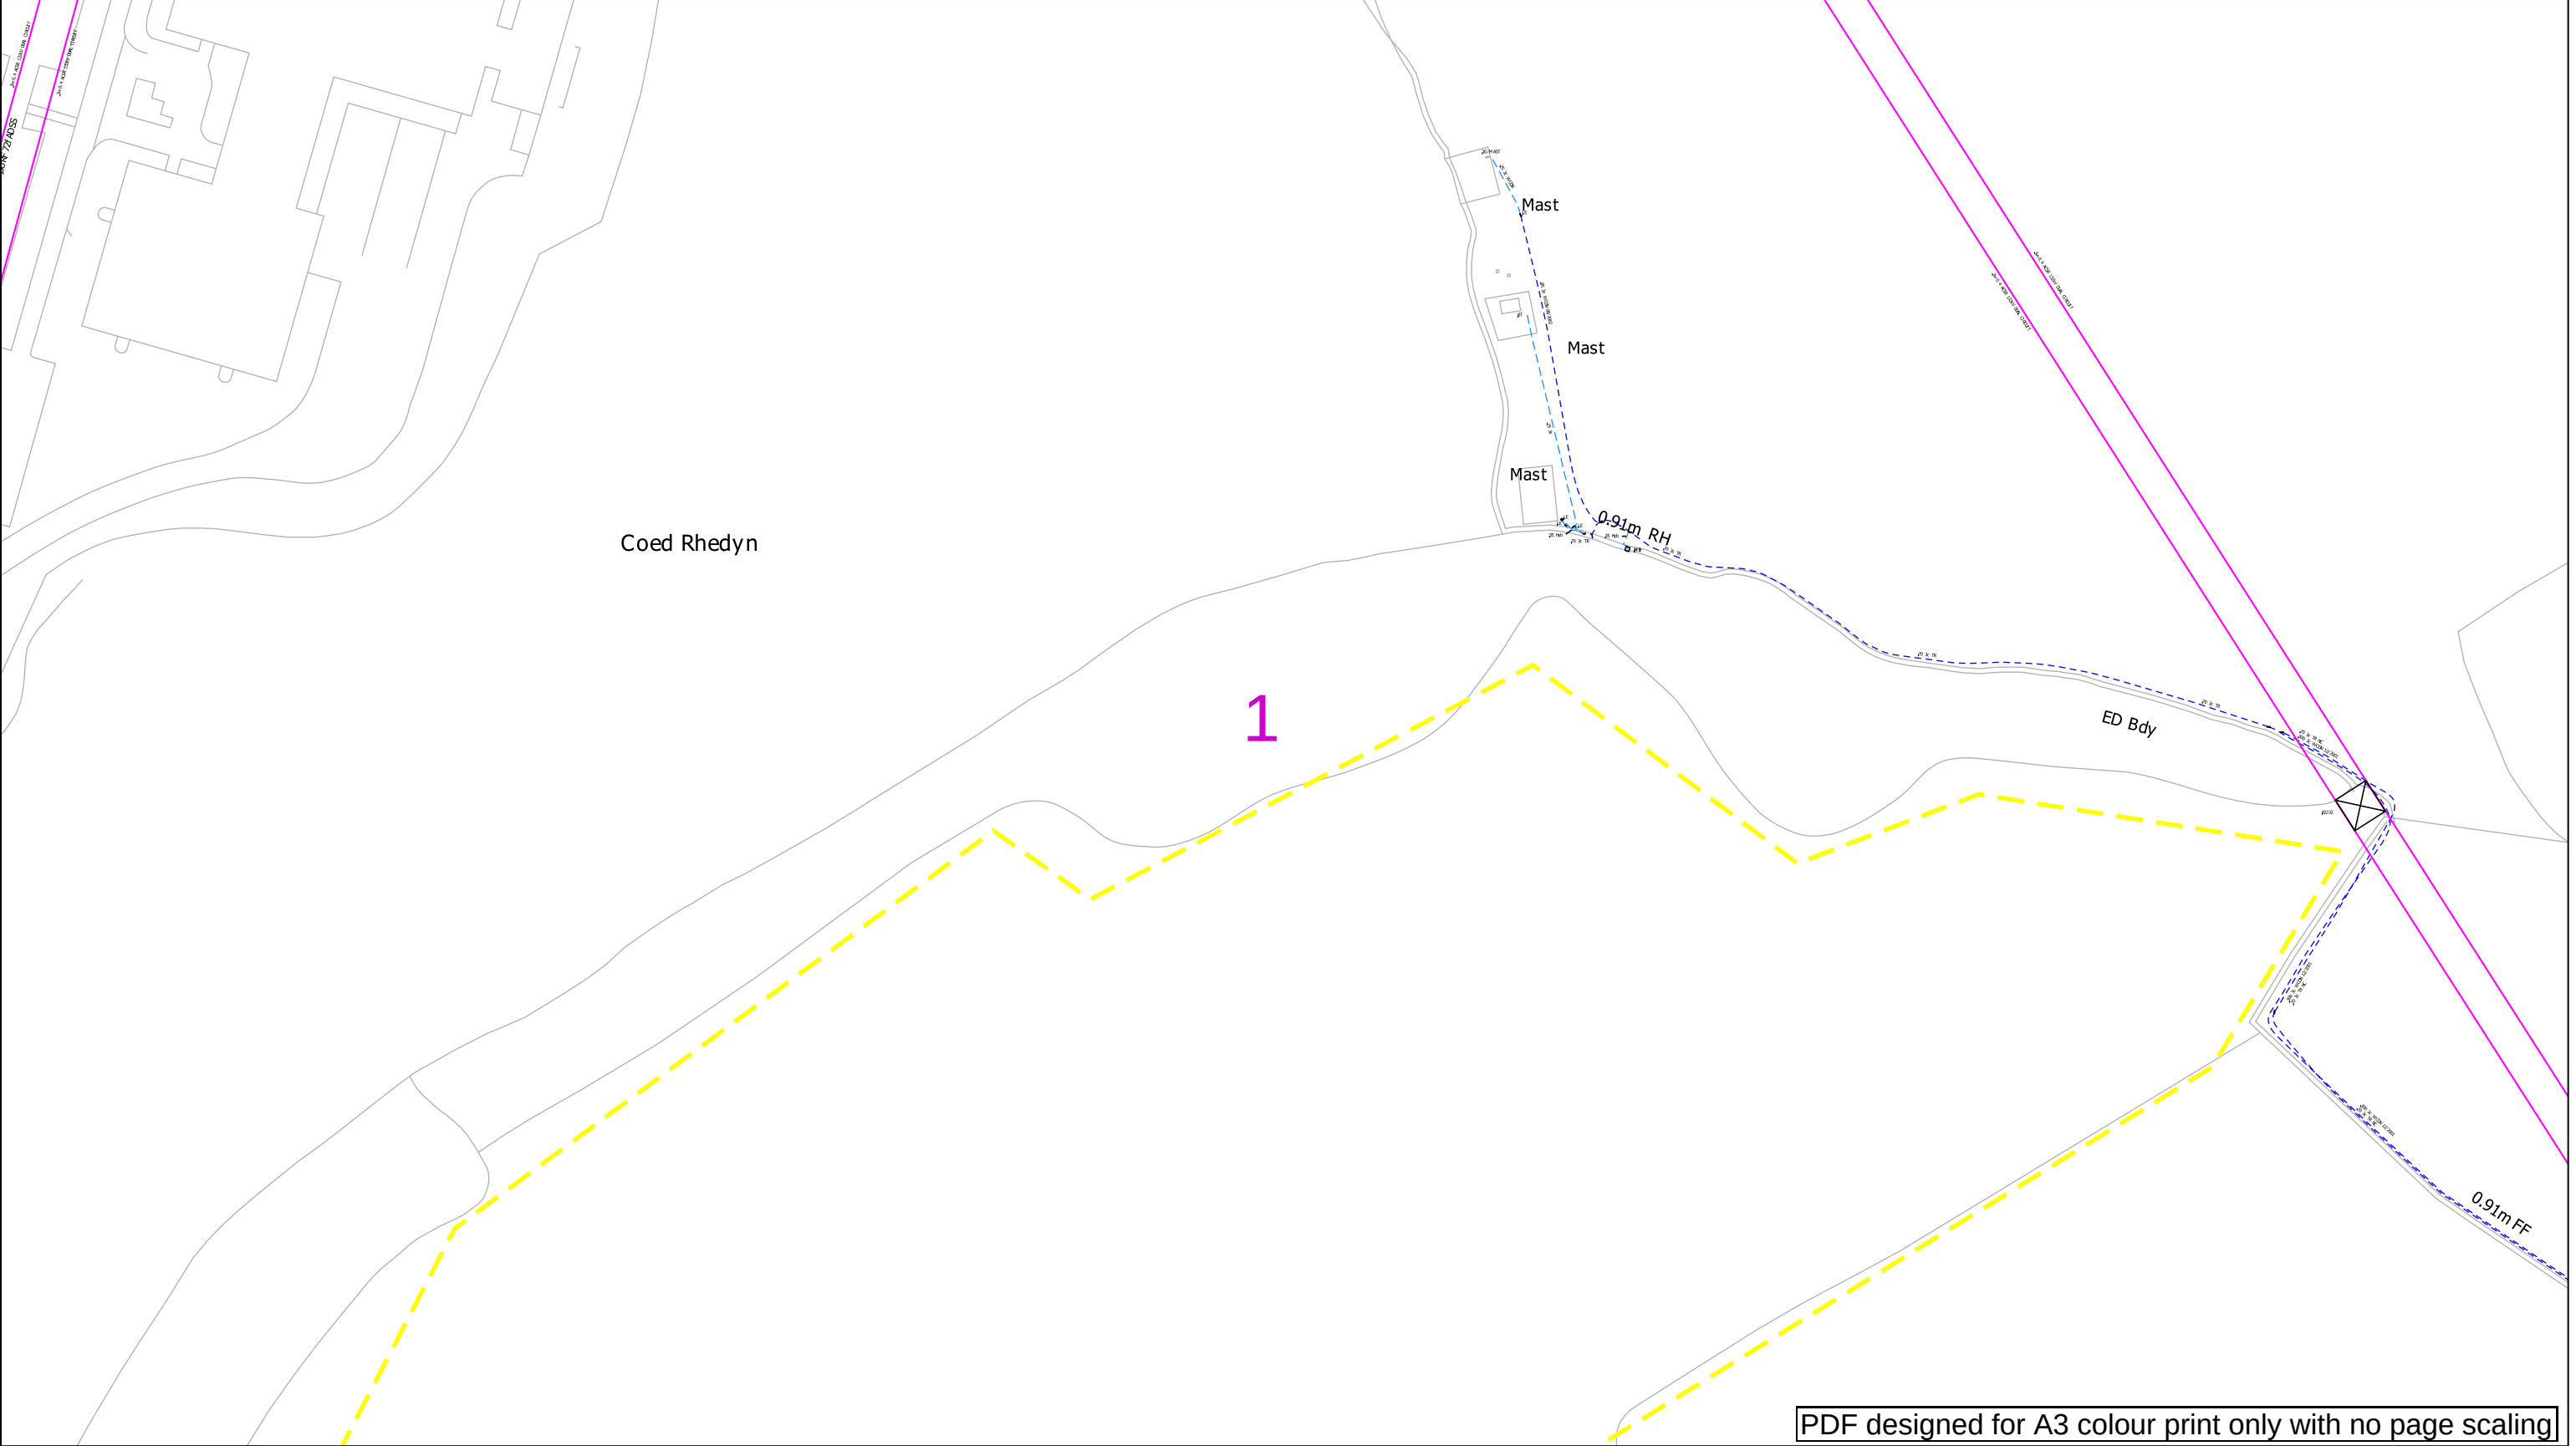

PDF designed for A3 colour print only with no page scaling

Contact Us Mapping Enquiries: 0121 623 9780 General Enquiries: 0800 096 3080 Date Requested: 17/06/2024 Job Reference: 33763539 Site Location: 336301 189188 Requested by: Mr Geraint Roberts Your Scheme/Reference: 24/0467 Scale: 1:1250 (When plotted at A3)	IMPORTANT NOTICES - This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown. - Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown. - You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47. - When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6. - For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080. - Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080	0 100m <table><tr><td> Link Box ● Site Location Line/Area — — — — — </td><td> Overhead Line <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table></td><td> Underground Cable <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table></td><td> National Grid Telecoms — — — — — Private Cables — — — — — PME Earth — — — — — Underground Earth — — — — — </td><td> Pilot Cables — — — — — Pole Mounted Transformer — — — — — Ground Mounted Transformer — — — — — </td></tr></table> Report damage immediately KEEP EVERYONE AWAY FROM THE AREA 0800 6783 105	Link Box ● Site Location Line/Area — — — — —	Overhead Line <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table>	— — — — —	PL	— — — — —	Service	— — — — —	LV	— — — — —	HV (11kV)	— — — — —	HV (33kV)	— — — — —	HV (66kV)	— — — — —	HV (132kV)	Underground Cable <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table>	— — — — —	PL	— — — — —	Service	— — — — —	LV	— — — — —	HV (11kV)	— — — — —	HV (33kV)	— — — — —	HV (66kV)	— — — — —	HV (132kV)	National Grid Telecoms — — — — — Private Cables — — — — — PME Earth — — — — — Underground Earth — — — — —	Pilot Cables — — — — — Pole Mounted Transformer — — — — — Ground Mounted Transformer — — — — —	nationalgrid Electricity Distribution Email: NGED.MapResponse@NationalGrid.co.uk
Link Box ● Site Location Line/Area — — — — —	Overhead Line <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table>	— — — — —	PL	— — — — —	Service	— — — — —	LV	— — — — —	HV (11kV)	— — — — —	HV (33kV)	— — — — —	HV (66kV)	— — — — —	HV (132kV)	Underground Cable <table><tr><td>— — — — —</td><td>PL</td></tr><tr><td>— — — — —</td><td>Service</td></tr><tr><td>— — — — —</td><td>LV</td></tr><tr><td>— — — — —</td><td>HV (11kV)</td></tr><tr><td>— — — — —</td><td>HV (33kV)</td></tr><tr><td>— — — — —</td><td>HV (66kV)</td></tr><tr><td>— — — — —</td><td>HV (132kV)</td></tr></table>	— — — — —	PL	— — — — —	Service	— — — — —	LV	— — — — —	HV (11kV)	— — — — —	HV (33kV)	— — — — —	HV (66kV)	— — — — —	HV (132kV)	National Grid Telecoms — — — — — Private Cables — — — — — PME Earth — — — — — Underground Earth — — — — —	Pilot Cables — — — — — Pole Mounted Transformer — — — — — Ground Mounted Transformer — — — — —				
— — — — —	PL																																			
— — — — —	Service																																			
— — — — —	LV																																			
— — — — —	HV (11kV)																																			
— — — — —	HV (33kV)																																			
— — — — —	HV (66kV)																																			
— — — — —	HV (132kV)																																			
— — — — —	PL																																			
— — — — —	Service																																			
— — — — —	LV																																			
— — — — —	HV (11kV)																																			
— — — — —	HV (33kV)																																			
— — — — —	HV (66kV)																																			
— — — — —	HV (132kV)																																			

Crown Copyright © All Rights Reserved. Ordnance Survey Licence numbers: 100022432. NGED Copyright: This copy has been made by or with the authority of National Grid Electricity Distribution (NGED) pursuant to Section 47 of the Copyright Designs and Patents Act 1988 unless that Act provides a relevant exception to copyright the copy must not be copied without the prior permission of the copyright owner.

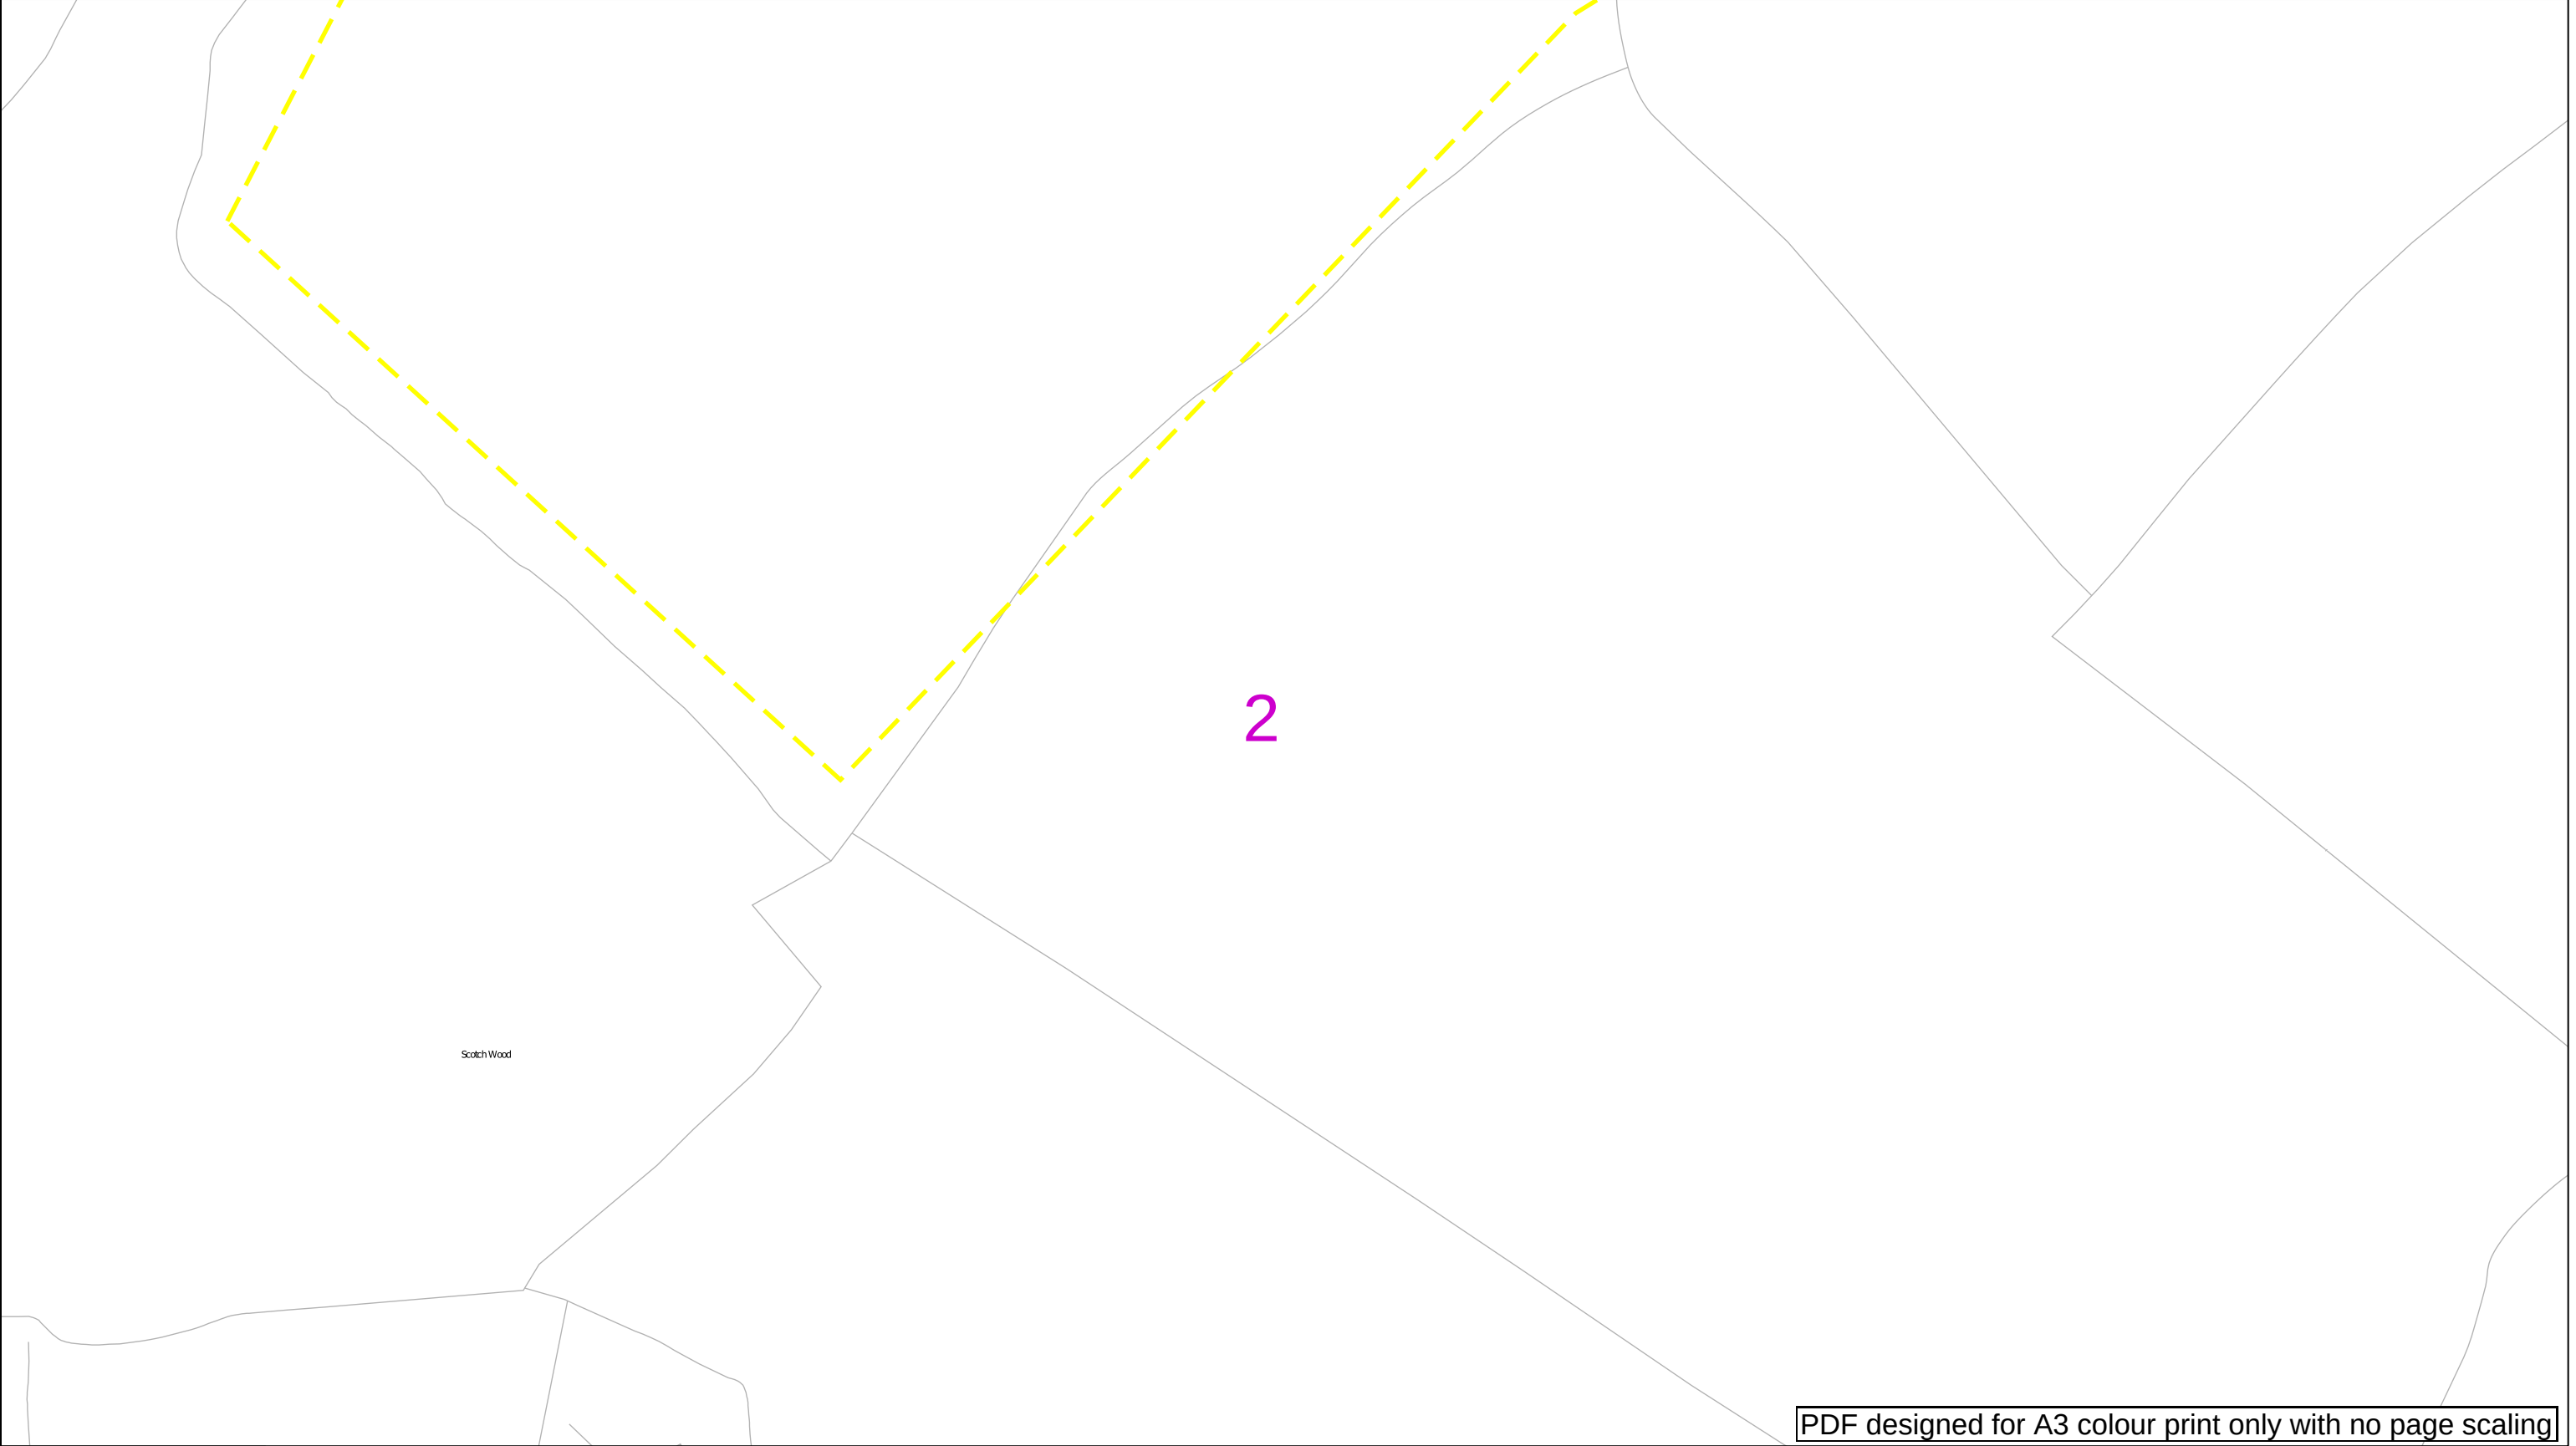

PDF designed for A3 colour print only with no page scaling

Contact Us

Mapping Enquiries: 0121 623 9780

General Enquiries: 0800 096 3080

Date Requested: 17/06/2024

Job Reference: 33763539

Site Location: 336301 189188

Requested by: Mr Geraint Roberts

Your Scheme/Reference: 24/0467

Scale: 1:1250 (When plotted at A3)

IMPORTANT NOTICES

- This information is given as a guide only and its accuracy cannot be guaranteed. Services or recent additions to the network may not be shown.
- Cables, overhead lines & substations owned by other electricity network owners or private companies may be present and may not be shown.
- You should always verify exact locations of cables using a cable locator and by careful use of hand tools in accordance with HSE guidance note HSG47.
- When working within 10m of any overhead electric line you should follow the requirements of HSE Guidance Note GS6.
- For further advice on working near our electricity cables or lines, call our Contact Centre on 0800 096 3080.
- Advice should be sought from the National Grid Electricity Distribution Contact Centre for any work that is to take place in proximity to 66kV or 132kV underground cables and 66kV 132kV overhead lines – 0800 096 3080

0100m

Link Box

●

Site Location

Line/Area

└─┬─┘

Overhead Line

○

○

○

○

○

⊠

PL

Service

LV

HV (11kV)

HV (33kV)

HV (66kV)

HV (132kV)

Underground Cable

National Grid Telecoms

—S—S—

Private Cables

|||||

PME Earth

—E—|||||

Underground Earth

Pilot Cables

—P—P—

○

□

Pole Mounted Transformer

Ground Mounted Transformer

Report damage immediately KEEP EVERYONE AWAY FROM THE AREA

0800 6783 105

nationalgrid

Electricity Distribution

Email: NGED.MapResponse@NationalGrid.co.uk